



OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL




Area
EOLUS SAFE HARBOUR PORT [46004111]

Machine Id
11425272

Component
Wind Turbine Gearbox

Fluid
FUCHS RENOLIN CLP ISO 320 (--- LTR)

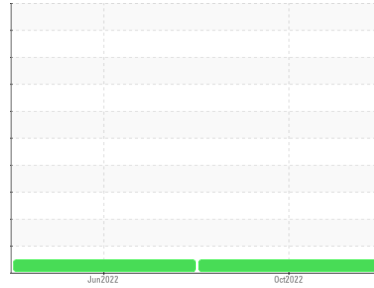

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the component. The amount and size of particulates present in the system is acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		NX012576	NX011459	---
Sample Date	Client Info		19 Oct 2022	25 Jun 2022	---
Machine Age	hrs	Client Info	0	0	---
Oil Age	hrs	Client Info	0	0	---
Oil Changed	Client Info		N/A	Not Changd	---
Sample Status			NORMAL	NORMAL	---

WEAR METALS

	method	limit/base	current	history1	history2
PQ	ASTM D8184	>80	12	20	---
Iron	ppm	ASTM D5185m	>150	1	1
Chromium	ppm	ASTM D5185m	>5	0	0
Nickel	ppm	ASTM D5185m	>10	0	0
Titanium	ppm	ASTM D5185m	>10	0	0
Silver	ppm	ASTM D5185m		0	0
Aluminum	ppm	ASTM D5185m	>10	0	0
Lead	ppm	ASTM D5185m	>20	<1	<1
Copper	ppm	ASTM D5185m	>50	0	0
Tin	ppm	ASTM D5185m	>3	0	0
Vanadium	ppm	ASTM D5185m		0	0
Cadmium	ppm	ASTM D5185m		0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	4
Barium	ppm	ASTM D5185m		0	2
Molybdenum	ppm	ASTM D5185m		0	0
Manganese	ppm	ASTM D5185m		0	0
Magnesium	ppm	ASTM D5185m		0	0
Calcium	ppm	ASTM D5185m		20	17
Phosphorus	ppm	ASTM D5185m		218	192
Zinc	ppm	ASTM D5185m		0	3
Sulfur	ppm	ASTM D5185m		5831	4586

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>50	4	7
Sodium	ppm	ASTM D5185m	>20	0	0
Potassium	ppm	ASTM D5185m	>20	0	<1
Water	%	ASTM D6304	>0.05	0.011	0.007
ppm Water	ppm	ASTM D6304	>500	111.6	73.9

FLUID CLEANLINESS





	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		10804	6643	---
Particles >6µm	ASTM D7647	>2500	1306	747	---
Particles >14µm	ASTM D7647	>320	86	74	---
Particles >21µm	ASTM D7647	>80	22	19	---
Particles >38µm	ASTM D7647	>20	1	7	---
Particles >71µm	ASTM D7647	>4	1	4	---
Oil Cleanliness	ISO 4406 (c)	>--/18/15	21/18/14	20/17/13	---

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.47	0.44



OIL ANALYSIS REPORT

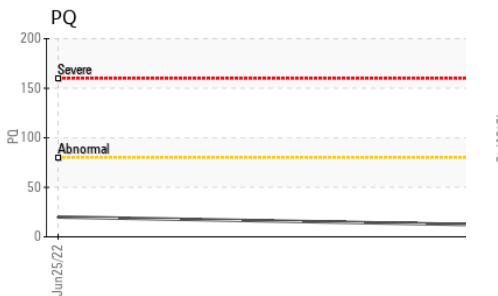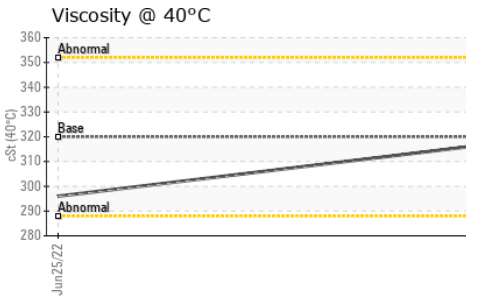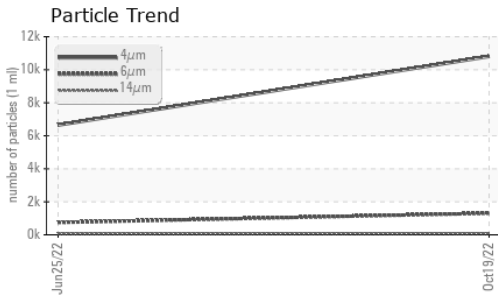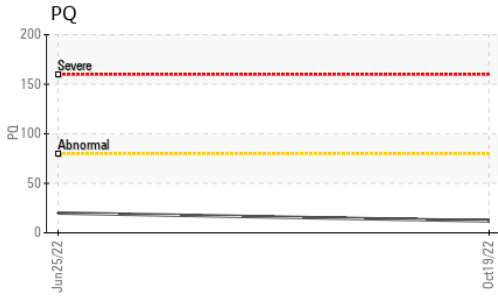




VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	320	317	296

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------



GRAPHS

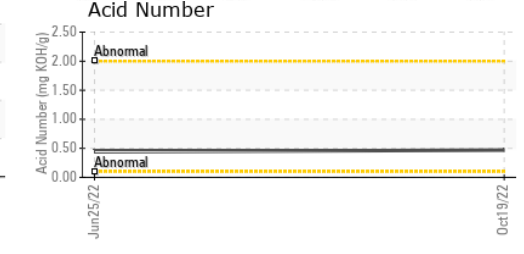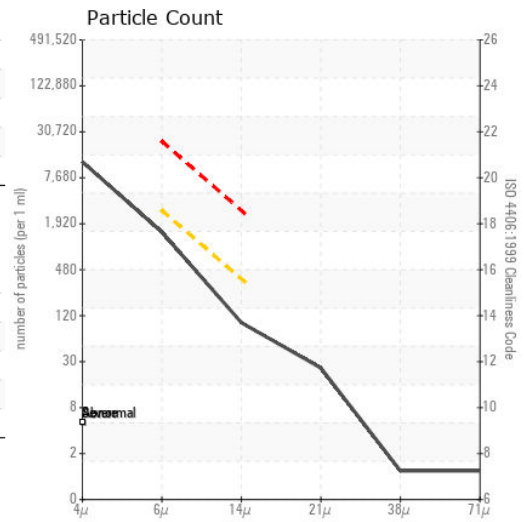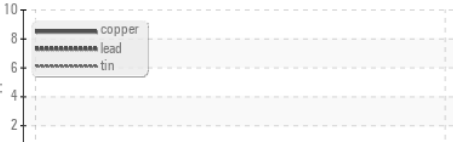

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : NX012576 **Received** : 08 Nov 2022
Lab Number : 05687863 **Diagnosed** : 14 Nov 2022
Unique Number : 10207435 **Diagnostician** : Angela Borella
Test Package : IND 2 (Additional Tests: KF, PQ, PrtCount)

NORDEX USA - Chicago
 300 SOUTH WACKER DRIVE, SUITE 1500
 CHICAGO, IL
 US 60606
 Contact: DEVIN LINEHAN
 DLinehan@nordex-online.com
 T: (312)386-4124
 F: (312)386-7102

Certificate L2367
 To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)