




OIL ANALYSIS REPORT

Sample Rating Trend

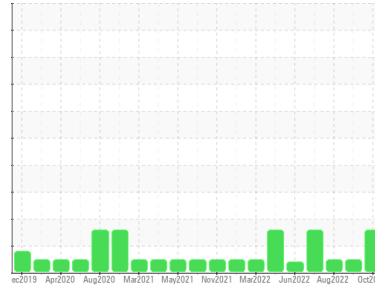

ISO



Area
RIG 1
Machine Id
CATERPILLAR 3512 R1-G-02-NKL
Component
Diesel Engine
Fluid
CHEVRON 15W40 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of particulates present in the oil.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		KL0009801	KL0008381	KL0008391
Sample Date	Client Info		28 Oct 2022	23 Sep 2022	29 Aug 2022
Machine Age	days	Client Info	44855	44806	44808
Oil Age	days	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			ATTENTION	NORMAL	NORMAL

CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>5	<1.0	<1.0	<1.0
Water	WC Method	>0.2	NEG	NEG	NEG
Glycol	WC Method		NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >100	4	5	5
Chromium	ppm	ASTM D5185m >20	<1	<1	0
Nickel	ppm	ASTM D5185m >2	0	0	0
Titanium	ppm	ASTM D5185m >2	0	0	0
Silver	ppm	ASTM D5185m >2	2	0	<1
Aluminum	ppm	ASTM D5185m >25	4	3	3
Lead	ppm	ASTM D5185m >40	<1	<1	<1
Copper	ppm	ASTM D5185m >330	68	148	323
Tin	ppm	ASTM D5185m >15	<1	0	<1
Vanadium	ppm	ASTM D5185m	<1	<1	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	328	328	333
Barium	ppm	ASTM D5185m	0	0	<1
Molybdenum	ppm	ASTM D5185m	133	136	141
Manganese	ppm	ASTM D5185m	<1	<1	<1
Magnesium	ppm	ASTM D5185m	643	694	635
Calcium	ppm	ASTM D5185m	1495	1591	1599
Phosphorus	ppm	ASTM D5185m	675	726	704
Zinc	ppm	ASTM D5185m	828	866	849
Sulfur	ppm	ASTM D5185m	2956	3055	2397

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	10	6	9
Sodium	ppm	ASTM D5185m >50	0	0	0
Potassium	ppm	ASTM D5185m >20	2	2	2


INFRA-RED

	method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844 >3	0.1	0.2	0.2
Nitration	Abs/cm	*ASTM D7624 >20	8	7.8	9.9
Sulfation	Abs./1mm	*ASTM D7415 >30	27	26.2	26.8




OIL ANALYSIS REPORT


▲ Particle Trend

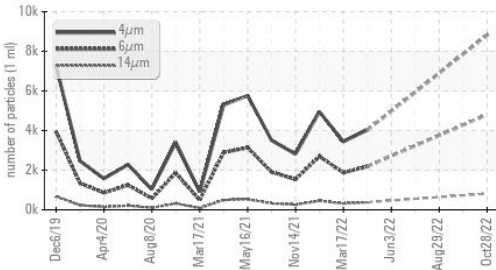


▲ Particle Trend

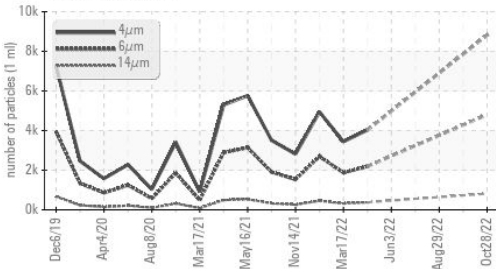

Base Number

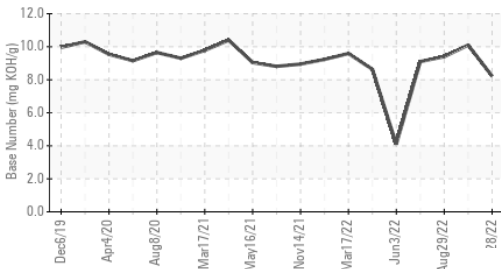

Viscosity @ 100°C

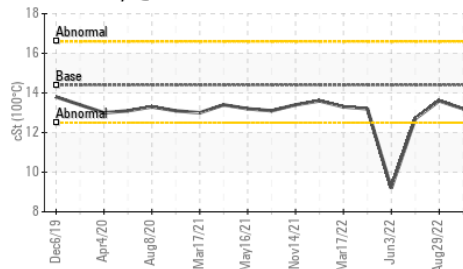

FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		8817	---	---
Particles >6µm	ASTM D7647	>5000	4803	---	---
Particles >14µm	ASTM D7647	>640	▲ 817	---	---
Particles >21µm	ASTM D7647	>160	▲ 275	---	---
Particles >38µm	ASTM D7647	>40	▲ 43	---	---
Particles >71µm	ASTM D7647	>10	4	---	---
Oil Cleanliness	ISO 4406 (c)	>19/16	▲ 19/17	---	---


FLUID DEGRADATION	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm *ASTM D7414	>25	19.4	18.9	20.6
Base Number (BN)	mg KOH/g ASTM D2896		8.22	10.1	9.4

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar *Visual	NONE	LIGHT	NONE	NONE
Yellow Metal	scalar *Visual	NONE	NONE	NONE	NONE
Precipitate	scalar *Visual	NONE	NONE	NONE	NONE
Silt	scalar *Visual	NONE	NONE	NONE	NONE
Debris	scalar *Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar *Visual	NONE	NONE	NONE	NONE
Appearance	scalar *Visual	NORML	NORML	NORML	NORML
Odor	scalar *Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar *Visual	>0.2	NEG	NEG	NEG
Free Water	scalar *Visual		NEG	NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt ASTM D445	14.4	13.5	13.2	13.6

GRAPHS


Ferrous Alloys

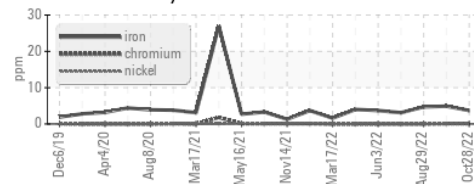


Non-ferrous Metals

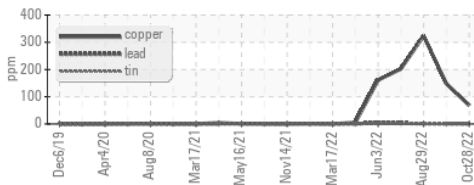


Viscosity @ 100°C

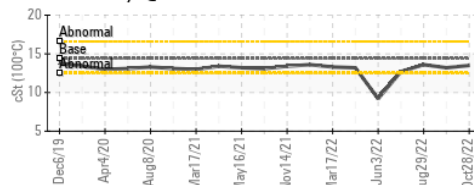

▲ Particle Count

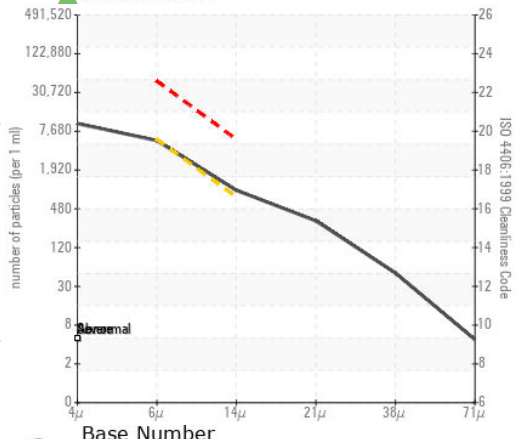

Base Number

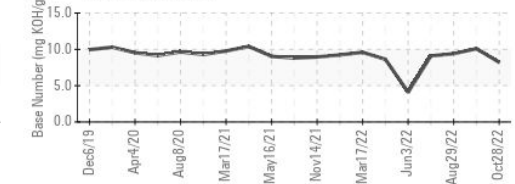

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
 Sample No. : KL0009801 Recieved : 14 Nov 2022
 Lab Number : 05693498 Diagnosed : 16 Nov 2022
 Unique Number : 10218071 Diagnostician : Jonathan Hester
 Test Package : MOB 2 (Additional Tests: PrtCount)

CITADEL DRILLING
 7550 W I20
 ODESSA, TX
 US 79763
 Contact: MIKE COMBDEN
 mcombden@citadelldrilling.com
 T: (780)955-5509
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)