




PROBLEM SUMMARY

Sample Rating Trend


ISO

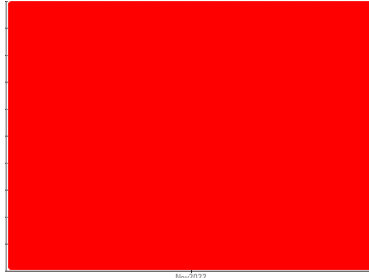

Machine Id
6177830 (S/N 1035)

Component
Compressor
Fluid
NOT GIVEN (--- GAL)

COMPONENT CONDITION SUMMARY

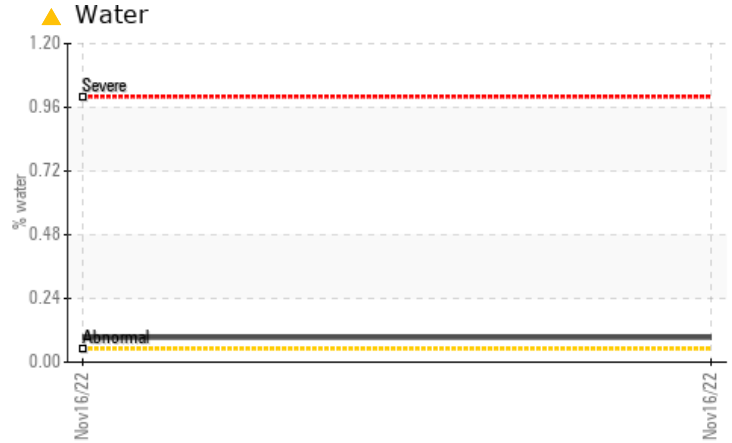

RECOMMENDATION

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status				SEVERE	---	---
Water	%	ASTM D6304	>0.05	▲ 0.093	---	---
ppm Water	ppm	ASTM D6304	>500	▲ 930.5	---	---
Particles >6µm		ASTM D7647	>1300	● 32776	---	---
Particles >14µm		ASTM D7647	>80	● 3416	---	---
Particles >21µm		ASTM D7647	>20	● 1115	---	---
Particles >38µm		ASTM D7647	>4	● 135	---	---
Oil Cleanliness		ISO 4406 (c)	>--/17/13	● 24/22/19	---	---

Customer Id: CERFRECA
Sample No.: KCP28704
Lab Number: 05696970
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Angela Borella +1 800-237-1369
angela.borella@wearcheckusa.com

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS


Action	Status	Date	Done By	Description
Change Fluid	---	---	?	Oil and filter change at the time of sampling has been noted.
Change Filter	---	---	?	Oil and filter change at the time of sampling has been noted.

HISTORICAL DIAGNOSIS

OIL ANALYSIS REPORT

Sample Rating Trend

ISO

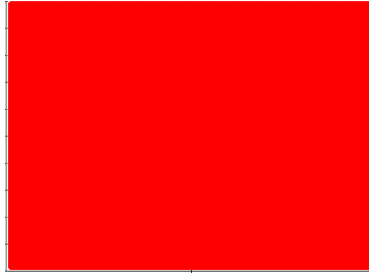

Machine Id
6177830 (S/N 1035)

Component
Compressor

Fluid
NOT GIVEN (--- GAL)

DIAGNOSIS

Recommendation

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil. There is a light concentration of water present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		KCP28704	---	---
Sample Date	Client Info		16 Nov 2022	---	---
Machine Age	hrs	Client Info	27480	---	---
Oil Age	hrs	Client Info	4000	---	---
Oil Changed	Client Info		Changed	---	---
Sample Status			SEVERE	---	---

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<1	---	---
Chromium	ppm	ASTM D5185m >10	0	---	---
Nickel	ppm	ASTM D5185m >3	0	---	---
Titanium	ppm	ASTM D5185m >3	0	---	---
Silver	ppm	ASTM D5185m >2	2	---	---
Aluminum	ppm	ASTM D5185m >10	<1	---	---
Lead	ppm	ASTM D5185m >10	0	---	---
Copper	ppm	ASTM D5185m >50	6	---	---
Tin	ppm	ASTM D5185m >10	0	---	---
Vanadium	ppm	ASTM D5185m	0	---	---
Cadmium	ppm	ASTM D5185m	0	---	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	---	---
Barium	ppm	ASTM D5185m	0	---	---
Molybdenum	ppm	ASTM D5185m	0	---	---
Manganese	ppm	ASTM D5185m	0	---	---
Magnesium	ppm	ASTM D5185m	4	---	---
Calcium	ppm	ASTM D5185m	<1	---	---
Phosphorus	ppm	ASTM D5185m	10	---	---
Zinc	ppm	ASTM D5185m	58	---	---
Sulfur	ppm	ASTM D5185m	23031	---	---

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	2	---	---
Sodium	ppm	ASTM D5185m	6	---	---
Potassium	ppm	ASTM D5185m >20	3	---	---
Water	%	ASTM D6304 >0.05	▲ 0.093	---	---
ppm Water	ppm	ASTM D6304 >500	▲ 930.5	---	---






FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		119483	---	---
Particles >6µm	ASTM D7647 >1300		▲ 32776	---	---
Particles >14µm	ASTM D7647 >80		▲ 3416	---	---
Particles >21µm	ASTM D7647 >20		▲ 1115	---	---
Particles >38µm	ASTM D7647 >4		▲ 135	---	---
Particles >71µm	ASTM D7647 >3		4	---	---
Oil Cleanliness	ISO 4406 (c) >--/17/13		▲ 24/22/19	---	---

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.30	---	---

OIL ANALYSIS REPORT

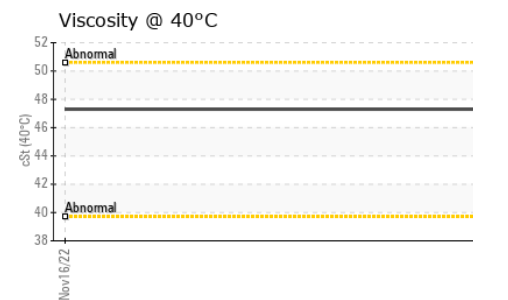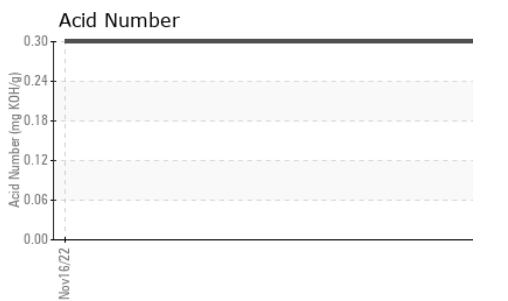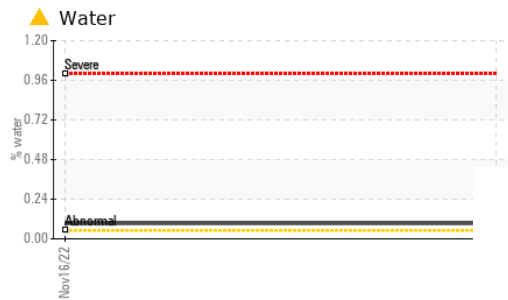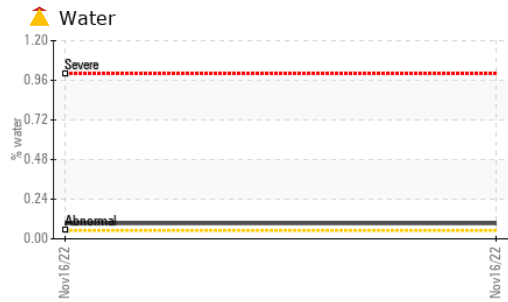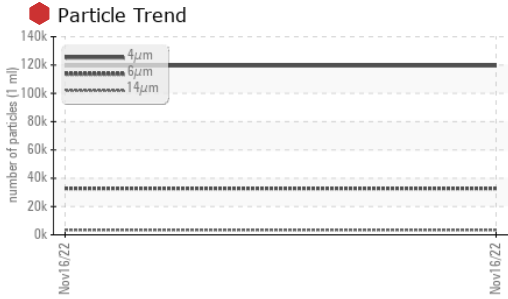





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	LIGHT	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	47.3	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color		no image	no image
Bottom		no image	no image

GRAPHS

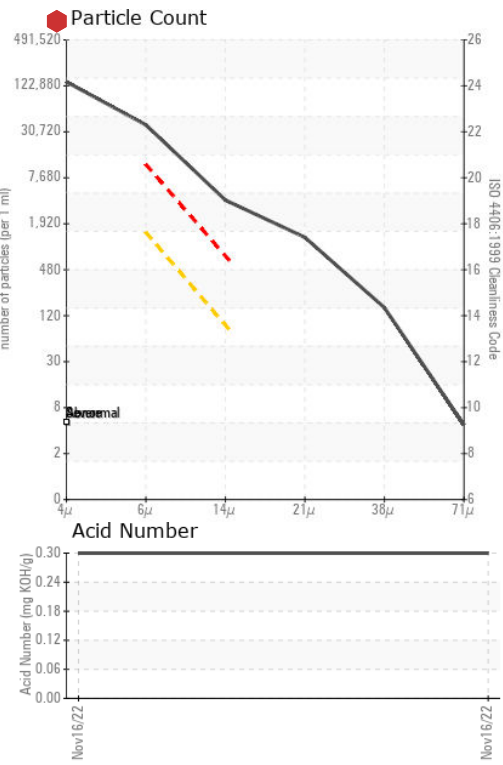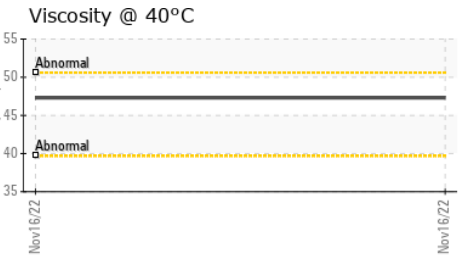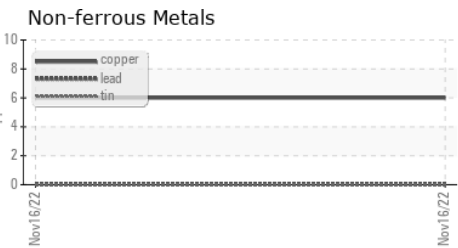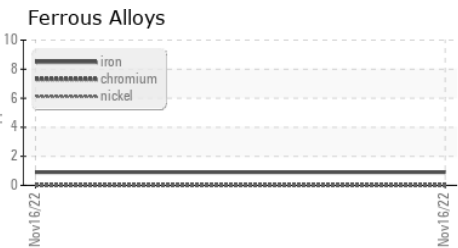

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCP28704 **Received** : 17 Nov 2022
Lab Number : 05696970 **Diagnosed** : 18 Nov 2022
Unique Number : 10221543 **Diagnostician** : Angela Borella
Test Package : IND 2 (Additional Tests: KF, PrtCount)

CERAMIC TECH
 46211 RESEARCH AVE
 FREMONT, CA
 US 94539
 Contact: RICH WININGAR
 RICH.WININGAR@CERAMICTECHINC.COM
 T:
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)