


## **OIL ANALYSIS REPORT**

Sample Rating Trend



NORMAL



# Machine Id 7040975 (S/N 1006)

Component

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

#### DIAGNOSIS

#### Recommendation

The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

#### Contamination

The amount and size of particulates present in the system are acceptable.

#### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

		Feb 2020	Jun2020 Sep2020 Jun20	21 Oct2021 Jan2022 Jul2022	Nov2022	
SAMPLE INFOR	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC107653	KC95149	KC94518
Sample Date		Client Info		14 Nov 2022	14 Jul 2022	10 Jan 2022
Machine Age	hrs	Client Info		27192	24242	19809
Oil Age	hrs	Client Info		2950	1316	1653
Oil Changed		Client Info		Not Changd	Changed	Changed
Sample Status				NORMAL	NORMAL	ATTENTION
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	1	<1
Chromium	ppm	ASTM D5185m	>10	<1	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	<1
Aluminum	ppm	ASTM D5185m	>10	1	2	1
Lead	ppm	ASTM D5185m	>10	<1	<1	0
Copper	ppm	ASTM D5185m	>50	6	15	6
Tin	ppm	ASTM D5185m	>10	<1	<1	<1
Antimony	ppm	ASTM D5185m				0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
	ррпп					
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<1	2	0
Barium	ppm	ASTM D5185m	90	0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	0	<1
Magnesium	ppm	ASTM D5185m	90	39	19	41
Calcium	ppm	ASTM D5185m	2	0	0	0
Phosphorus	ppm	ASTM D5185m		10	38	4
Zinc	ppm	ASTM D5185m		67	73	60
CONTAMINANTS	3	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	1	3	1
Sodium	ppm	ASTM D5185m		17	8	11
Potassium	ppm	ASTM D5185m	>20	6	6	2
Water	%	ASTM D6304	>0.05	0.015	0.012	0.009
ppm Water	ppm	ASTM D6304	>500	157.2	122.6	91.0
FLUID CLEANLIN	NESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		1209	1743	6599
Particles >6µm		ASTM D7647	>1300	289	581	<u> </u>
Particles >14µm		ASTM D7647	>80	35	70	<u> </u>
Particles >21µm		ASTM D7647		13	21	<u>^</u> 56
Particles >38µm		ASTM D7647	>4	1	0	3
Particles >71μm		ASTM D7647		0	0	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	17/15/12	18/16/13	<u>▲</u> 18/14
FLUID DEGRAD	ATION _	method	limit/base	current	history1	history2
					,	, , , , , , , , , , , , , , , , , , , ,

Acid Number (AN)

mg KOH/g ASTM D8045 0.4


0.43

0.42

0.423



## **OIL ANALYSIS REPORT**

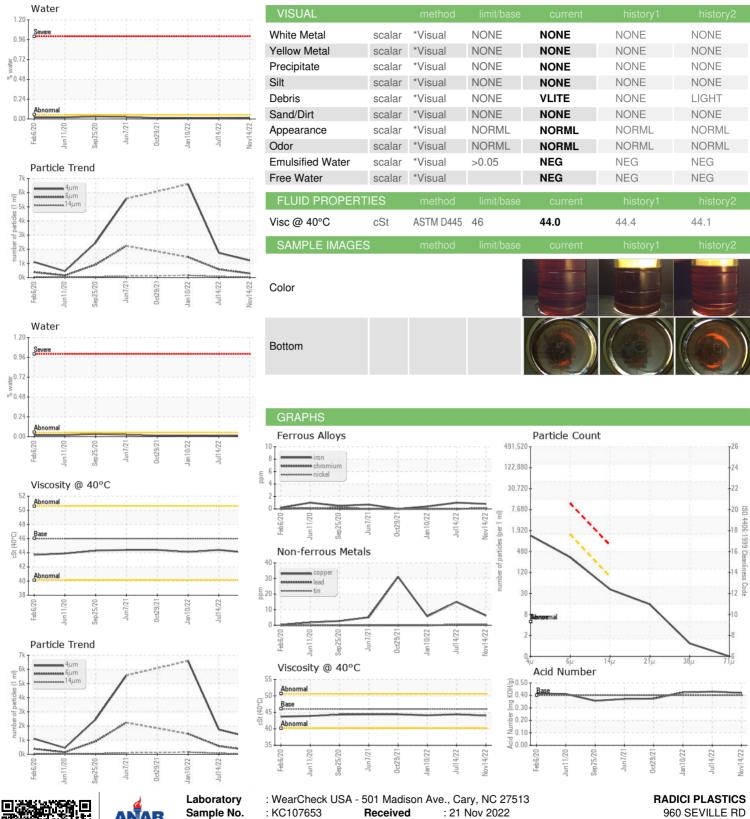





Certificate L2367

Sample No. Lab Number **Unique Number** Test Package

: 05699795

: KC107653 : 10229369 : IND 2

Received Diagnosed : 23 Nov 2022

Diagnostician : Angela Borella

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

US 44281

T: F:

WADSWORTH, OH

Contact: Service Manager