




# PROBLEM SUMMARY

Sample Rating Trend

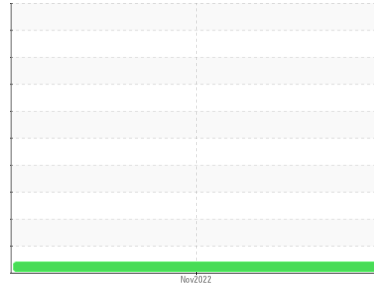


VISCOSITY



Machine Id  
**FRICK C2 - OIL SEPERATOR (S/N 11552R19991664)**  
 Component  
**Refrigeration Compressor**  
 Fluid  
**ISEL NXT 717 (--- GAL)**

## COMPONENT CONDITION SUMMARY

### ▲ Viscosity @ 40°C

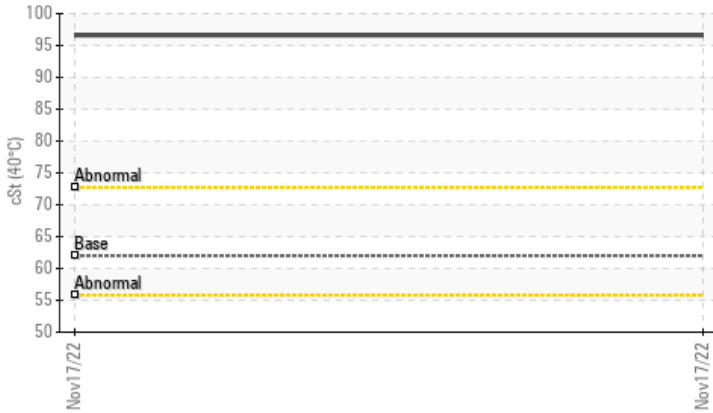

## RECOMMENDATION

No corrective action is recommended at this time.  
 Resample at the next service interval to monitor.

## PROBLEMATIC TEST RESULTS

Sample Status				<b>ABNORMAL</b>	---	---
Visc @ 40°C	cSt	ASTM D445	62	▲ 96.61	---	---

Customer Id: SPAPEN  
 Sample No.: WC0746971  
 Lab Number: 05701411  
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
 Jonathan Hester +1 919-379-4092 x4092  
[jhester@wearcheckusa.com](mailto:jhester@wearcheckusa.com)

To change component or sample information:  
 Customer Service +1 1-800-237-1369  
[customerservice@wearcheck.com](mailto:customerservice@wearcheck.com)

## RECOMMENDED ACTIONS


*There are no recommended actions for this sample.*

## HISTORICAL DIAGNOSIS



# OIL ANALYSIS REPORT

Sample Rating Trend

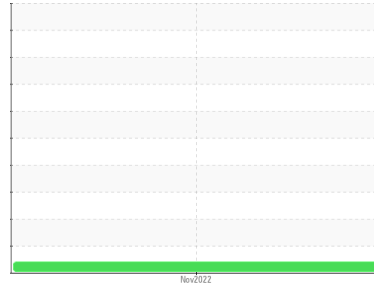

VISCOSITY



Machine Id  
**FRICK C2 - OIL SEPERATOR (S/N 11552R19991664)**  
 Component  
**Refrigeration Compressor**  
 Fluid  
**ISEL NXT 717 (--- GAL)**

## DIAGNOSIS

### ▲ Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

The water content is negligible. There is no indication of any contamination in the oil.

### ▲ Fluid Condition

The oil viscosity is higher than normal. The AN level is acceptable for this fluid.

## SAMPLE INFORMATION

	method	limit/base	current	history 1	history 2
Sample Number	Client Info		<b>WC0746971</b>	---	---
Sample Date	Client Info		<b>17 Nov 2022</b>	---	---
Machine Age	hrs	Client Info	<b>7706</b>	---	---
Oil Age	hrs	Client Info	<b>0</b>	---	---
Oil Changed	Client Info		<b>Not Changed</b>	---	---
Sample Status			<b>ABNORMAL</b>	---	---

## WEAR METALS

	method	limit/base	current	history 1	history 2
Iron	ppm	ASTM D5185m >50	<b>&lt;1</b>	---	---
Chromium	ppm	ASTM D5185m >10	<b>0</b>	---	---
Nickel	ppm	ASTM D5185m	<b>0</b>	---	---
Titanium	ppm	ASTM D5185m	<b>0</b>	---	---
Silver	ppm	ASTM D5185m	<b>0</b>	---	---
Aluminum	ppm	ASTM D5185m >10	<b>0</b>	---	---
Lead	ppm	ASTM D5185m >10	<b>0</b>	---	---
Copper	ppm	ASTM D5185m >50	<b>&lt;1</b>	---	---
Tin	ppm	ASTM D5185m >10	<b>0</b>	---	---
Vanadium	ppm	ASTM D5185m	<b>0</b>	---	---
Cadmium	ppm	ASTM D5185m	<b>0</b>	---	---

## ADDITIVES

	method	limit/base	current	history 1	history 2
Boron	ppm	ASTM D5185m	<b>0</b>	---	---
Barium	ppm	ASTM D5185m	<b>0</b>	---	---
Molybdenum	ppm	ASTM D5185m	<b>0</b>	---	---
Manganese	ppm	ASTM D5185m	<b>0</b>	---	---
Magnesium	ppm	ASTM D5185m	<b>0</b>	---	---
Calcium	ppm	ASTM D5185m	<b>3</b>	---	---
Phosphorus	ppm	ASTM D5185m	<b>2</b>	---	---
Zinc	ppm	ASTM D5185m	<b>4</b>	---	---
Sulfur	ppm	ASTM D5185m	<b>34</b>	---	---

## CONTAMINANTS




	method	limit/base	current	history 1	history 2
Silicon	ppm	ASTM D5185m >15	<b>0</b>	---	---
Sodium	ppm	ASTM D5185m	<b>0</b>	---	---
Potassium	ppm	ASTM D5185m >20	<b>0</b>	---	---
Water	%	ASTM D6304 >0.01	<b>0.004</b>	---	---
ppm Water	ppm	ASTM D6304 >100	<b>43.0</b>	---	---

## FLUID DEGRADATION

	method	limit/base	current	history 1	history 2
Acid Number (AN)	mg KOH/g	ASTM D974	<b>0.015</b>	---	---



# OIL ANALYSIS REPORT

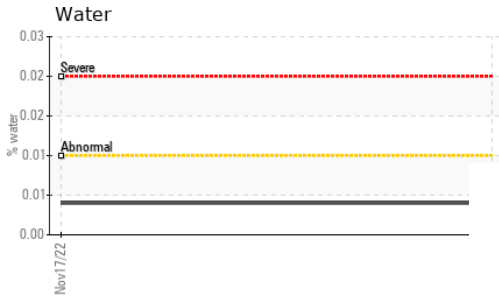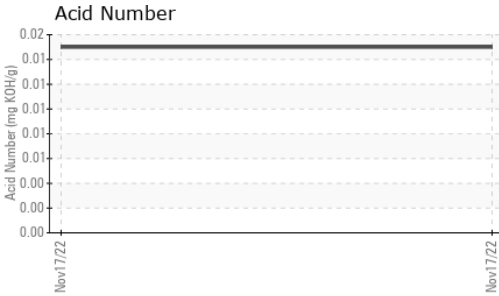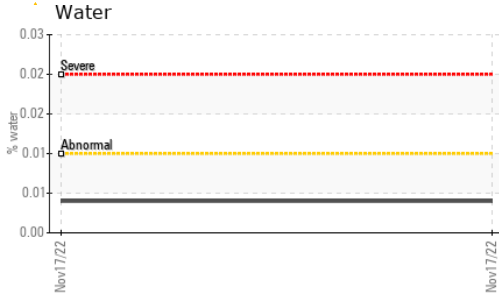





VISUAL	method	limit/base	current	history 1	history 2	
White Metal	scalar	*Visual	NONE	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	NONE	---	---
Precipitate	scalar	*Visual	NONE	NONE	---	---
Silt	scalar	*Visual	NONE	NONE	---	---
Debris	scalar	*Visual	NONE	NONE	---	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---	---
Appearance	scalar	*Visual	NORML	NORML	---	---
Odor	scalar	*Visual	NORML	NORML	---	---
Emulsified Water	scalar	*Visual	>0.01	NEG	---	---
Free Water	scalar	*Visual		NEG	---	---

FLUID PROPERTIES	method	limit/base	current	history 1	history 2
Visc @ 40°C	cSt	ASTM D445 62	▲ 96.61	---	---

SAMPLE IMAGES	method	limit/base	current	history 1	history 2
---------------	--------	------------	---------	-----------	-----------

Color		no image	no image
Bottom		no image	no image

### GRAPHS

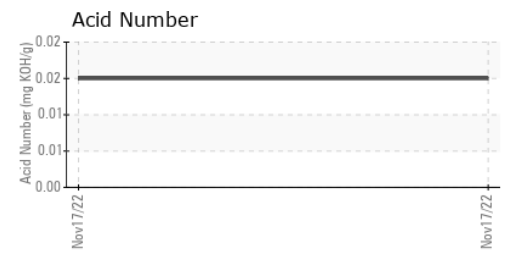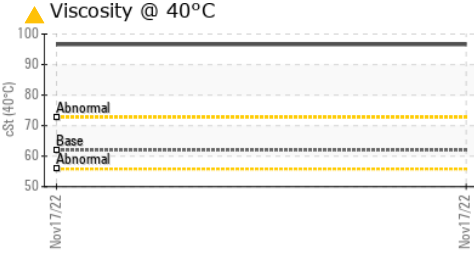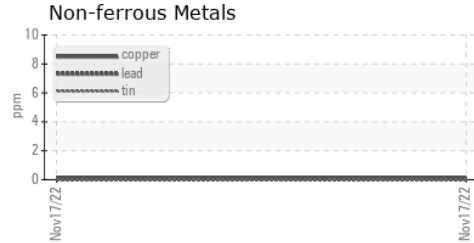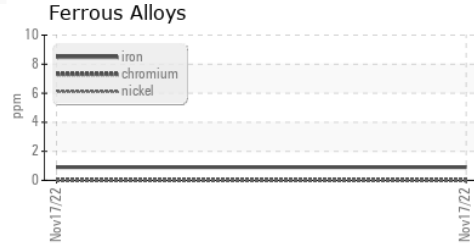

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0746971 **Received** : 23 Nov 2022  
**Lab Number** : 05701411 **Diagnosed** : 29 Nov 2022  
**Unique Number** : 10230985 **Diagnostician** : Jonathan Hester  
**Test Package** : IND 2

**SPARTAN NASH**  
 4150 W BLOUNT ST  
 PENSACOLA, FL  
 US 32505  
 Contact: TRACY  
 tracy@serfco.com  
 T:  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)