




# PROBLEM SUMMARY

Sample Rating Trend

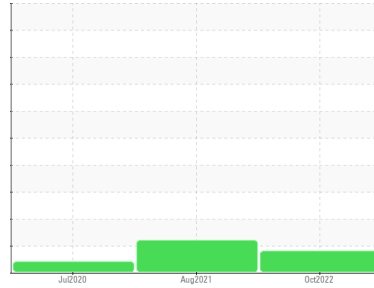

ISO




Machine Id  
**KAESER SX 7.5 5703906 (S/N 1049)**

Component  
**Compressor**

Fluid  
**KAESER SIGMA (OEM) M-460 (--- GAL)**

## COMPONENT CONDITION SUMMARY

▲ Particle Trend

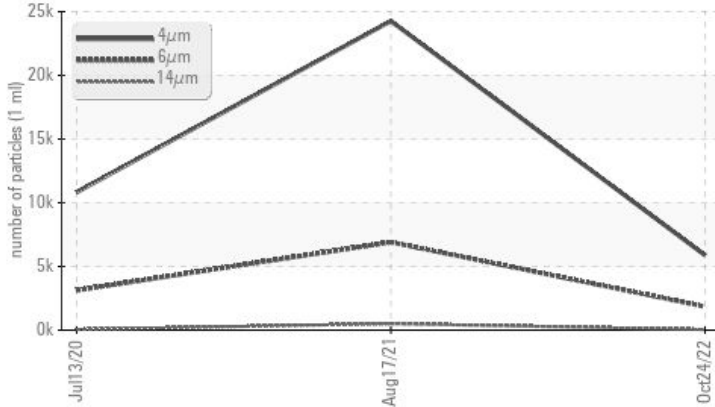

## RECOMMENDATION

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

## PROBLEMATIC TEST RESULTS

Sample Status		ATTENTION	ABNORMAL	ABNORMAL
Particles >6µm	ASTM D7647 >1300	▲ 1840	▲ 6904	▲ 3130
Oil Cleanliness	ISO 4406 (c) >--/17/13	▲ 20/18/13	▲ 20/16	▲ 19/13

Customer Id: ANCNORRI  
Sample No.: KCP50086  
Lab Number: 05702999  
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
Angela Borella +1 800-237-1369  
[angela.borella@wearcheckusa.com](mailto:angela.borella@wearcheckusa.com)

To change component or sample information:  
Customer Service +1 1-800-237-1369  
[customerservice@wearcheck.com](mailto:customerservice@wearcheck.com)

## RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Fluid	---	---	?	Oil and filter change at the time of sampling has been noted.
Change Filter	---	---	?	Oil and filter change at the time of sampling has been noted.

## HISTORICAL DIAGNOSIS

### 17 Aug 2021 Diag: Jonathan Hester

ISO



The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

[view report](#)



### 13 Jul 2020 Diag: Angela Borella

ISO




Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

[view report](#)



# OIL ANALYSIS REPORT

Sample Rating Trend

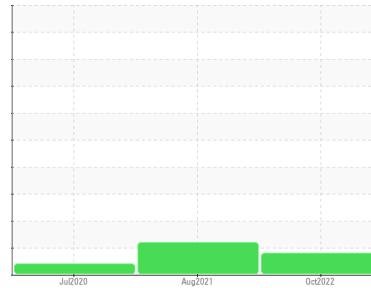

ISO



Machine Id  
**KAESER SX 7.5 5703906 (S/N 1049)**

Component  
**Compressor**

Fluid  
**KAESER SIGMA (OEM) M-460 (--- GAL)**

## DIAGNOSIS

### ▲ Recommendation

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### ▲ Contamination

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>KCP50086</b>	KCP41509	KCP10938
Sample Date	Client Info		<b>24 Oct 2022</b>	17 Aug 2021	13 Jul 2020
Machine Age	hrs	Client Info	<b>14245</b>	10069	5236
Oil Age	hrs	Client Info	<b>4176</b>	4833	1967
Oil Changed	Client Info		<b>Changed</b>	Not Changd	Changed
Sample Status			<b>ATTENTION</b>	ABNORMAL	ABNORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>&lt;1</b>	<1	<1
Chromium	ppm	ASTM D5185m >10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m >3	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m >3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >10	<b>0</b>	<1	0
Lead	ppm	ASTM D5185m >10	<b>0</b>	<1	0
Copper	ppm	ASTM D5185m >50	<b>12</b>	11	42
Tin	ppm	ASTM D5185m >10	<b>0</b>	<1	<1
Antimony	ppm	ASTM D5185m	<b>---</b>	0	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	<b>0</b>	13	1
Barium	ppm	ASTM D5185m 90	<b>&lt;1</b>	36	0
Molybdenum	ppm	ASTM D5185m 0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>0</b>	<1	<1
Magnesium	ppm	ASTM D5185m 100	<b>17</b>	48	7
Calcium	ppm	ASTM D5185m 0	<b>&lt;1</b>	0	<1
Phosphorus	ppm	ASTM D5185m 0	<b>4</b>	4	6
Zinc	ppm	ASTM D5185m 0	<b>42</b>	39	49
Sulfur	ppm	ASTM D5185m 23500	<b>21468</b>	15564	17233

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>&lt;1</b>	<1	4
Sodium	ppm	ASTM D5185m	<b>8</b>	9	6
Potassium	ppm	ASTM D5185m >20	<b>0</b>	<1	<1
Water	%	ASTM D6304 >0.05	<b>0.012</b>	0.019	0.010
ppm Water	ppm	ASTM D6304 >500	<b>128.2</b>	198.9	101.8






## FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>5880</b>	24264	10831
Particles >6µm	ASTM D7647 >1300		<b>▲ 1840</b>	▲ 6904	▲ 3130
Particles >14µm	ASTM D7647 >80		<b>44</b>	▲ 508	50
Particles >21µm	ASTM D7647 >20		<b>10</b>	▲ 130	8
Particles >38µm	ASTM D7647 >4		<b>1</b>	4	0
Particles >71µm	ASTM D7647 >3		<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c) >--/17/13		<b>▲ 20/18/13</b>	▲ 20/16	▲ 19/13

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 1.0	<b>0.28</b>	0.512	0.190

# OIL ANALYSIS REPORT

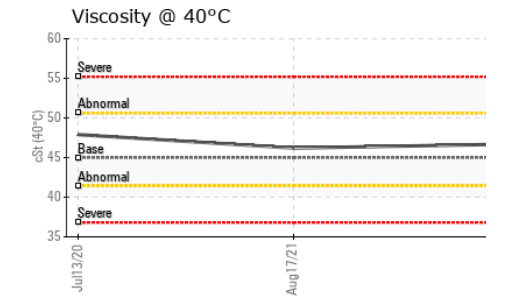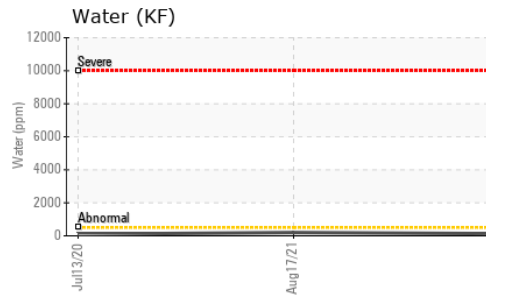
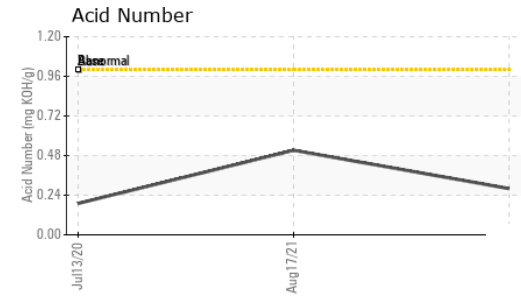
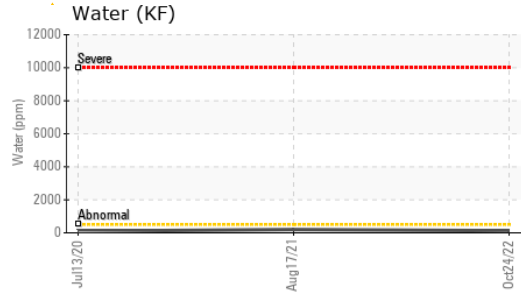
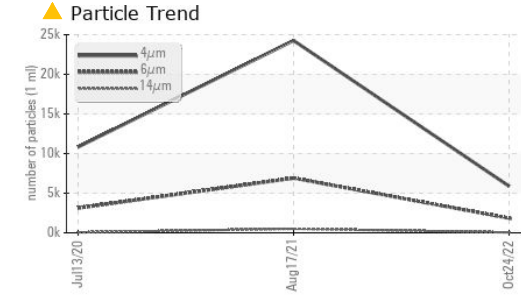


PARAMETER	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 45	46.7	46.2	47.9

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

## GRAPHS

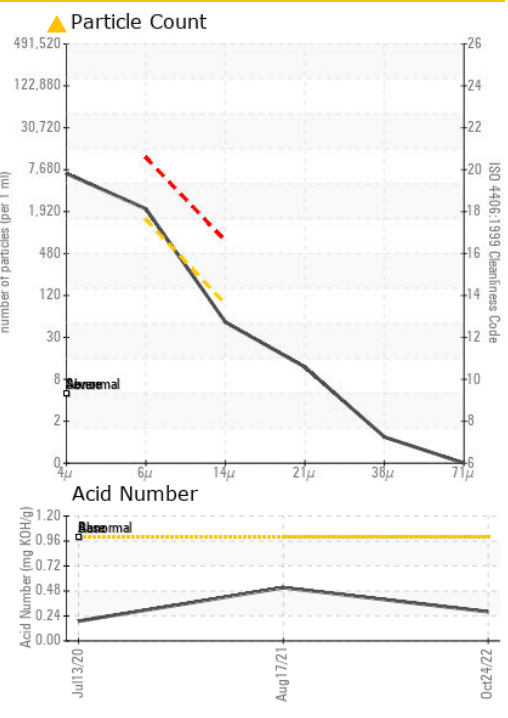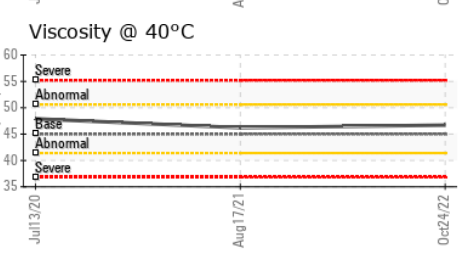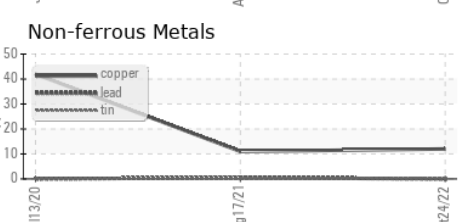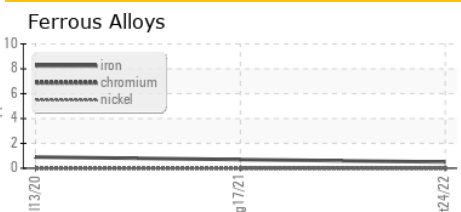

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCP50086 **Received** : 25 Nov 2022  
**Lab Number** : 05702999 **Diagnosed** : 29 Nov 2022  
**Unique Number** : 10232573 **Diagnostician** : Angela Borella  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**ANCHOR SALES**  
 1041 EDDIE DOWLING HWY  
 NORTH SMITHFIELD, RI  
 US 02896  
 Contact: A/P  
 nissanpayables@anchorautoequip.com  
 T:  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)