


# OIL ANALYSIS REPORT

## Sample Rating Trend



**NORMAL**

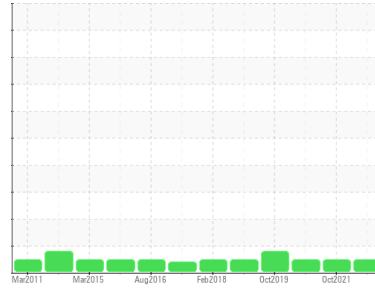

Machine Id  
**A102 (S/N 6409-07)**

Component  
**Wind Turbine Gearbox**

Fluid  
**MOBIL MOBILGEAR SHC XMP 320 (74 GAL)**

### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

### SAMPLE INFORMATION

|               | method      | limit/base  | current            | history1    | history2    |
|---------------|-------------|-------------|--------------------|-------------|-------------|
| Sample Number | Client Info |             | <b>MHI025362</b>   | MHI017779   | MHI018493   |
| Sample Date   | Client Info |             | <b>27 Oct 2022</b> | 27 Oct 2021 | 27 Nov 2019 |
| Machine Age   | hrs         | Client Info | <b>0</b>           | 0           | 0           |
| Oil Age       | hrs         | Client Info | <b>88405</b>       | 82732       | 71105       |
| Oil Changed   | Client Info |             | <b>Not Changed</b> | Not Changed | Not Changed |
| Sample Status |             |             | <b>NORMAL</b>      | NORMAL      | NORMAL      |

### WEAR METALS

|          | method     | limit/base  | current  | history1     | history2 |    |
|----------|------------|-------------|----------|--------------|----------|----|
| PQ       | ASTM D8184 | >200        | <b>5</b> | 17           | 19       |    |
| Iron     | ppm        | ASTM D5185m | >200     | <b>8</b>     | 8        | 17 |
| Chromium | ppm        | ASTM D5185m | >3       | <b>0</b>     | 0        | <1 |
| Nickel   | ppm        | ASTM D5185m | >3       | <b>2</b>     | 0        | 0  |
| Titanium | ppm        | ASTM D5185m | >10      | <b>0</b>     | 0        | 0  |
| Silver   | ppm        | ASTM D5185m |          | <b>0</b>     | 0        | 0  |
| Aluminum | ppm        | ASTM D5185m | >30      | <b>0</b>     | 0        | <1 |
| Lead     | ppm        | ASTM D5185m | >15      | <b>&lt;1</b> | 0        | <1 |
| Copper   | ppm        | ASTM D5185m | >75      | <b>6</b>     | 7        | 4  |
| Tin      | ppm        | ASTM D5185m | >10      | <b>&lt;1</b> | 0        | 0  |
| Antimony | ppm        | ASTM D5185m | >5       | <b>---</b>   | 0        | 0  |
| Vanadium | ppm        | ASTM D5185m |          | <b>0</b>     | 0        | 0  |
| Cadmium  | ppm        | ASTM D5185m |          | <b>0</b>     | 0        | 0  |

### ADDITIVES

|            | method | limit/base  | current | history1     | history2 |      |
|------------|--------|-------------|---------|--------------|----------|------|
| Boron      | ppm    | ASTM D5185m | 0       | <b>0</b>     | 0        | <1   |
| Barium     | ppm    | ASTM D5185m |         | <b>0</b>     | 0        | 0    |
| Molybdenum | ppm    | ASTM D5185m | 0       | <b>0</b>     | 0        | <1   |
| Manganese  | ppm    | ASTM D5185m |         | <b>&lt;1</b> | <1       | <1   |
| Magnesium  | ppm    | ASTM D5185m |         | <b>1</b>     | 0        | <1   |
| Calcium    | ppm    | ASTM D5185m | 0       | <b>2</b>     | 0        | 3    |
| Phosphorus | ppm    | ASTM D5185m | 485     | <b>403</b>   | 420      | 388  |
| Zinc       | ppm    | ASTM D5185m | 0       | <b>17</b>    | 12       | 12   |
| Sulfur     | ppm    | ASTM D5185m |         | <b>5012</b>  | 3344     | 3518 |






### CONTAMINANTS

|           | method | limit/base  | current | history1     | history2 |       |
|-----------|--------|-------------|---------|--------------|----------|-------|
| Silicon   | ppm    | ASTM D5185m | >+30    | <b>&lt;1</b> | 0        | <1    |
| Sodium    | ppm    | ASTM D5185m | >15     | <b>&lt;1</b> | 0        | <1    |
| Potassium | ppm    | ASTM D5185m | >20     | <b>2</b>     | 0        | <1    |
| Water     | %      | ASTM D6304  | >0.1    | <b>0.013</b> | 0.009    | 0.005 |
| ppm Water | ppm    | ASTM D6304  | >1000   | <b>132.7</b> | 90.5     | 51.2  |

### FLUID CLEANLINESS

|                 | method       | limit/base | current         | history1 | history2 |
|-----------------|--------------|------------|-----------------|----------|----------|
| Particles >4µm  | ASTM D7647   |            | <b>531</b>      | 444      | 1125     |
| Particles >6µm  | ASTM D7647   | >5000      | <b>127</b>      | 106      | 372      |
| Particles >14µm | ASTM D7647   | >640       | <b>11</b>       | 14       | 26       |
| Particles >21µm | ASTM D7647   | >160       | <b>3</b>        | 3        | 7        |
| Particles >38µm | ASTM D7647   | >40        | <b>0</b>        | 0        | 2        |
| Particles >71µm | ASTM D7647   | >10        | <b>0</b>        | 0        | 0        |
| Oil Cleanliness | ISO 4406 (c) | >--/19/16  | <b>16/14/11</b> | 16/14/11 | 17/16/12 |

# OIL ANALYSIS REPORT

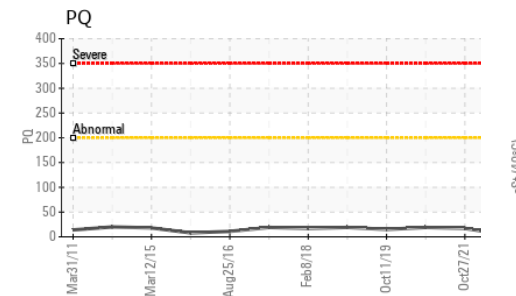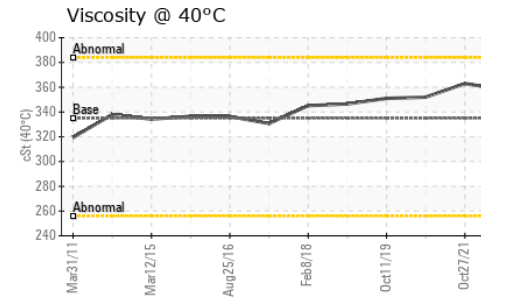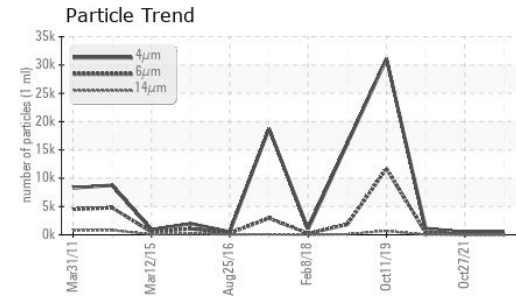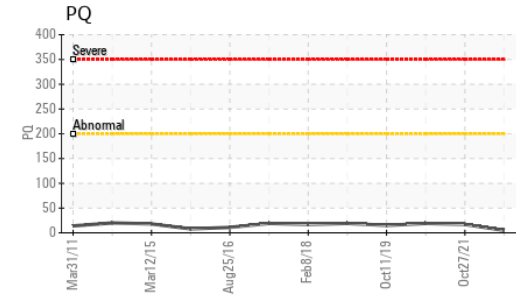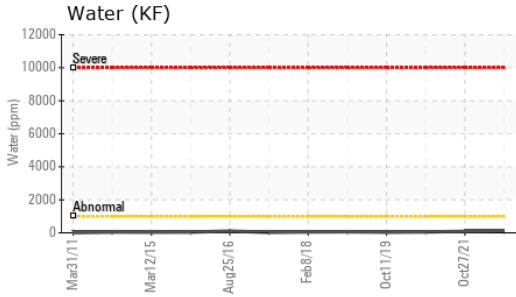


| FLUID DEGRADATION |          | method     | limit/base | current     | history1 | history2 |
|-------------------|----------|------------|------------|-------------|----------|----------|
| Acid Number (AN)  | mg KOH/g | ASTM D8045 | 0.85       | <b>1.17</b> | 1.120    | 1.084    |






| VISUAL           |        | method  | limit/base | current      | history1 | history2 |
|------------------|--------|---------|------------|--------------|----------|----------|
| White Metal      | scalar | *Visual | NONE       | <b>NONE</b>  | NONE     | NONE     |
| Yellow Metal     | scalar | *Visual | NONE       | <b>NONE</b>  | NONE     | NONE     |
| Precipitate      | scalar | *Visual | NONE       | <b>NONE</b>  | NONE     | NONE     |
| Silt             | scalar | *Visual | NONE       | <b>NONE</b>  | NONE     | NONE     |
| Debris           | scalar | *Visual | NONE       | <b>NONE</b>  | NONE     | VLITE    |
| Sand/Dirt        | scalar | *Visual | NONE       | <b>NONE</b>  | NONE     | NONE     |
| Appearance       | scalar | *Visual | NORML      | <b>NORML</b> | NORML    | NORML    |
| Odor             | scalar | *Visual | NORML      | <b>NORML</b> | NORML    | NORML    |
| Emulsified Water | scalar | *Visual | >0.1       | <b>NEG</b>   | NEG      | NEG      |
| Free Water       | scalar | *Visual |            | <b>NEG</b>   | NEG      | NEG      |

| FLUID PROPERTIES |     | method    | limit/base | current    | history1 | history2 |
|------------------|-----|-----------|------------|------------|----------|----------|
| Visc @ 40°C      | cSt | ASTM D445 | 335        | <b>358</b> | 363      | 352      |

| SAMPLE IMAGES |  | method | limit/base | current | history1 | history2 |
|---------------|--|--------|------------|---------|----------|----------|
|---------------|--|--------|------------|---------|----------|----------|

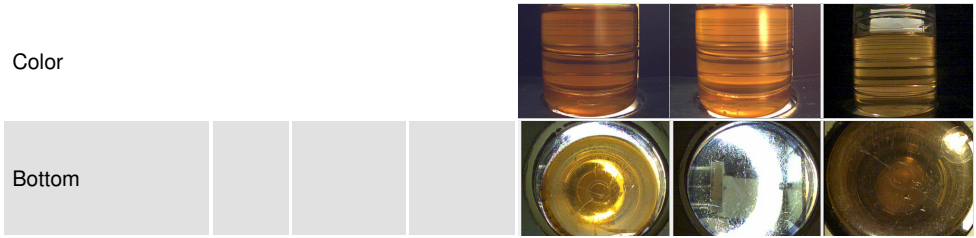

## GRAPHS

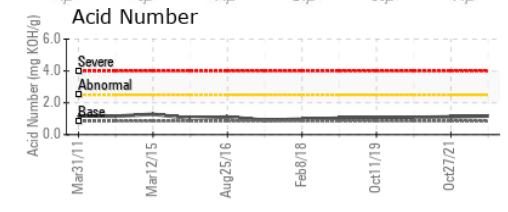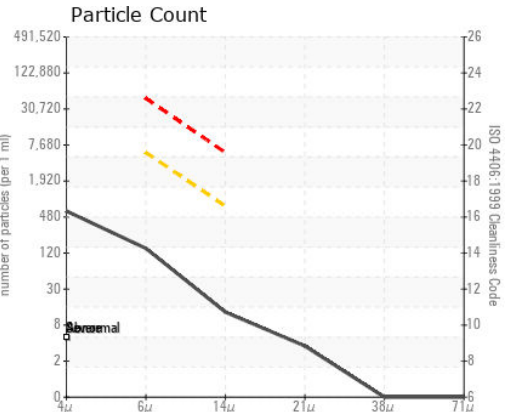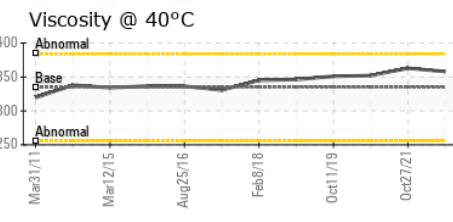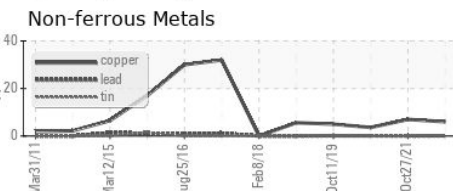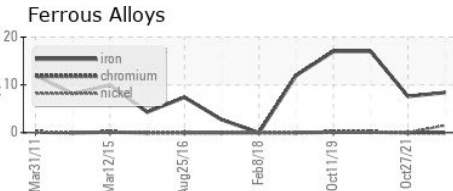

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : MH1025362 **Received** : 29 Nov 2022  
**Lab Number** : **05704558** **Diagnosed** : 30 Nov 2022  
**Unique Number** : 10234132 **Diagnostician** : Doug Bogart  
**Test Package** : IND 2 ( Additional Tests: KF, PQ, PrtCount )

**DIAMOND WTG - DILLON**  
P.O. BOX 880  
DESERT HOT SPRINGS, CA  
US 92240  
Contact: DANIEL BOYD  
daniel.boyd@diamondwtg.com  
T: (760)329-7171  
F: (760)329-7122

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)