


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL

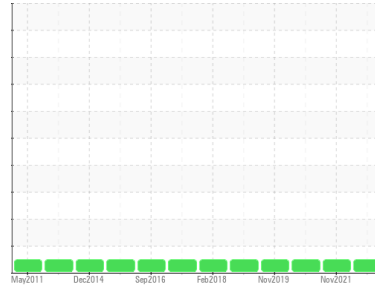

Machine Id
A106
Component
Hydraulic System
Fluid
MOBIL DTE 10 EXCEL 32 (43 GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2	
Sample Number	Client Info	MHI025365	MHI018316	MHI018495	
Sample Date	Client Info	07 Nov 2022	12 Nov 2021	03 Nov 2020	
Machine Age	hrs	Client Info	0	0	
Oil Age	hrs	Client Info	86600	80804	74462
Oil Changed	Client Info	Not Changed	Not Changed	Not Changed	
Sample Status		NORMAL	NORMAL	NORMAL	

WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >50	7	4	5
Chromium	ppm	ASTM D5185m >20	0	0	0
Nickel	ppm	ASTM D5185m >20	7	4	4
Titanium	ppm	ASTM D5185m	0	0	0
Silver	ppm	ASTM D5185m	0	0	<1
Aluminum	ppm	ASTM D5185m >20	0	0	0
Lead	ppm	ASTM D5185m >20	<1	0	<1
Copper	ppm	ASTM D5185m >20	<1	0	<1
Tin	ppm	ASTM D5185m >20	<1	0	0
Antimony	ppm	ASTM D5185m	---	0	0
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	0	0	<1
Barium	ppm	ASTM D5185m	0	0	0
Molybdenum	ppm	ASTM D5185m	0	0	0
Manganese	ppm	ASTM D5185m	0	0	0
Magnesium	ppm	ASTM D5185m	2	0	0
Calcium	ppm	ASTM D5185m 120	111	103	103
Phosphorus	ppm	ASTM D5185m 475	431	407	400
Zinc	ppm	ASTM D5185m	22	14	14
Sulfur	ppm	ASTM D5185m 1275	1835	1174	1304

CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >+30	<1	0	0
Sodium	ppm	ASTM D5185m	3	1	2
Potassium	ppm	ASTM D5185m >20	<1	0	0
Water	%	ASTM D6304 >0.1	0.005	0.002	0.002
ppm Water	ppm	ASTM D6304 >1000	51.7	19.6	15.9






FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647 >5000	682	1412	302
Particles >6µm	ASTM D7647 >1300	100	356	128
Particles >14µm	ASTM D7647 >160	10	29	27
Particles >21µm	ASTM D7647 >40	3	7	14
Particles >38µm	ASTM D7647 >10	0	0	0
Particles >71µm	ASTM D7647 >3	0	0	0
Oil Cleanliness	ISO 4406 (c) >19/17/14	17/14/10	18/16/12	15/14/12

FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045	0.09	0.104	0.153


OIL ANALYSIS REPORT

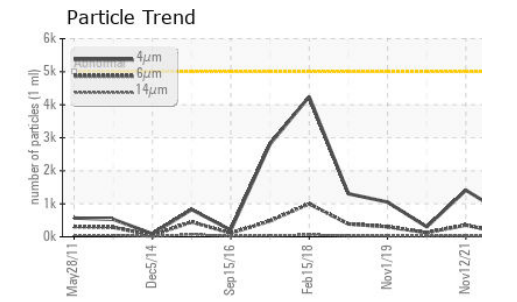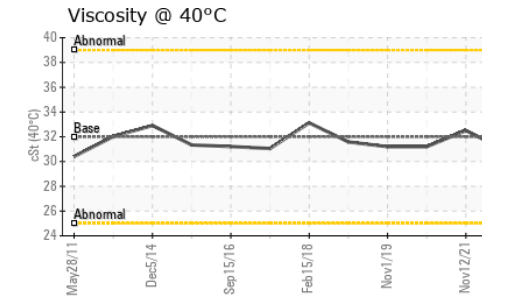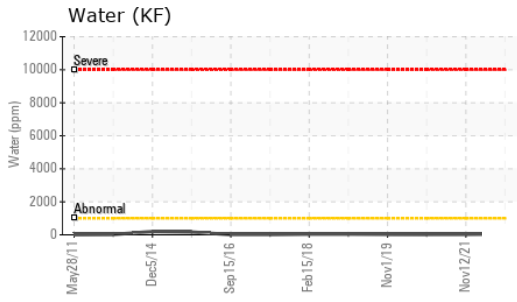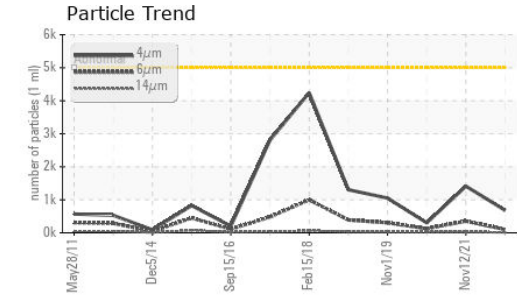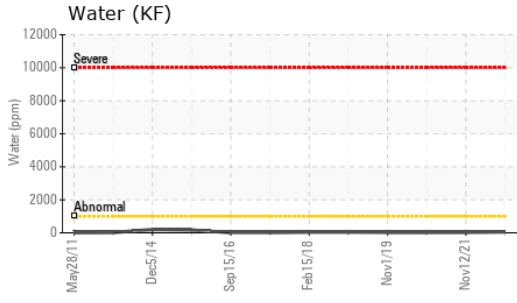






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	32	30.9	32.5	31.2

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

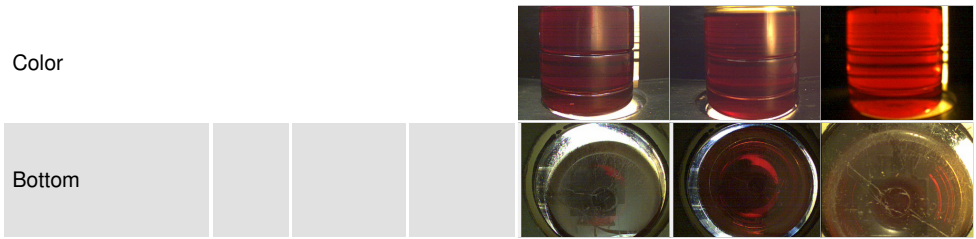

GRAPHS

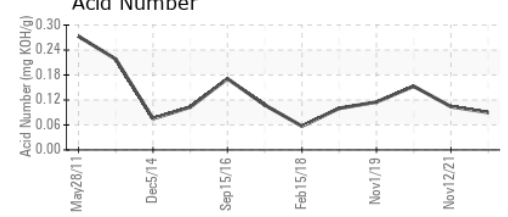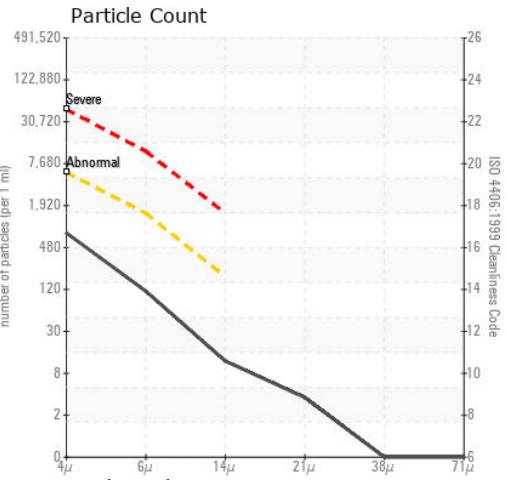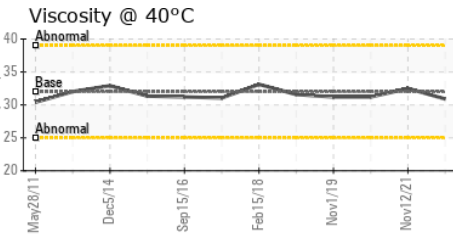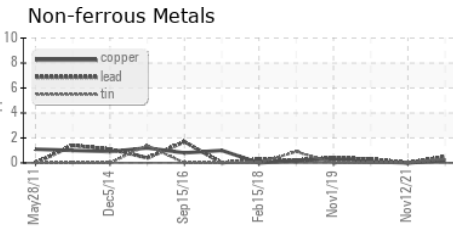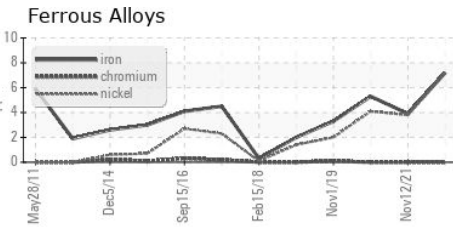

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : MH1025365 **Received** : 29 Nov 2022
Lab Number : 05704574 **Diagnosed** : 30 Nov 2022
Unique Number : 10234148 **Diagnostician** : Doug Bogart
Test Package : IND 2 (Additional Tests: KF)

DIAMOND WTG - DILLON
P.O. BOX 880
DESERT HOT SPRINGS, CA
US 92240
Contact: DANIEL BOYD
daniel.boyd@diamondwtg.com
T: (760)329-7171
F: (760)329-7122

Certificate L2367
To discuss this sample report, contact Customer Service at 1-800-237-1369.
* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)