




OIL ANALYSIS REPORT

Sample Rating Trend

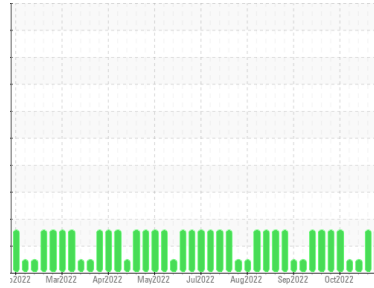

DIRT



Machine Id
GZJ00314
 Component
Biogas Engine
 Fluid
PETRO CANADA SENTRON CG 40 (145 GAL)

DIAGNOSIS

▲ Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor. (Customer Sample Comment: Total oil added 82 gal)

Wear

All component wear rates are normal.

▲ Contamination

Fuel content negligible. Elemental level of silicon (Si) above normal.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0698993	WC0699059	WC0699060
Sample Date	Client Info		28 Nov 2022	16 Nov 2022	08 Nov 2022
Machine Age	hrs	Client Info	119020	118734	118546
Oil Age	hrs	Client Info	759	473	285
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			ABNORMAL	ABNORMAL	NORMAL

CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.1	NEG	NEG	NEG
Glycol	WC Method		NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m	>45	9	7	3
Chromium	ppm	ASTM D5185m	>2	<1	<1	<1
Nickel	ppm	ASTM D5185m	>2	<1	<1	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m	>5	0	0	0
Aluminum	ppm	ASTM D5185m	>10	2	3	2
Lead	ppm	ASTM D5185m	>5	2	2	<1
Copper	ppm	ASTM D5185m	>14	4	3	2
Tin	ppm	ASTM D5185m	>13	7	5	3
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0

ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	0	1	1	0
Barium	ppm	ASTM D5185m	1	0	0	0
Molybdenum	ppm	ASTM D5185m	2	1	1	<1
Manganese	ppm	ASTM D5185m	1	<1	<1	<1
Magnesium	ppm	ASTM D5185m	9	17	16	14
Calcium	ppm	ASTM D5185m	2712	2973	2855	2943
Phosphorus	ppm	ASTM D5185m	292	306	285	278
Zinc	ppm	ASTM D5185m	342	356	334	330
Sulfur	ppm	ASTM D5185m	2575	3692	3429	3920

CONTAMINANTS

	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m	>200	▲ 348	▲ 267	188
Sodium	ppm	ASTM D5185m		<1	0	0
Potassium	ppm	ASTM D5185m	>20	0	0	0
Fuel	%	ASTM D3524	>4.0	0.3	0.2	0.2

INFRA-RED






	method	limit/base	current	history1	history2	
Soot %	%	*ASTM D7844		0.1	0.1	0.1
Nitration	Abs/cm	*ASTM D7624	>20	6.7	6.1	5.6
Sulfation	Abs/.1mm	*ASTM D7415	>30	23.8	22.0	19.6

FLUID DEGRADATION

	method	limit/base	current	history1	history2	
Oxidation	Abs/.1mm	*ASTM D7414	>25	14.9	12.8	10.8
Acid Number (AN)	mg KOH/g	ASTM D8045	0.98	1.25	1.10	0.86
Base Number (BN)	mg KOH/g	ASTM D2896	8.1	7.61	6.87	6.18











OIL ANALYSIS REPORT

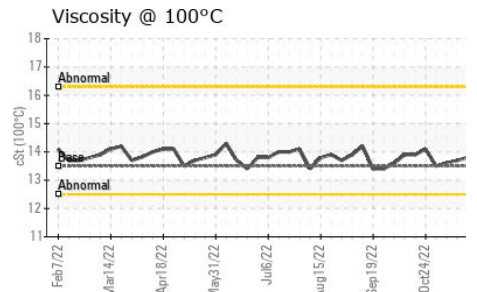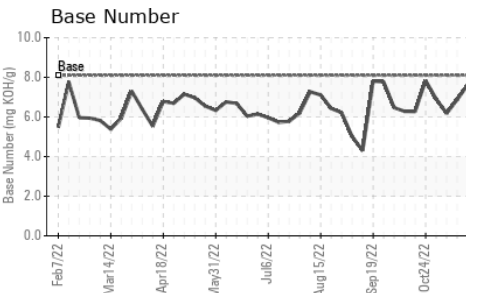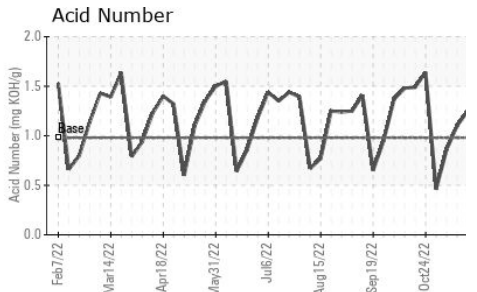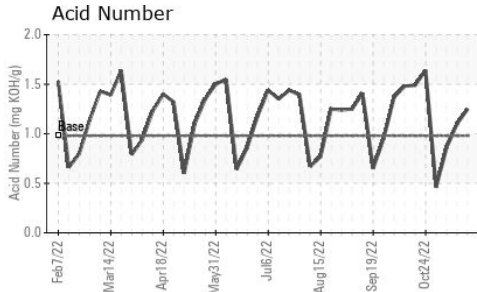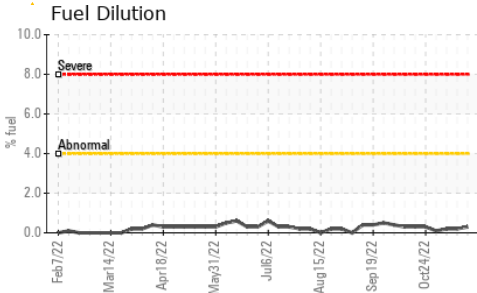

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	13.5	13.8	13.7

GRAPHS

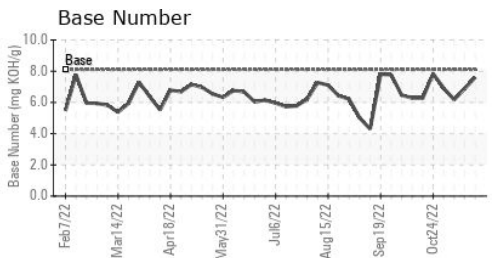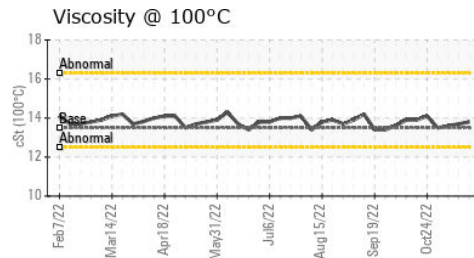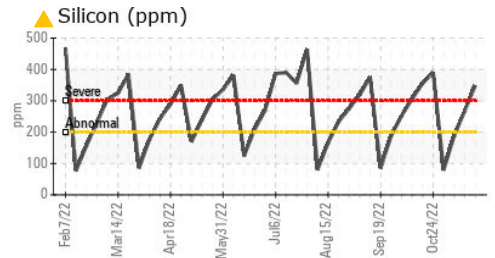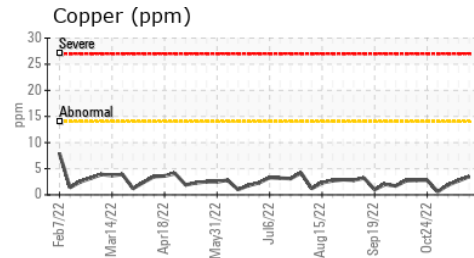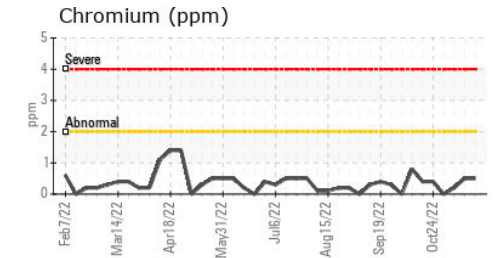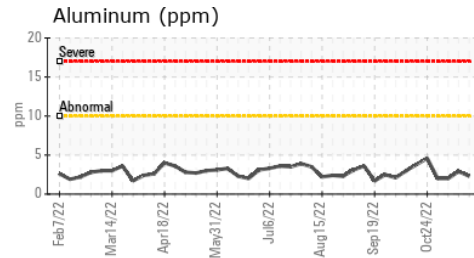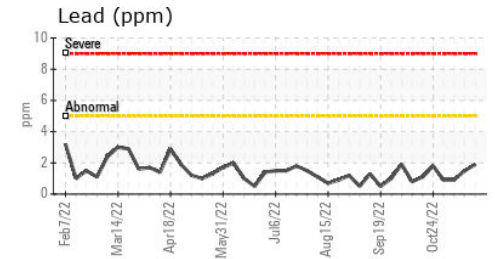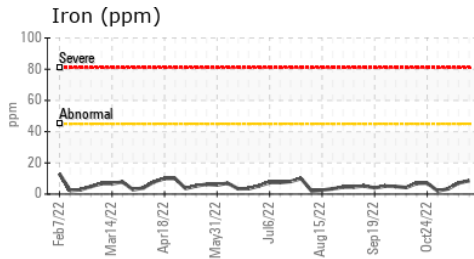

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
 Sample No. : WC0698993
 Lab Number : 05706128
 Unique Number : 10240703
 Test Package : MOB 2 (Additional Tests: FuelDilution, PercentFuel)

Received : 01 Dec 2022
 Tested : 02 Dec 2022
 Diagnosed : 02 Dec 2022 - Don Baldrige

FINLEY BIOENERGY
 74265 Bombing Range Road
 Boardman, OR
 US 97818

Contact: Blain Middleton
 bmiddleton@archaea.energy
 T: (541)481-3232

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)