




OIL ANALYSIS REPORT

Sample Rating Trend

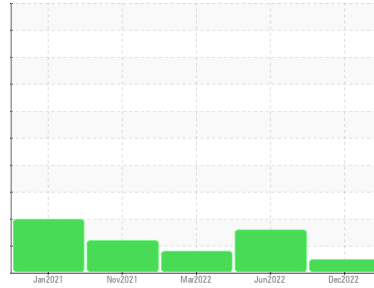

NORMAL



Machine Id
KAESER 7352439

Component
Compressor
Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			KCP49863	KCP40190	KCP41025
Sample Date	Client Info			05 Dec 2022	30 Jun 2022	14 Mar 2022
Machine Age	hrs	Client Info		4337	4017	3820
Oil Age	hrs	Client Info		800	300	800
Oil Changed	Client Info			Changed	Not Changd	Not Changd
Sample Status				NORMAL	ABNORMAL	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	0
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	<1	<1	<1
Lead	ppm	ASTM D5185m	>10	<1	<1	0
Copper	ppm	ASTM D5185m	>50	1	3	1
Tin	ppm	ASTM D5185m	>10	<1	0	<1
Antimony	ppm	ASTM D5185m		---	---	---
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	<1
Barium	ppm	ASTM D5185m	90	52	50	59
Molybdenum	ppm	ASTM D5185m	0	0	0	0
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m	100	87	79	74
Calcium	ppm	ASTM D5185m	0	2	2	0
Phosphorus	ppm	ASTM D5185m	0	8	0	0
Zinc	ppm	ASTM D5185m	0	4	4	0
Sulfur	ppm	ASTM D5185m	23500	23632	22795	15317

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	1	<1	0
Sodium	ppm	ASTM D5185m		9	15	5
Potassium	ppm	ASTM D5185m	>20	9	7	<1
Water	%	ASTM D6304	>0.05	0.017	0.031	0.014
ppm Water	ppm	ASTM D6304	>500	177.6	316.8	142.2

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		2222	21819	10459
Particles >6µm		ASTM D7647	>1300	795	▲ 6969	▲ 2891
Particles >14µm		ASTM D7647	>80	36	▲ 562	▲ 162
Particles >21µm		ASTM D7647	>20	5	▲ 143	16
Particles >38µm		ASTM D7647	>4	0	3	1
Particles >71µm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>--/17/13	18/17/12	▲ 22/20/16	▲ 19/15

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.37	0.35	0.37


OIL ANALYSIS REPORT

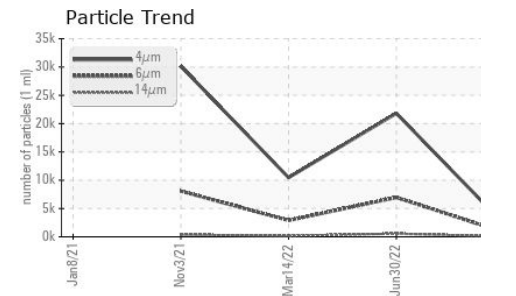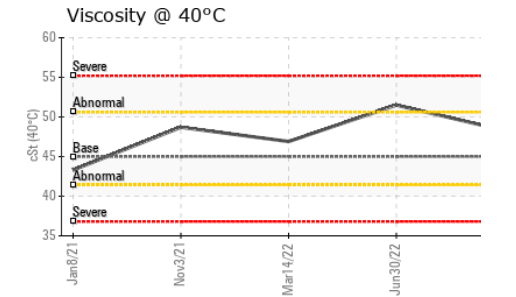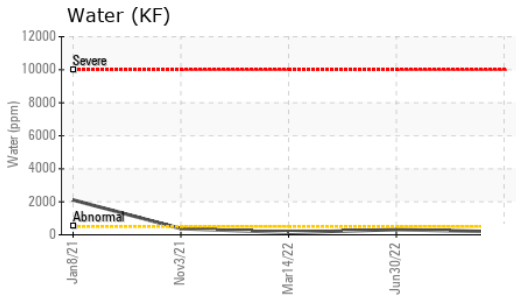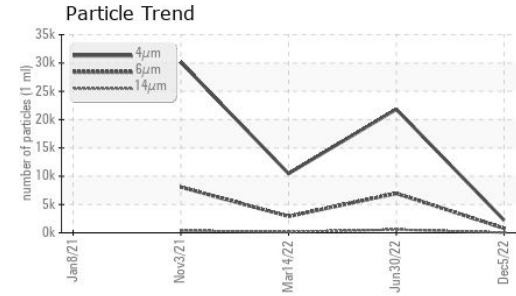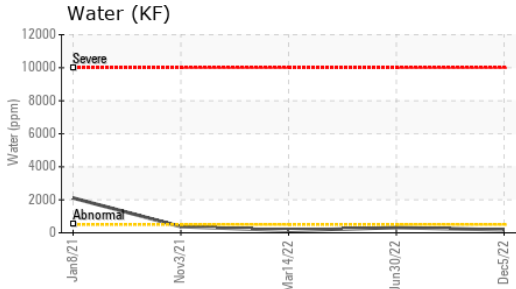




VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 45	48.3	51.5	46.9

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

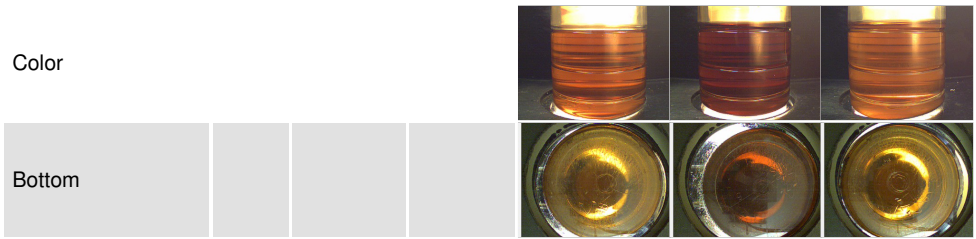

GRAPHS

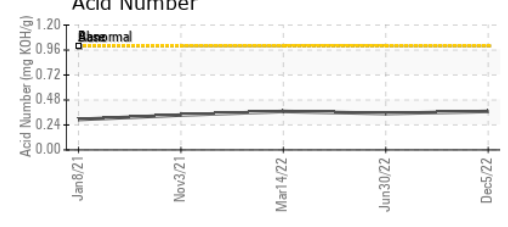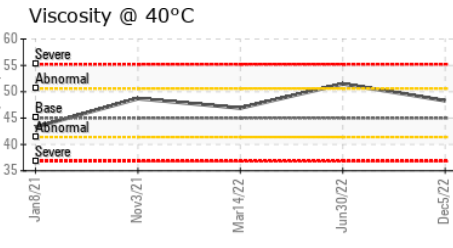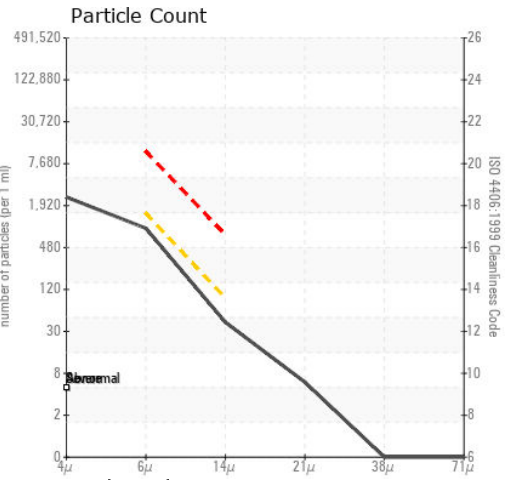

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCP49863 **Received** : 12 Dec 2022
Lab Number : 05715896 **Diagnosed** : 14 Dec 2022
Unique Number : 10255472 **Diagnostician** : Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)

AMAZON GSO1
 1656 OLD GREENSBORO RD
 KERNERSVILLE, NC
 US 27284
 Contact: B. LANCRON
 blancron@amazon.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: