

OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL



7845366 (S/N 1676)

Component

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			Oct2021	Dec2022		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC103460	KC92656	
Sample Date		Client Info		09 Dec 2022	13 Oct 2021	
Machine Age	hrs	Client Info		4462	2024	
Oil Age	hrs	Client Info		2400	2024	
Oil Changed		Client Info		Changed	Changed	
Sample Status				NORMAL	ABNORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	1	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m	>3	0	0	
Titanium	ppm	ASTM D5185m		0	0	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>10	0	<1	
Lead	ppm	ASTM D5185m	>10	0	<1	
Copper	ppm	ASTM D5185m		6	6	
Tin	ppm	ASTM D5185m	>10	0	<1	
Antimony		ASTM D5185m	>10		0	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
	ppm	ASTIVI DOTOSITI		U	U	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	16	
Barium	ppm	ASTM D5185m	90	3	13	
Molybdenum	ppm	ASTM D5185m		0	0	
Manganese	ppm	ASTM D5185m		0	<1	
Magnesium	ppm	ASTM D5185m	90	58	59	
Calcium	ppm	ASTM D5185m	2	0	0	
Phosphorus	ppm	ASTM D5185m		7	18	
Zinc	ppm	ASTM D5185m		<1	3	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	1	
Sodium	ppm	ASTM D5185m		11	15	
Potassium	ppm	ASTM D5185m	>20	7	15	
Water	%	ASTM D6304	>0.05	0.016	0.027	
ppm Water	ppm	ASTM D6304	>500	162.7	270.8	
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4μm		ASTM D7647		1321		
Particles >6µm		ASTM D7647	>1300	366		
Particles >14μm		ASTM D7647	>80	25		
Particles >21µm		ASTM D7647	>20	5		
Particles >38µm		ASTM D7647	>4	0		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	18/16/12		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.32	0.308	



OIL ANALYSIS REPORT

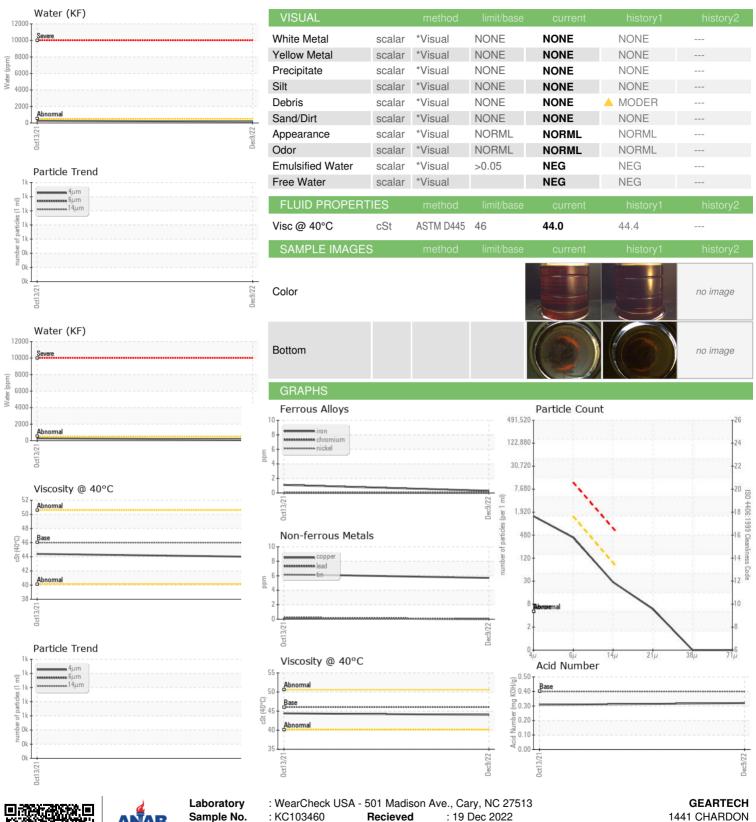





Certificate L2367

Sample No. Lab Number **Unique Number** Test Package

: KC103460 : 05721405

: 19 Dec 2022 Recieved : 21 Dec 2022 Diagnosed : 10260981 Diagnostician

: Jonathan Hester

Contact: Service Manager

: IND 2 To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

EUCLID, OH

US 44117

T: F: