

OIL ANALYSIS REPORT

8290287 (S/N 1556)

Component

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

Sample Rating Trend ISO

Recommendation

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of particulates present in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Dec2022		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC107691		
Sample Date		Client Info		12 Dec 2022		
Machine Age	hrs	Client Info		584		
Oil Age	hrs	Client Info		584		
Oil Changed		Client Info		Changed		
Sample Status				ATTENTION		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	2		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	<1		
Aluminum	ppm	ASTM D5185m	>10	<1		
Lead	ppm	ASTM D5185m	>10	<1		
Copper	ppm	ASTM D5185m	>50	1		
Tin	ppm	ASTM D5185m	>10	<1		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m	90	5		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m	90	67		
Calcium	ppm	ASTM D5185m	2	<1		
Phosphorus	ppm	ASTM D5185m		<1		
Zinc	ppm	ASTM D5185m		8		
CONTAMINANTS	3	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1		
Sodium	ppm	ASTM D5185m	720	11		
Potassium	ppm	ASTM D5185m	>20	2		
Water	%	ASTM D6304	>0.05	0.012		
ppm Water	ppm	ASTM D6304	>500	125.7		
FLUID CLEANLIN	NESS _	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		4961		
Particles >6µm		ASTM D7647	>1300	1973		
Particles >14µm		ASTM D7647	>80	153		
Particles >21µm		ASTM D7647	>20	3 0		
Particles >38µm		ASTM D7647	>4	0		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	19/18/14		
FLUID DEGRADA	NOITA	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.48		



OIL ANALYSIS REPORT

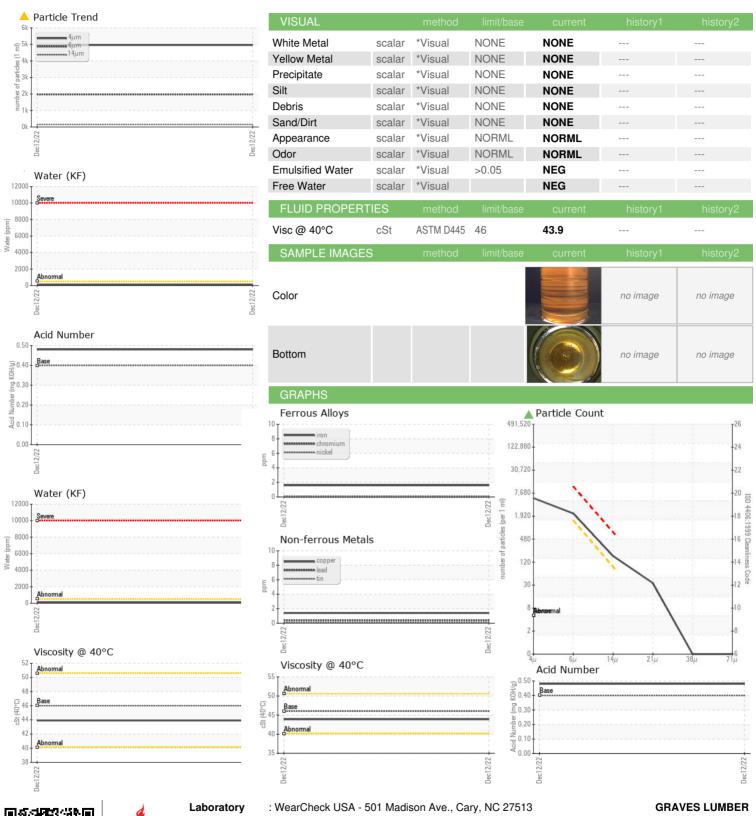





Certificate L2367

Sample No. Lab Number **Unique Number** Test Package

: KC107691 : 05722555

: 10267136

Recieved Diagnosed

: 20 Dec 2022 : 22 Dec 2022 : Don Baldridge Diagnostician

1315 S CLEVELAND-MASSILLION RD

COPLEY, OH US 44321

Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

: IND 2

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: F: