




# PROBLEM SUMMARY


Sample Rating Trend

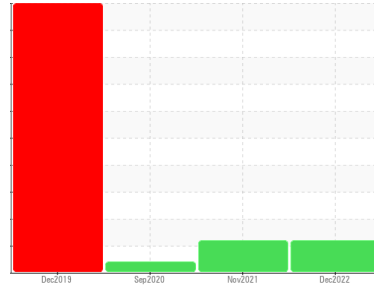

Machine Id  
**KAESER ASD 25 5747171 (S/N 1164)**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) M-460 (--- GAL)**

## COMPONENT CONDITION SUMMARY

▲ Particle Trend

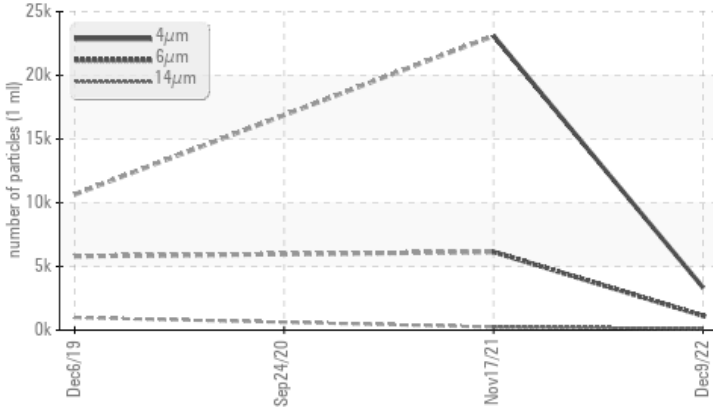

## RECOMMENDATION

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

## PROBLEMATIC TEST RESULTS

Sample Status			ATTENTION	ABNORMAL	ABNORMAL
Particles >14µm	ASTM D7647	>80	▲ 130	▲ 245	---
Particles >21µm	ASTM D7647	>20	▲ 35	▲ 31	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 19/17/14	▲ 20/15	---

Customer Id: IMAHIG  
 Sample No.: KCP55699  
 Lab Number: 05724113  
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
 Don Baldrige +1  
[don.b505@comcast.net](mailto:don.b505@comcast.net)

To change component or sample information:  
 Customer Service +1 1-800-237-1369  
[customerservice@wearcheck.com](mailto:customerservice@wearcheck.com)

## RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Fluid	---	---	?	Oil and filter change at the time of sampling has been noted.
Change Filter	---	---	?	Oil and filter change at the time of sampling has been noted.

## HISTORICAL DIAGNOSIS

### 17 Nov 2021 Diag: Doug Bogart

#### ISO



No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

[view report](#)



### 24 Sep 2020 Diag: Angela Borella

#### VIS DEBRIS



No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample. All component wear rates are normal. Moderate concentration of visible dirt/debris present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

[view report](#)



### 06 Dec 2019 Diag: Jonathan Hester

#### WATER



Oil and filter change at the time of sampling has been noted. We recommend an early resample in 500 hours to monitor this condition. All component wear rates are normal. There is a high amount of particulates present in the oil. Excessive free water present. There is a high concentration of water present in the oil. The AN level is acceptable for this fluid.

[view report](#)



# OIL ANALYSIS REPORT

Sample Rating Trend



Machine Id  
**KAESER ASD 25 5747171 (S/N 1164)**

Component  
**Compressor**  
Fluid  
**KAESER SIGMA (OEM) M-460 (--- GAL)**

## DIAGNOSIS

### Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a moderate amount of particulates present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KCP55699</b>	KCP43581	KCP30384
Sample Date	Client Info			<b>09 Dec 2022</b>	17 Nov 2021	24 Sep 2020
Machine Age	hrs	Client Info		<b>18404</b>	15197	12009
Oil Age	hrs	Client Info		<b>2000</b>	3100	3000
Oil Changed	Client Info			<b>Changed</b>	Changed	Changed
Sample Status				<b>ATTENTION</b>	ABNORMAL	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>0</b>	<1	<1
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	>3	<b>0</b>	0	<1
Titanium	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	>2	<b>0</b>	<1	<1
Aluminum	ppm	ASTM D5185m	>10	<b>&lt;1</b>	<1	0
Lead	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>50	<b>2</b>	3	5
Tin	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Antimony	ppm	ASTM D5185m		<b>---</b>	0	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	<b>0</b>	13	<1
Barium	ppm	ASTM D5185m	90	<b>0</b>	0	<1
Molybdenum	ppm	ASTM D5185m	0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m		<b>0</b>	0	<1
Magnesium	ppm	ASTM D5185m	100	<b>58</b>	46	48
Calcium	ppm	ASTM D5185m	0	<b>&lt;1</b>	0	0
Phosphorus	ppm	ASTM D5185m	0	<b>4</b>	0	4
Zinc	ppm	ASTM D5185m	0	<b>29</b>	43	54
Sulfur	ppm	ASTM D5185m	23500	<b>21672</b>	17995	17246


CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>&lt;1</b>	<1	1
Sodium	ppm	ASTM D5185m		<b>13</b>	15	13
Potassium	ppm	ASTM D5185m	>20	<b>2</b>	3	4
Water	%	ASTM D6304	>0.05	<b>0.030</b>	0.020	0.032
ppm Water	ppm	ASTM D6304	>500	<b>309.4</b>	209.7	329.9

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>3347</b>	23102	---
Particles >6µm		ASTM D7647	>1300	<b>1133</b>	▲ 6141	---
Particles >14µm		ASTM D7647	>80	▲ <b>130</b>	▲ 245	---
Particles >21µm		ASTM D7647	>20	▲ <b>35</b>	▲ 31	---
Particles >38µm		ASTM D7647	>4	<b>2</b>	2	---
Particles >71µm		ASTM D7647	>3	<b>0</b>	0	---
Oil Cleanliness		ISO 4406 (c)	>--/17/13	▲ <b>19/17/14</b>	▲ 20/15	---


FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	<b>0.41</b>	0.369	0.409

# OIL ANALYSIS REPORT


## ▲ Particle Trend

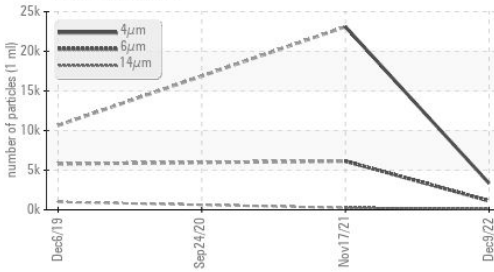


## Water (KF)

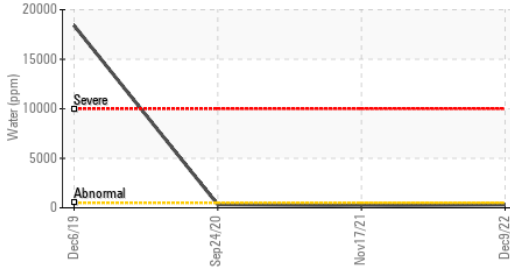


## Acid Number

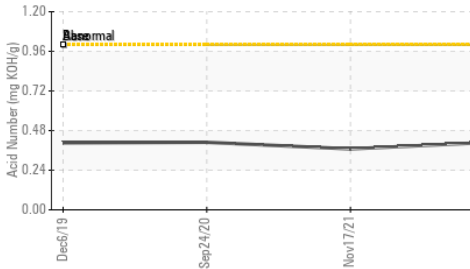

## Water (KF)

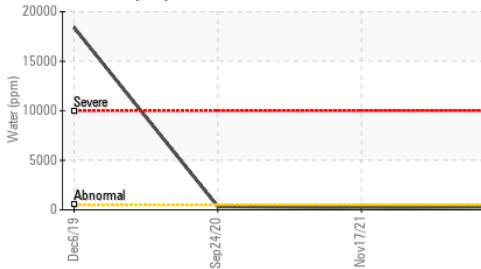

## Viscosity @ 40°C

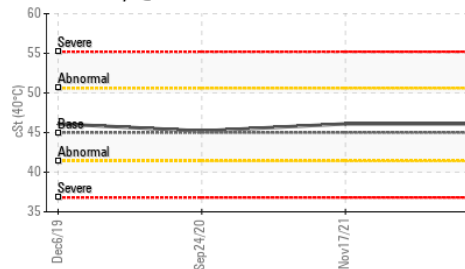


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	▲ MODER
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 45	46.1	46.1	45.2

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color




Bottom




## GRAPHS


### Ferrous Alloys

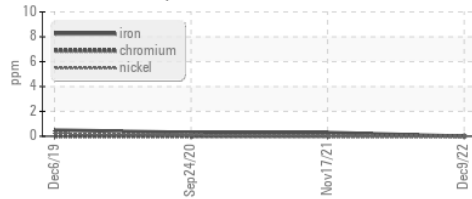


### Non-ferrous Metals

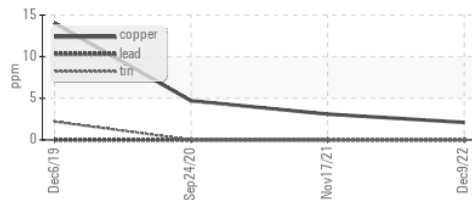


### Viscosity @ 40°C

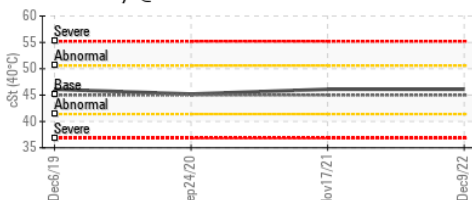

### ▲ Particle Count

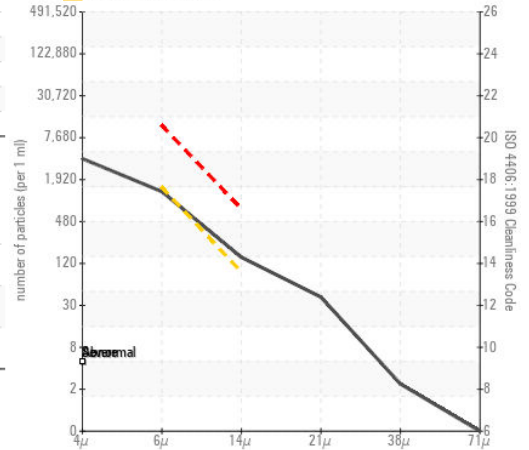

### Acid Number

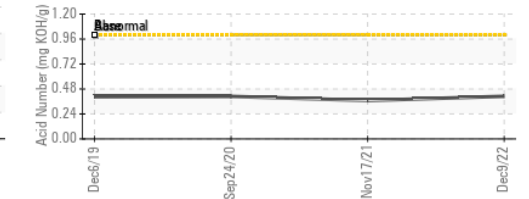

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCP55699 **Received** : 22 Dec 2022  
**Lab Number** : 05724113 **Diagnosed** : 24 Dec 2022  
**Unique Number** : 10268694 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

**IMAGEFIRST HP**  
639 ALTON PL  
HIGH POINT, NC  
US 27263

Contact: J. SPREADBURY  
jspreadbury@imagefirst.com

T:  
F: