

PROBLEM SUMMARY

Sample Rating Trend




7336667 (S/N 1449)

Component

Compressor

KAESER SIGMA (OEM) S-460 (--- QTS)

COMPONENT CONDITION SUMMARY

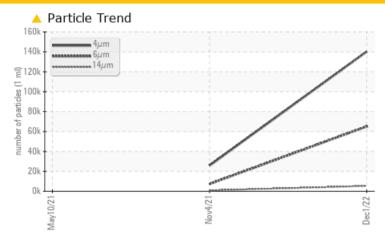

RECOMMENDATION

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS									
Sample Status			ABNORMAL	ABNORMAL	ABNORMAL				
Particles >6µm	ASTM D7647	>1300	△ 65085	<u>^</u> 7361					
Particles >14µm	ASTM D7647	>80	5339	<u>▲</u> 865					
Particles >21µm	ASTM D7647	>20	1006	<u></u> 116					
Particles >38µm	ASTM D7647	>4	<u> </u>	4					
Oil Cleanliness	ISO 4406 (c)	>/17/13	4 24/23/20	<u>^</u> 20/17					

Customer Id: ROYBARIN Sample No.: KC103219 Lab Number: 05724128 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:

Don Baldridge +1 don.b505@comcast.net

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Fluid			?	Oil and filter change at the time of sampling has been noted.
Change Filter			?	Oil and filter change at the time of sampling has been noted.

HISTORICAL DIAGNOSIS

04 Nov 2021 Diag: Jonathan Hester

ISO



Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



10 May 2021 Diag: Don Baldridge

VIS DEBRIS



No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample. All component wear rates are normal. Moderate concentration of visible dirt/debris present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





OIL ANALYSIS REPORT



ISO

7336667 (S/N 1449)

Compressor

KAESER SIGMA (OEM) S-460 (--- QTS)

DIAGNOSIS

Recommendation

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Ma	y2021	Nov2021 Dec20	22	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info	minu bass	KC103219	KC86931	KC72534
Sample Date		Client Info		01 Dec 2022	04 Nov 2021	10 May 2021
Machine Age	hrs	Client Info		3326	3323	3246
Oil Age	hrs	Client Info		3	0	1680
Oil Changed	1113	Client Info		Changed	Changed	Not Changd
Sample Status		Olletti IIIIO		ABNORMAL	ABNORMAL	ABNORMAL
·						
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m		2	1	<1
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m	>2	0	<1	<1
Aluminum	ppm	ASTM D5185m	>10	<1	<1	1
Lead	ppm	ASTM D5185m	>10	0	0	<1
Copper	ppm	ASTM D5185m	>50	2	7	5
Tin	ppm	ASTM D5185m	>10	0	0	<1
Antimony	ppm	ASTM D5185m			0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	<1
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	3	11
Barium	ppm	ASTM D5185m	90	58	0	29
Molybdenum	ppm	ASTM D5185m		0	0	<1
Manganese	ppm	ASTM D5185m		0	<1	<1
Magnesium	ppm	ASTM D5185m	90	72	29	45
Calcium	ppm	ASTM D5185m	2	2	0	1
Phosphorus	ppm	ASTM D5185m		3	2	0
Zinc	ppm	ASTM D5185m		3	1	0
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	1	1
Sodium	ppm	ASTM D5185m		3	3	7
Potassium	ppm	ASTM D5185m	>20	0	<1	3
Water	%	ASTM D6304	>0.05	0.020	0.010	0.015
ppm Water	ppm	ASTM D6304	>500	205.0	102.6	158.5
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		140271	25852	
Particles >6µm		ASTM D7647	>1300	65085	▲ 7361	
Particles >14µm		ASTM D7647	>80	<u>▲</u> 5339	<u>▲</u> 865	
Particles >21µm		ASTM D7647	>20	1006	<u> </u>	
Particles >38µm		ASTM D7647	>4	<u>▲</u> 11	4	
Particles >71µm		ASTM D7647	>3	0	0	
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u>△</u> 24/23/20	<u>△</u> 20/17	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.40	0.48	0.379
ACIO INUITIDEI (AIN)	IIIy N∪⊓/ÿ	49 LINI D0049	0.4	0.40	0.40	0.578



OIL ANALYSIS REPORT

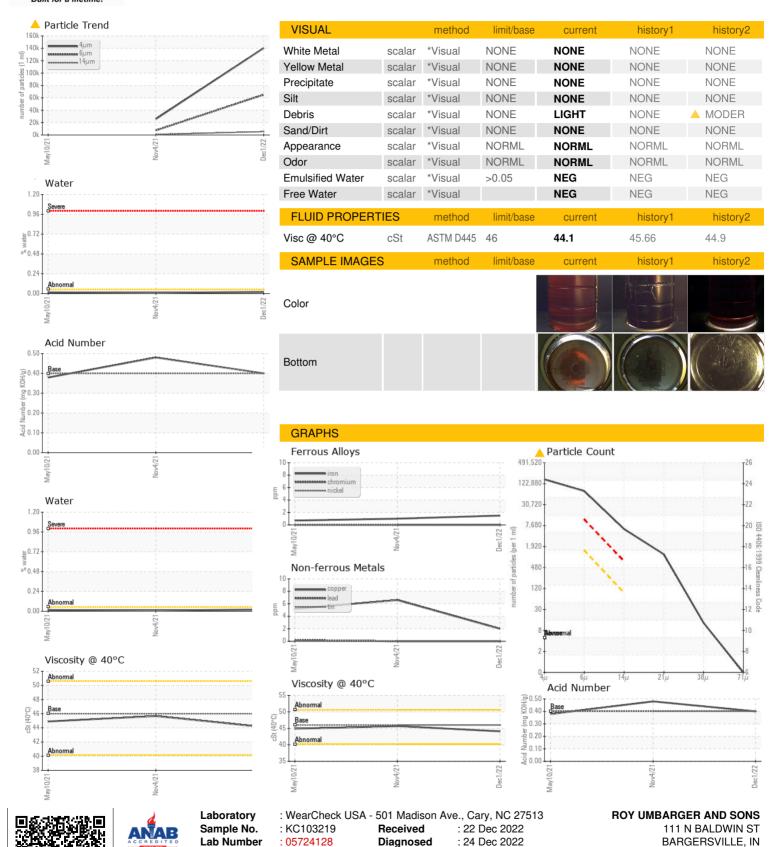

Certificate L2367

Unique Number

Test Package

: 10268709

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

: IND 2

Diagnostician

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

: Don Baldridge

US 46106

T: F:

Contact: J. LOPER

jloper1@gmail.com