




OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL

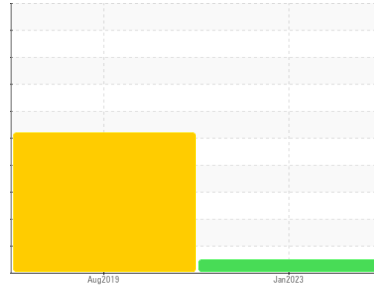

Machine Id
KAESER SK 15T 3847445 (S/N 1737)

Component
Compressor

Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			KCP54105	KCP18117	---
Sample Date	Client Info			04 Jan 2023	01 Aug 2019	---
Machine Age	hrs	Client Info		2138	1683	---
Oil Age	hrs	Client Info		167	1683	---
Oil Changed	Client Info			Changed	Changed	---
Sample Status				NORMAL	ABNORMAL	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	---
Chromium	ppm	ASTM D5185m	>10	0	0	---
Nickel	ppm	ASTM D5185m	>3	0	<1	---
Titanium	ppm	ASTM D5185m	>3	0	0	---
Silver	ppm	ASTM D5185m	>2	0	0	---
Aluminum	ppm	ASTM D5185m	>10	0	0	---
Lead	ppm	ASTM D5185m	>10	0	<1	---
Copper	ppm	ASTM D5185m	>50	1	1	---
Tin	ppm	ASTM D5185m	>10	0	0	---
Antimony	ppm	ASTM D5185m		---	0	---
Vanadium	ppm	ASTM D5185m		0	0	---
Cadmium	ppm	ASTM D5185m		0	0	---






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	<1	---
Barium	ppm	ASTM D5185m	90	0	0	---
Molybdenum	ppm	ASTM D5185m		0	0	---
Manganese	ppm	ASTM D5185m		<1	<1	---
Magnesium	ppm	ASTM D5185m	90	45	19	---
Calcium	ppm	ASTM D5185m	2	0	0	---
Phosphorus	ppm	ASTM D5185m		0	<1	---
Zinc	ppm	ASTM D5185m		11	10	---
Sulfur	ppm	ASTM D5185m		22924	17303	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	<1	---
Sodium	ppm	ASTM D5185m		18	8	---
Potassium	ppm	ASTM D5185m	>20	2	2	---
Water	%	ASTM D6304	>0.05	0.028	▲ 0.174	---
ppm Water	ppm	ASTM D6304	>500	282.3	▲ 1740	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		734	1256	---
Particles >6µm		ASTM D7647	>1300	104	684	---
Particles >14µm		ASTM D7647	>80	6	▲ 116	---
Particles >21µm		ASTM D7647	>20	2	▲ 39	---
Particles >38µm		ASTM D7647	>4	0	▲ 6	---
Particles >71µm		ASTM D7647	>3	0	0	---
Oil Cleanliness		ISO 4406 (c)	>--/17/13	17/14/10	▲ 17/14	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.31	0.185	---


OIL ANALYSIS REPORT

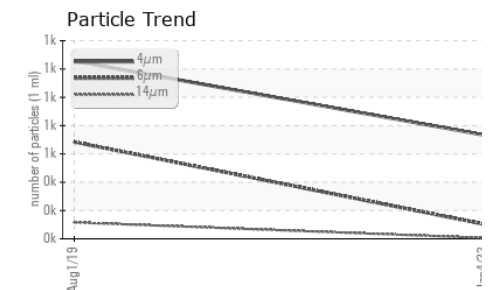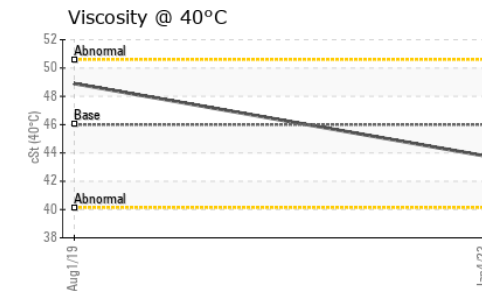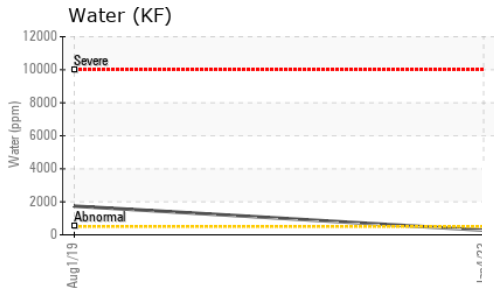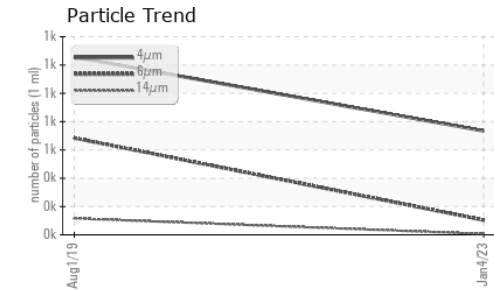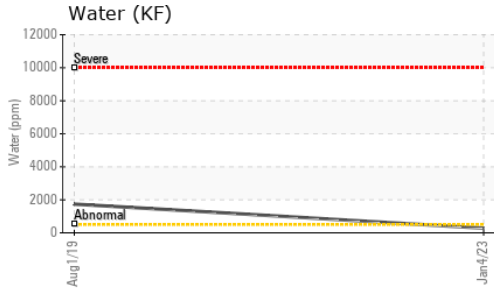






VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	LIGHT	---
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	▲ LAYRD	---
Odor	scalar	*Visual	NORML	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	0.2%	---
Free Water	scalar	*Visual		NEG	▲ 1.0	---

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	46	43.8	48.9	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

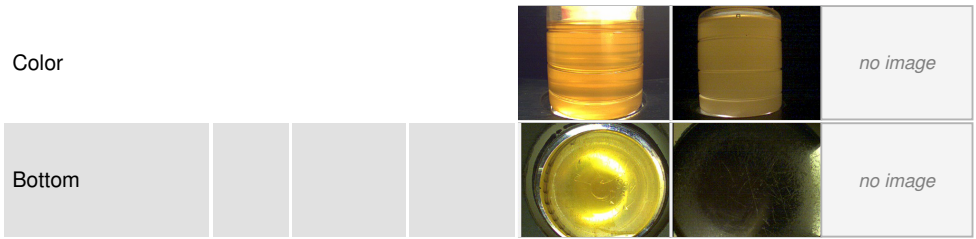

GRAPHS

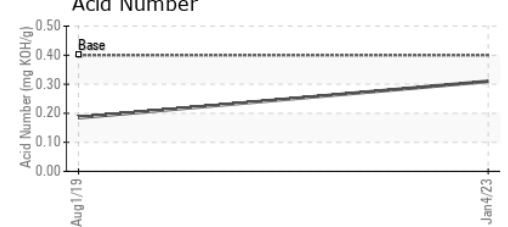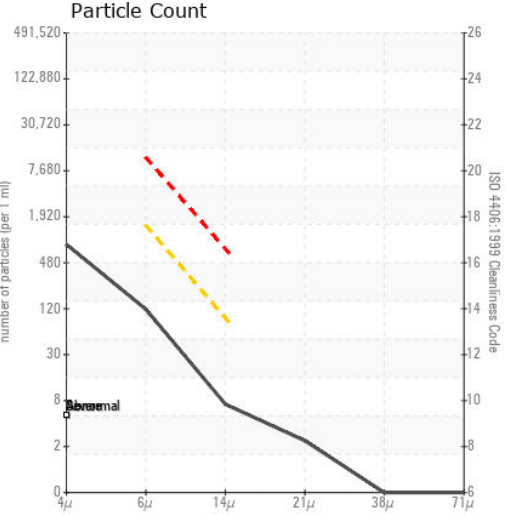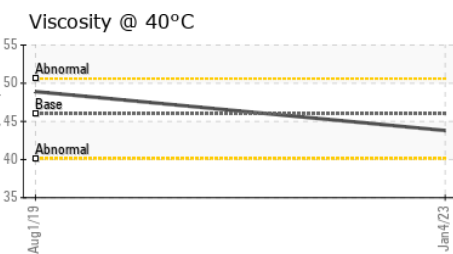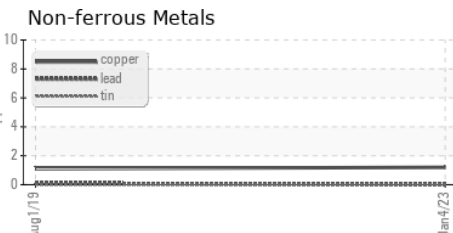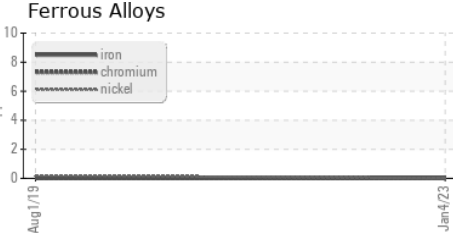

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCP54105 **Received** : 13 Jan 2023
Lab Number : **05738955** **Tested** : 16 Jan 2023
Unique Number : 10293554 **Diagnosed** : 16 Jan 2023 - Jonathan Hester
Test Package : IND 2 (Additional Tests: KF, PrtCount)

ENTERPRISE PRODUCTS
 2950 HWY 18
 SOLOMON, KS
 US 67401
 Contact: LC BURKLOW
 LCBURKLOW@EPROD.COM
 T:
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)