


PROBLEM SUMMARY


ÎRON STAR [200006142] 58WEA88303


Component
Wind Turbine Gearbox

GEAR OIL (PAO) ISO 320 (--- LTR)

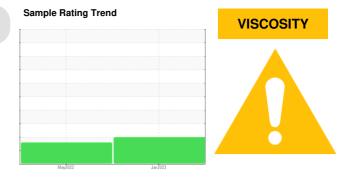

COMPONENT CONDITION SUMMARY

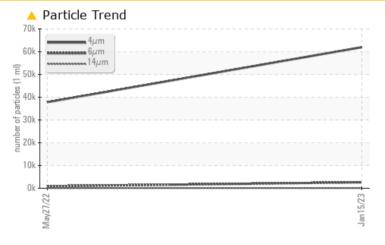

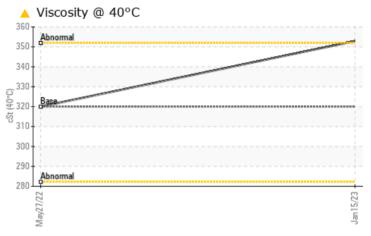

RECOMMENDATION

We recommend you service the filters on this component. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS								
Sample Status				ABNORMAL	ABNORMAL			
Particles >6µm		ASTM D7647	>320	^ 2612	<u>▲</u> 884			
Particles >14µm		ASTM D7647	>40	<u> </u>	<u></u> 58			
Particles >21µm		ASTM D7647	>10	<u> </u>	<u>^</u> 21			
Oil Cleanliness		ISO 4406 (c)	>/15/12	23/19/13	<u>22/17/13</u>			
Visc @ 40°C	cSt	ASTM D445	320	△ 352.9	320			

Customer Id: NORDEX Sample No.: NX05739637 Lab Number: 05739637 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data: Doug Bogart +1 (800)237-1369 x4016 dougb@wearcheckusa.com

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter	MISSED	Aug 30 2023	?	We recommend you service the filters on this component.

HISTORICAL DIAGNOSIS

27 May 2022 Diag: Doug Bogart





We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





OIL ANALYSIS REPORT

IRON STAR [200006142] Machine Id 58WEA88303

Component

Wind Turbine Gearbox

GEAR OIL (PAO) ISO 320 (--- LTR)

May(1022 Jan(102)

Sample Rating Trend



DIAGNOSIS

Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.


Fluid Condition

The oil viscosity is higher than normal. The AN level is acceptable for this fluid.

			May2022	Jan 2023		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		NX05739637	NX05555939	
Sample Date		Client Info		15 Jan 2023	27 May 2022	
Machine Age	hrs	Client Info		0	0	
Oil Age	hrs	Client Info		0	0	
Oil Changed		Client Info		N/A	N/A	
Sample Status				ABNORMAL	ABNORMAL	
WEAR METALS		method	limit/base	current	history1	history2
PQ		ASTM D8184	>50	9	16	
Iron	ppm	ASTM D5185m	>30	21	11	
Chromium	ppm	ASTM D5185m	>3	0	0	
Nickel	ppm	ASTM D5185m	>3	0	<1	
Titanium	ppm	ASTM D5185m	>10	0	0	
Silver	ppm	ASTM D5185m		0	0	
Aluminum	ppm	ASTM D5185m	>30	0	0	
Lead	ppm	ASTM D5185m	>15	<1	<1	
Copper	ppm	ASTM D5185m	>10	0	0	
Tin	ppm	ASTM D5185m	>10	<1	<1	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	25	8	13	
Barium	ppm	ASTM D5185m	12	0	0	
Molybdenum	ppm	ASTM D5185m	5	0	0	
Manganese	ppm	ASTM D5185m		<1	<1	
Magnesium	ppm	ASTM D5185m	25	0	0	
Calcium	ppm	ASTM D5185m	25	19	7	
Phosphorus	ppm	ASTM D5185m	375	212	204	
Zinc	ppm	ASTM D5185m	25	4	0	
Sulfur	ppm	ASTM D5185m	4900	5540	4559	
CONTAMINANTS	3	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>+15	9	8	
Sodium	ppm	ASTM D5185m		3	2	
Potassium	ppm	ASTM D5185m	>20	0	0	
Water	%	ASTM D6304	>0.02	0.004	0.005	
ppm Water	ppm	ASTM D6304	>200	46.4	50.6	
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		61968	37828	
Particles >6µm		ASTM D7647	>320	<u>^</u> 2612	<u></u> ▲ 884	
Particles >14µm		ASTM D7647	>40	<u>^</u> 61	▲ 58	
Particles >21µm		ASTM D7647	>10	<u> </u>	<u>^</u> 21	
Particles >38µm		ASTM D7647	>3	0	1	
Particles >71µm		ASTM D7647	>3	0	0	
Oil Cleanliness		ISO 4406 (c)	>/15/12	23/19/13	<u>^</u> 22/17/13	
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2



OIL ANALYSIS REPORT

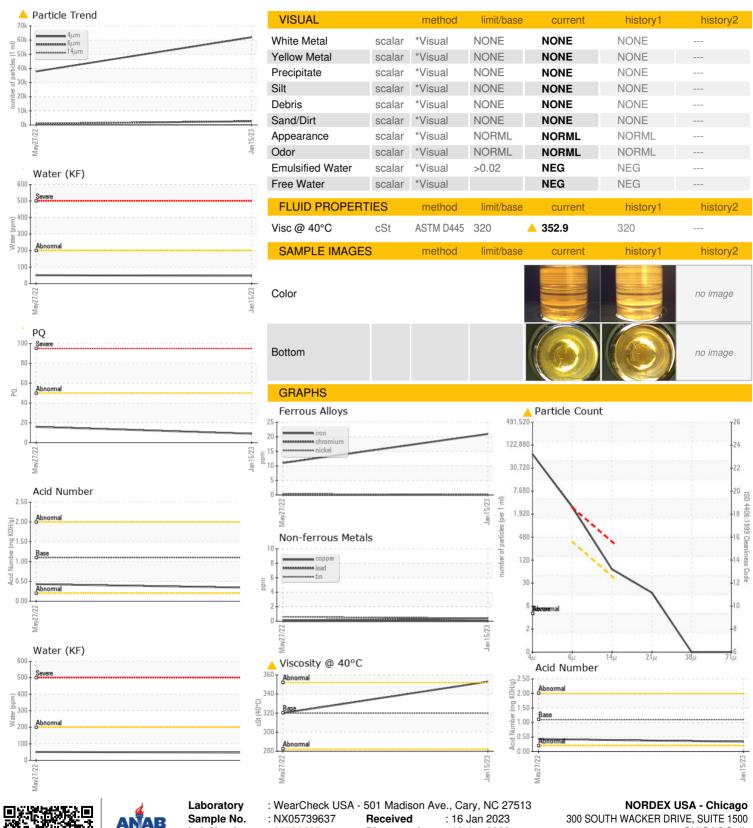



Certificate L2367

Lab Number **Unique Number**

: 05739637

: 10294236

Diagnosed Diagnostician : Doug Bogart

: 18 Jan 2023

Test Package: IND 2 (Additional Tests: KF, PQ, PrtCount) To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

CHICAGO, IL

US 60606 Contact: DEVIN LINEHAN

DLinehan@nordex-online.com T: (312)386-4124

F: (312)386-7102 Contact/Location: DEVIN LINEHAN - NORDEX