


# OIL ANALYSIS REPORT

## Sample Rating Trend



**NORMAL**

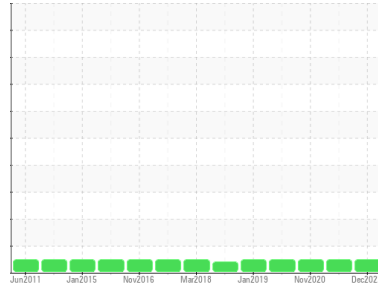

Machine Id  
**C106 (S/N 6407-07)**

Component  
**Wind Turbine Gearbox**

Fluid  
**MOBIL MOBILGEAR SHC XMP 320 (74 GAL)**

### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

### SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>MHI025110</b>	MHI017050	MHI017490
Sample Date	Client Info		<b>14 Dec 2022</b>	17 Dec 2021	20 Nov 2020
Machine Age	hrs	Client Info	<b>0</b>	0	0
Oil Age	hrs	Client Info	<b>86810</b>	81016	75900
Oil Changed	Client Info		<b>Not Chngd</b>	Not Chngd	N/A
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

### WEAR METALS

	method	limit/base	current	history1	history2	
PQ	ASTM D8184	>200	<b>10</b>	19	18	
Iron	ppm	ASTM D5185m	>200	<b>3</b>	6	8
Chromium	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Silver	ppm	ASTM D5185m		<b>0</b>	0	<1
Aluminum	ppm	ASTM D5185m	>30	<b>0</b>	0	0
Lead	ppm	ASTM D5185m	>15	<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>75	<b>50</b>	34	14
Tin	ppm	ASTM D5185m	>10	<b>0</b>	<1	<1
Antimony	ppm	ASTM D5185m	>5	<b>---</b>	0	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0

### ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	0	<b>0</b>	2	3
Barium	ppm	ASTM D5185m		<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	<1	<1
Magnesium	ppm	ASTM D5185m		<b>0</b>	0	<1
Calcium	ppm	ASTM D5185m	0	<b>0</b>	0	<1
Phosphorus	ppm	ASTM D5185m	485	<b>320</b>	410	397
Zinc	ppm	ASTM D5185m	0	<b>13</b>	11	16
Sulfur	ppm	ASTM D5185m		<b>3248</b>	3447	3496






### CONTAMINANTS

	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m	>+30	<b>0</b>	<1	0
Sodium	ppm	ASTM D5185m	>15	<b>0</b>	0	<1
Potassium	ppm	ASTM D5185m	>20	<b>0</b>	0	0
Water	%	ASTM D6304	>0.1	<b>0.014</b>	0.004	0.003
ppm Water	ppm	ASTM D6304	>1000	<b>140.4</b>	44.0	38.1

### FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>1114</b>	163	394
Particles >6µm	ASTM D7647	>5000	<b>177</b>	46	46
Particles >14µm	ASTM D7647	>640	<b>8</b>	8	6
Particles >21µm	ASTM D7647	>160	<b>2</b>	5	2
Particles >38µm	ASTM D7647	>40	<b>1</b>	1	0
Particles >71µm	ASTM D7647	>10	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>--/19/16	<b>17/15/10</b>	15/13/10	16/13/10

# OIL ANALYSIS REPORT

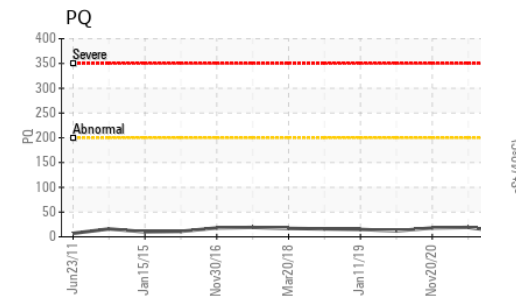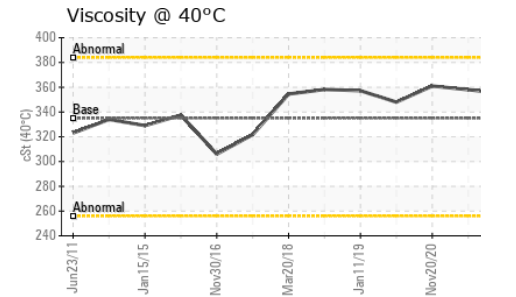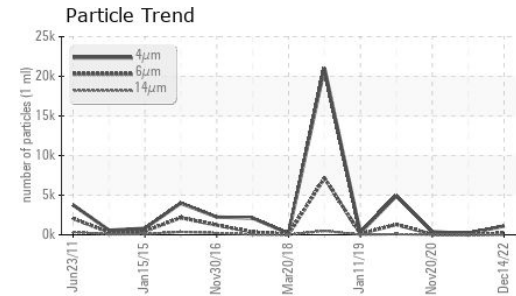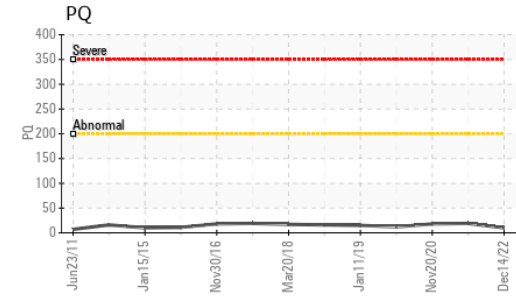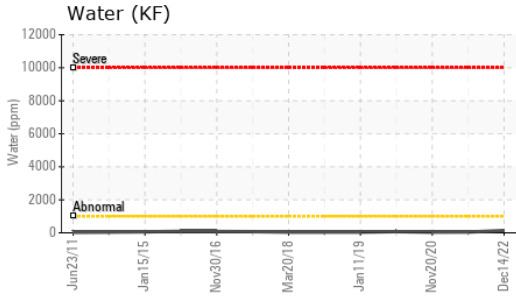


FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.85	<b>1.01</b>	1.15	1.214






VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	<b>NEG</b>	NEG	NEG
Free Water	scalar	*Visual		<b>NEG</b>	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	335	<b>355</b>	358	361

SAMPLE IMAGES		method	limit/base	current	history1	history2
---------------	--	--------	------------	---------	----------	----------

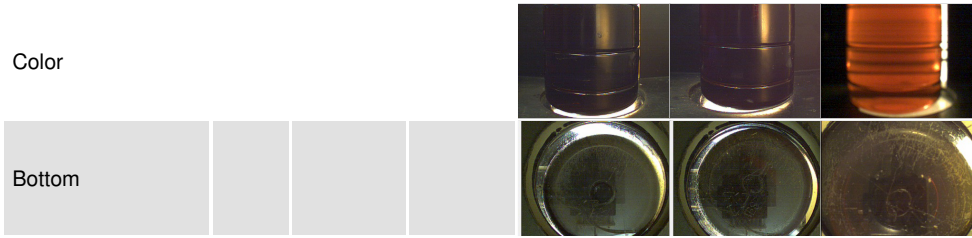

## GRAPHS

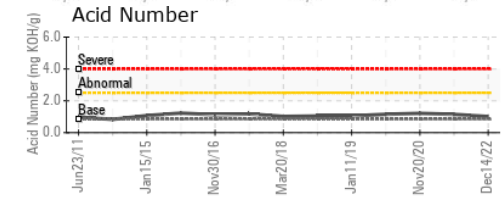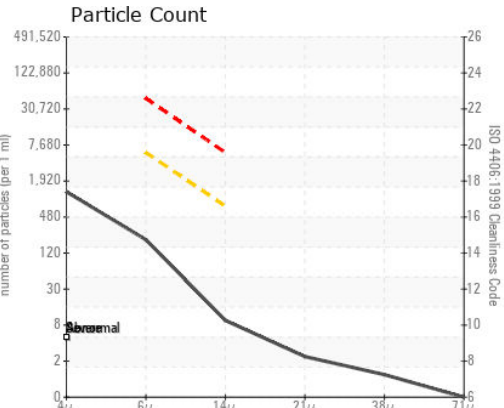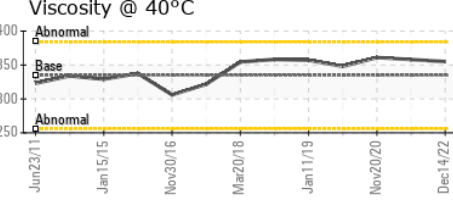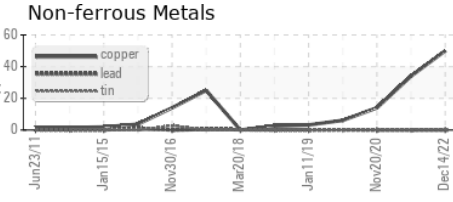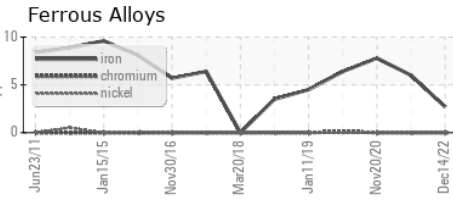

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : MH1025110 **Received** : 17 Jan 2023  
**Lab Number** : 05740532 **Diagnosed** : 18 Jan 2023  
**Unique Number** : 10295131 **Diagnostician** : Jonathan Hester  
**Test Package** : IND 2 ( Additional Tests: KF, PQ, PrtCount )

**DIAMOND WTG - DILLON**  
P.O. BOX 880  
DESERT HOT SPRINGS, CA  
US 92240  
Contact: DANIEL BOYD  
daniel.boyd@diamondwtg.com  
T: (760)329-7171  
F: (760)329-7122

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)