


KAESER COMPRESSORS Built for a lifetime."

KAESER 8484385

Component Compressor Fluid KAESER SIGMA (OEM) M-460 (--- GAL)

COMPONENT CONDITION SUMMARY

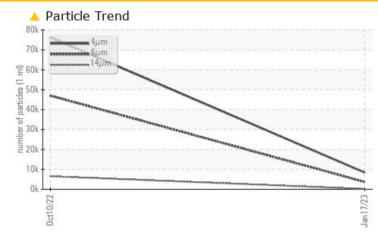

RECOMMENDATION

No corrective action is recommended at this time. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS									
Sample Status			ABNORMAL	ABNORMAL					
Particles >6µm	ASTM D7647	>1300	<u> </u>	4 6996					
Particles >14µm	ASTM D7647	>80	🔺 157	6 515					
Oil Cleanliness	ISO 4406 (c)	>/17/13	<u> </u>	▲ 23/23/20					


Customer Id: ABSGRA Sample No.: KC96756 Lab Number: 05744670 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data: Don Baldridge +1 <u>don.b505@comcast.net</u>

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

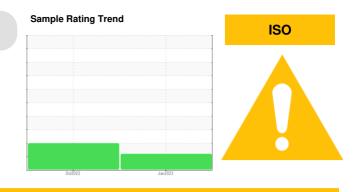

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

10 Oct 2022 Diag: Doug Bogart



We recommend you service the filters on this component. Resample at the next service interval to monitor.All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





OIL ANALYSIS REPORT

Sample Rating Trend

ISO

Machine Id KAESER 8484385 Component

Compressor

Fluid KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

A Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.


Contamination

There is a high amount of silt (particulates < 14 microns in size) present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			0ct2022	Jan2023		
		una a bla a al			la la tament	biotom (O
SAMPLE INFORM	ATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC96756	KC106549	
Sample Date		Client Info		17 Jan 2023	10 Oct 2022	
Machine Age	hrs	Client Info		606	332	
Oil Age	hrs	Client Info		606	332	
Oil Changed		Client Info		Not Changd	Not Changd	
Sample Status				ABNORMAL	ABNORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	<1	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m	>3	0	0	
Titanium	ppm	ASTM D5185m	>3	0	0	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>10	0	<1	
Lead	ppm	ASTM D5185m	>10	0	0	
Copper	ppm	ASTM D5185m	>50	1	<1	
Tin	ppm	ASTM D5185m	>10	0	<1	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	
Barium	ppm	ASTM D5185m	90	20	40	
Molybdenum	ppm	ASTM D5185m	0	0	0	
Manganese	ppm	ASTM D5185m		<1	<1	
Magnesium	ppm	ASTM D5185m	100	76	74	
Calcium	ppm	ASTM D5185m	0	2	2	
Phosphorus	ppm	ASTM D5185m	0	0	1	
Zinc	ppm	ASTM D5185m	0	4	2	
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	<1	
Sodium	ppm	ASTM D5185m		9	6	
Potassium	ppm	ASTM D5185m	>20	7	2	
Water	%	ASTM D6304	>0.05	0.018	0.035	
ppm Water	ppm	ASTM D6304	>500	181.0	357.3	
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		8385	76250	
Particles >6µm		ASTM D7647	>1300	<u> </u>	4 6996	
Particles >14µm		ASTM D7647	>80	<u> </u>	6 515	
Particles >21µm		ASTM D7647	>20	20	4 18	
Particles >38µm		ASTM D7647	>4	0	1 6	
Particles >71µm		ASTM D7647	>3	0	1	
Oil Cleanliness		ISO 4406 (c)	>/17/13	20/19/14	▲ 23/23/20	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.45	0.39	





204

P 0.2

0.00

1.20

0.9

_늘0.72

a²0.48 0.24

0.00

60

55

ှ 50

-73 45 Bas

40

Water

Abnorma

Abnorma

Se 35

OIL ANALYSIS REPORT

method

*Visual

*Visual

*Visua

*Visual

*Visual

*Visual

*Visual

*Visual

method

ASTM D445

method

scalar *Visual

scalar *Visual

scalar

scalar

scalar

scalar

scalar

scalar

scalar

scalar

cSt

limit/base

NONE

NONE

NONE

NONE

NONE

NONE

NORML

NORML

limit/base

limit/base

>0.05

45

current

NONE

NONE

NONE

NONE

NONE

NONE

NORML

NORML

curren

current

NEG

NEG

43.8

history1

NONE

NONE

NONE

NONE

LIGHT

NONE

NORML

NORML

history

history1

NEG

NEG

43.6

history2

history

history2

