OIL ANALYSIS REPORT

Sample Rating Trend

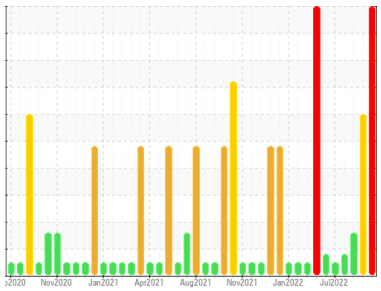

WEAR

Machine Id
COVM03BE (S/N GZJ00181)
Component
Biogas Engine
Fluid
CHEVRON HDAX 6500 LFG GAS ENGINE OIL (141 GAL)

DIAGNOSIS

Recommendation
We advise that you inspect for the source(s) of wear. We recommend an early resample to monitor this condition.

Wear
The iron level is severe. Cylinder, crank, or cam shaft wear is indicated. Valve wear is indicated.

Contamination
There is no indication of any contamination in the oil.

Fluid Condition
The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number		Client Info		**WC0722557**	WC05625791	WC0722528
Sample Date		Client Info		**18 Jan 2023**	12 Aug 2022	05 Aug 2022
Machine Age	hrs	Client Info		**124098**	123481	123466
Oil Age	hrs	Client Info		**873**	3020	3005
Oil Changed		Client Info		**Not Changd**	N/A	N/A
Sample Status				**SEVERE**	SEVERE	ABNORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Fuel		WC Method	>4.0	**<1.0**	<1.0	<1.0
Glycol		WC Method		**NEG**	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>15	**85**	77	8
Chromium	ppm	ASTM D5185m	>4	**<1**	1	<1
Nickel	ppm	ASTM D5185m	>2	**6**	4	<1
Titanium	ppm	ASTM D5185m		**0**	0	0
Silver	ppm	ASTM D5185m	>5	**<1**	1	<1
Aluminum	ppm	ASTM D5185m	>6	**2**	4	3
Lead	ppm	ASTM D5185m	>9	**<1**	2	2
Copper	ppm	ASTM D5185m	>6	**2**	3	2
Tin	ppm	ASTM D5185m	>4	**1**	2	4
Vanadium	ppm	ASTM D5185m		**0**	0	0
Cadmium	ppm	ASTM D5185m		**0**	<1	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		**9**	31	9
Barium	ppm	ASTM D5185m		**0**	<1	0
Molybdenum	ppm	ASTM D5185m		**6**	11	4
Manganese	ppm	ASTM D5185m		**1**	1	<1
Magnesium	ppm	ASTM D5185m		**27**	30	28
Calcium	ppm	ASTM D5185m		**1539**	1461	1449
Phosphorus	ppm	ASTM D5185m		**313**	305	307
Zinc	ppm	ASTM D5185m		**369**	374	370
Sulfur	ppm	ASTM D5185m		**2874**	2530	2841

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>181	**63**	72	▲ 196
Sodium	ppm	ASTM D5185m		**2**	8	0
Potassium	ppm	ASTM D5185m	>20	**2**	3	0

INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844		**0**	0.1	0.1
Nitration	Abs/cm	*ASTM D7624	>20	**3.7**	4.5	4.4
Sulfation	Abs/.1mm	*ASTM D7415	>30	**16.0**	18.3	17.9

FLUID DEGRADATION		method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414	>25	**7.8**	9.3	9.1
Acid Number (AN)	mg KOH/g	ASTM D8045	1.2	**0.54**	1.07	0.89
Base Number (BN)	mg KOH/g	ASTM D2896	4.5	**4.47**	4.18	4.21

OIL ANALYSIS REPORT

Ferrous Alloys

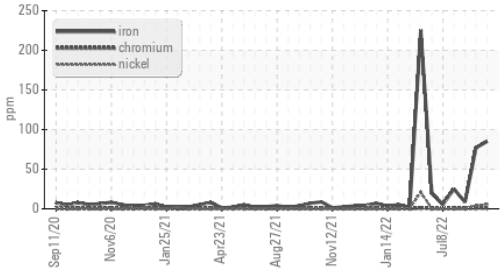

Acid Number

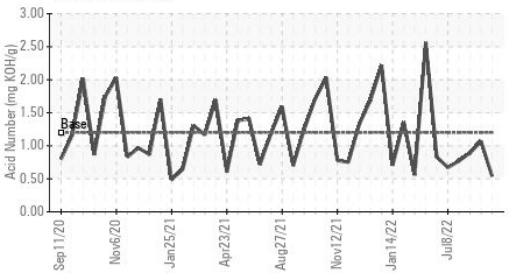

Base Number

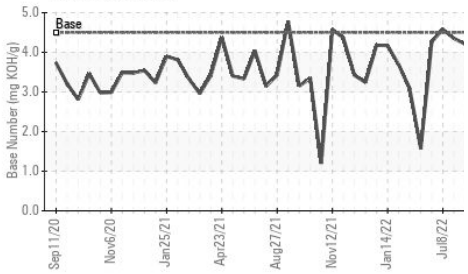

Viscosity @ 100°C

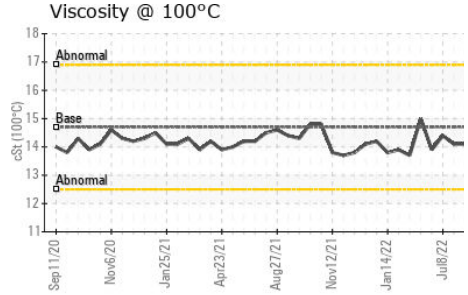

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	**NONE**	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	**NONE**	NONE	NONE
Precipitate	scalar	*Visual	NONE	**NONE**	NONE	NONE
Silt	scalar	*Visual	NONE	**NONE**	NONE	NONE
Debris	scalar	*Visual	NONE	**NONE**	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	**NONE**	NONE	NONE
Appearance	scalar	*Visual	NORML	**NORML**	NORML	NORML
Odor	scalar	*Visual	NORML	**NORML**	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	**NEG**	NEG	NEG
Free Water	scalar	*Visual		**NEG**	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	14.7	**14.2**	13.8	14.1

GRAPHS

Iron (ppm)

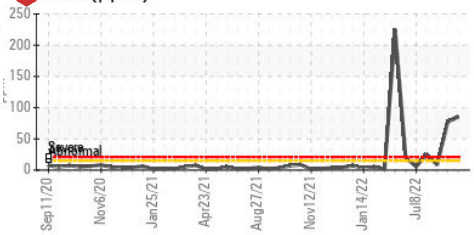

Lead (ppm)

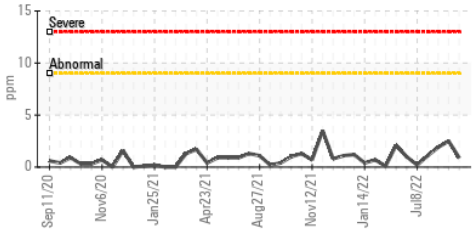

Aluminum (ppm)

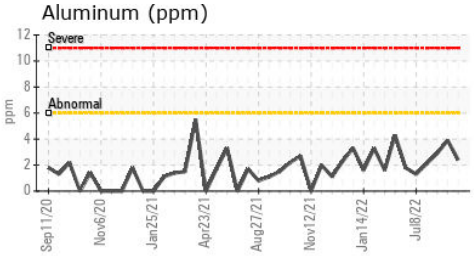

Chromium (ppm)

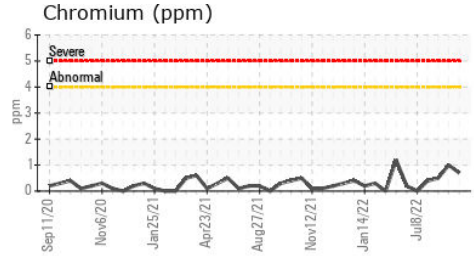

Copper (ppm)

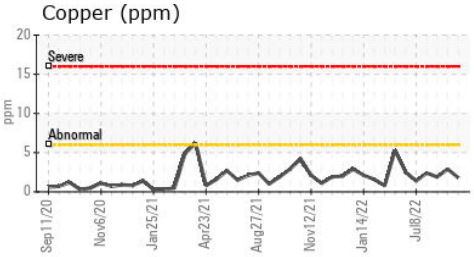

Silicon (ppm)

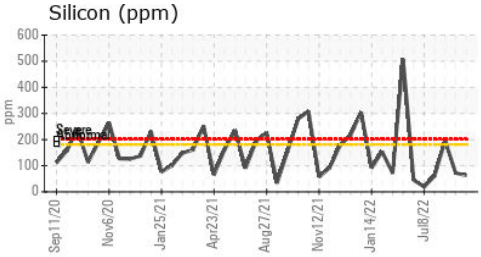

Viscosity @ 100°C

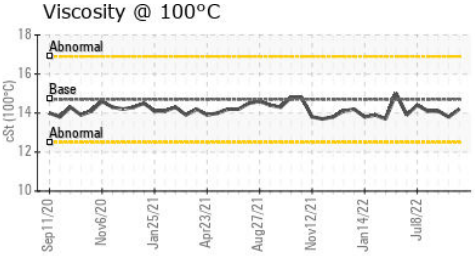

Base Number

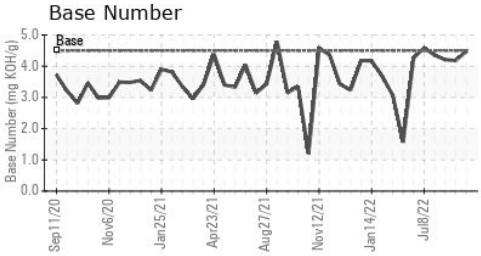

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0722557
Lab Number : 05744744
Unique Number : 10299343
Test Package : MOB 2

Received : 20 Jan 2023
Diagnosed : 23 Jan 2023
Diagnostician : Don Baldridge

To discuss this sample report, contact Customer Service at 1-800-237-1369.
** - Denotes test methods that are outside of the ISO 17025 scope of accreditation.*
Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

EDL NA Recips-Covel
COVEL GARDENS POWER STATION, 8611 COVEL ROAD
SAN ANTONIO, TX
US 78252
Contact: ARIEL CARRION
ariel.carrion@edlenergy.com
T:
F: