




PROBLEM SUMMARY


Sample Rating Trend

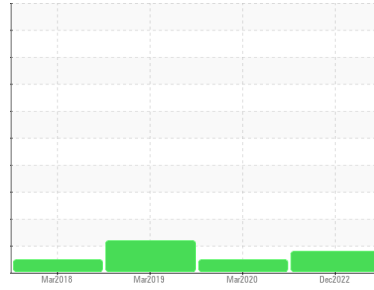

Machine Id
KAESER SFC 37 5192908 (S/N 1032)
 Component
Compressor
 Fluid
NOT GIVEN (--- QTS)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

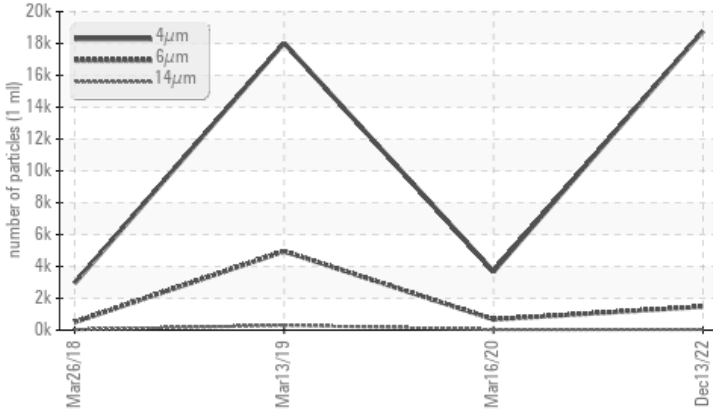

RECOMMENDATION

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor. Please specify the brand, type, and viscosity of the oil on your next sample.

PROBLEMATIC TEST RESULTS

Sample Status		ATTENTION	NORMAL	ABNORMAL
Particles >6µm	ASTM D7647 >1300	▲ 1474	670	▲ 4953
Oil Cleanliness	ISO 4406 (c) >--/17/13	▲ 21/18/13	17/12	▲ 19/15

Customer Id: VALDUB
 Sample No.: KCP49452
 Lab Number: 05746250
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Don Baldrige +1
don.b505@comcast.net

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Fluid	---	---	?	Oil and filter change at the time of sampling has been noted.
Change Filter	---	---	?	Oil and filter change at the time of sampling has been noted.
Information Required	MISSED	Aug 08 2023	?	Please specify the brand, type, and viscosity of the oil on your next sample.

HISTORICAL DIAGNOSIS

16 Mar 2020 Diag: Don Baldrige

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



13 Mar 2019 Diag: Angela Borella

ISO



The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



26 Mar 2018 Diag: Doug Bogart

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


view report



Machine Id
KAESER SFC 37 5192908 (S/N 1032)

Component
Compressor

Fluid
NOT GIVEN (--- QTS)

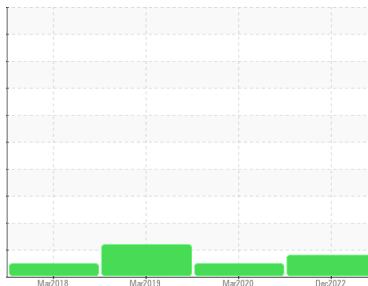

DIAGNOSIS

Recommendation

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor. Please specify the brand, type, and viscosity of the oil on your next sample.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION	method	limit/base	current	history1	history2
Sample Number	Client Info		KCP49452	KCP25110	KCP19363
Sample Date	Client Info		13 Dec 2022	16 Mar 2020	13 Mar 2019
Machine Age	hrs	Client Info	21756	11618	10349
Oil Age	hrs	Client Info	2585	2915	1646
Oil Changed	Client Info		Changed	Changed	Not Changed
Sample Status			ATTENTION	NORMAL	ABNORMAL

WEAR METALS	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<1	1	<1
Chromium	ppm	ASTM D5185m >10	0	0	0
Nickel	ppm	ASTM D5185m >3	0	0	<1
Titanium	ppm	ASTM D5185m >3	0	0	0
Silver	ppm	ASTM D5185m >2	0	<1	0
Aluminum	ppm	ASTM D5185m >10	0	1	1
Lead	ppm	ASTM D5185m >10	0	<1	0
Copper	ppm	ASTM D5185m >50	2	9	5
Tin	ppm	ASTM D5185m >10	0	0	<1
Antimony	ppm	ASTM D5185m	---	<1	0
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0






ADDITIVES	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	<1	<1
Barium	ppm	ASTM D5185m	8	<1	0
Molybdenum	ppm	ASTM D5185m	0	0	0
Manganese	ppm	ASTM D5185m	0	<1	<1
Magnesium	ppm	ASTM D5185m	2	13	40
Calcium	ppm	ASTM D5185m	0	2	<1
Phosphorus	ppm	ASTM D5185m	644	1	<1
Zinc	ppm	ASTM D5185m	48	106	94
Sulfur	ppm	ASTM D5185m	2634	17389	26188

CONTAMINANTS	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	3	0	<1
Sodium	ppm	ASTM D5185m	3	19	27
Potassium	ppm	ASTM D5185m >20	2	7	8
Water	%	ASTM D6304 >0.05	0.023	0.021	0.018
ppm Water	ppm	ASTM D6304 >500	232.7	216.7	180

FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		18774	3675	18029
Particles >6µm	ASTM D7647 >1300		▲ 1474	670	▲ 4953
Particles >14µm	ASTM D7647 >80		42	33	▲ 303
Particles >21µm	ASTM D7647 >20		9	8	▲ 77
Particles >38µm	ASTM D7647 >4		0	2	5
Particles >71µm	ASTM D7647 >3		0	0	0
Oil Cleanliness	ISO 4406 (c) >--/17/13		▲ 21/18/13	17/12	▲ 19/15

FLUID DEGRADATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.34	0.373	0.348


OIL ANALYSIS REPORT

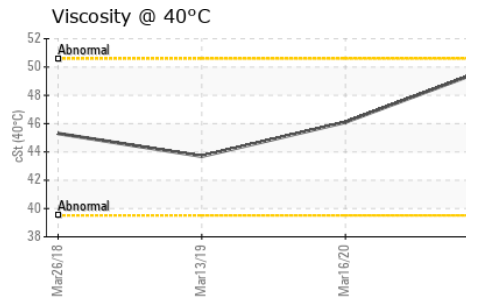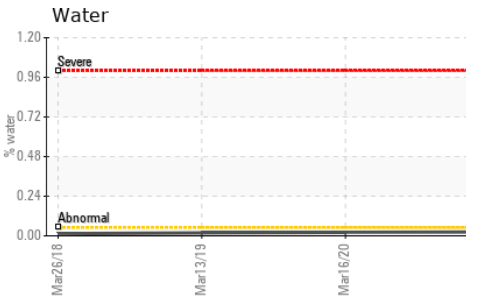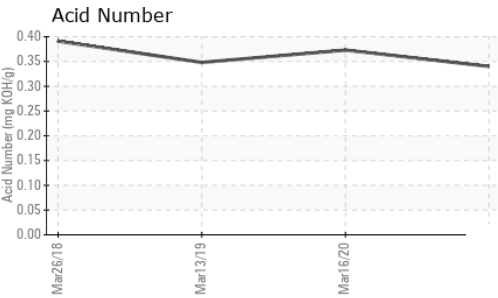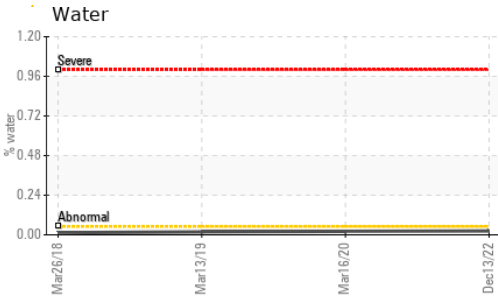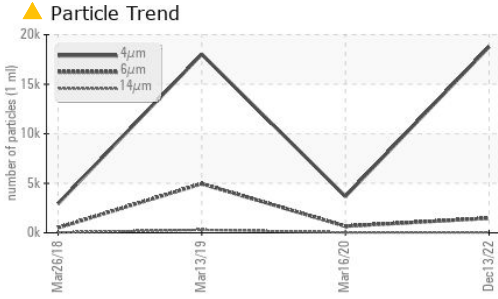





PARAMETER	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

PARAMETER	method	limit/base	current	history1	history2
FLUID PROPERTIES					
Visc @ 40°C	cSt	ASTM D445	49.9	46.1	43.69

PARAMETER	method	limit/base	current	history1	history2
-----------	--------	------------	---------	----------	----------

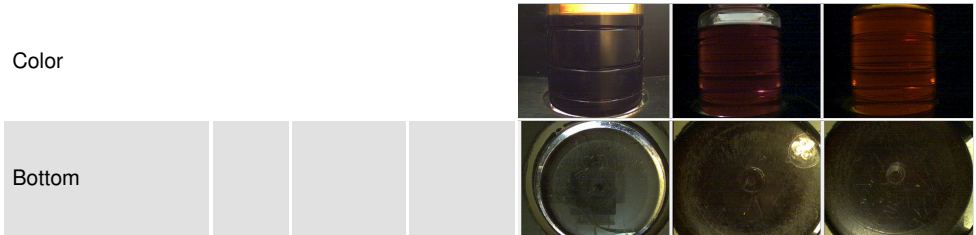

GRAPHS

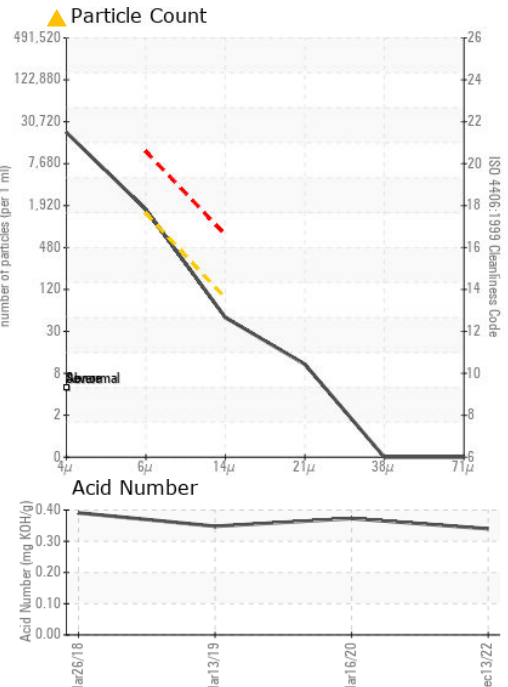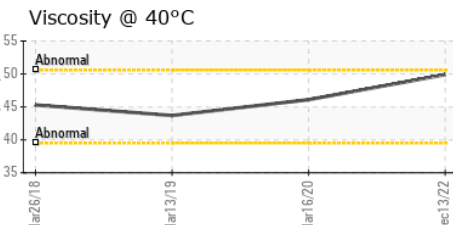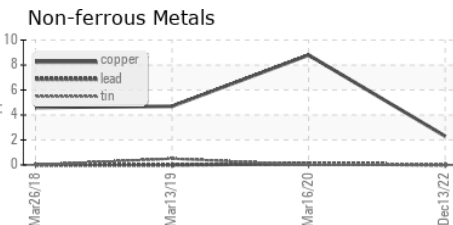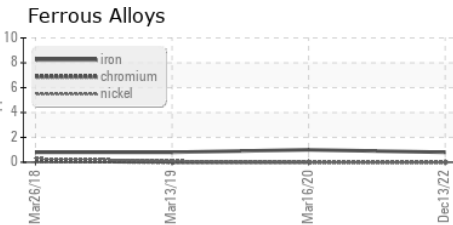

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
 Sample No. : KCP49452
 Lab Number : 05746250
 Unique Number : 10305854
 Test Package : IND 2 (Additional Tests: KF, PrtCount)

VALMIERA GLASS - SAINT GOBAIN ADFORS
 168 WILLIE PAULK PKWY
 DUBLIN, GA
 US 31021
 Contact: RYAN HARDEN
 ryan.harden@saint-gobain.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: