


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL



KAESER ASD 30 2515742 (S/N 1045)

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Feb 2021	Dec2021	Jun2022 Aug2022	Jan2023	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC108105	KC95201	KC95212
Sample Date		Client Info		17 Jan 2023	23 Aug 2022	27 Jun 2022
Machine Age	hrs	Client Info		71691	70503	70008
Oil Age	hrs	Client Info		1188	2000	1576
Oil Changed		Client Info		Not Changd	Changed	Not Changd
Sample Status				NORMAL	NORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	<1	<1
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	<1	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	<1	0
Aluminum	ppm	ASTM D5185m	>10	0	2	<1
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	2	5	4
Tin	ppm	ASTM D5185m	>10	0	1	<1
Antimony	ppm	ASTM D5185m				
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	<1	0
Barium	ppm	ASTM D5185m	90	7	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m	90	40	15	20
Calcium	ppm	ASTM D5185m	2	<1	0	0
Phosphorus	ppm	ASTM D5185m		3	1	3
Zinc	ppm	ASTM D5185m		19	28	21
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	4	2	3
Sodium	ppm	ASTM D5185m		12	2	6
Potassium	ppm	ASTM D5185m	>20	2	0	0
Water	%	ASTM D6304	>0.05	0.009	0.008	0.015
ppm Water	ppm	ASTM D6304	>500	98.0	84.4	153.2
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		1682	378	2488
Particles >6µm		ASTM D7647	>1300	458	95	511
Particles >14μm		ASTM D7647	>80	29	14	28
Particles >21µm		ASTM D7647	>20	8	5	7
Particles >38μm		ASTM D7647	>4	0	0	0
Particles >71μm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	18/16/12	16/14/11	18/16/12
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.40	0.33	0.31



OIL ANALYSIS REPORT

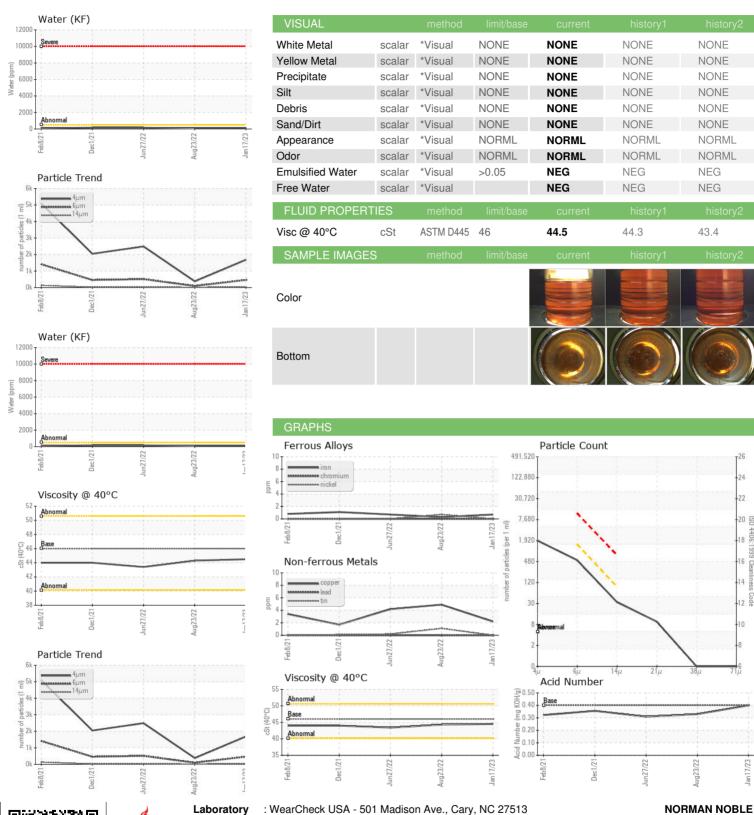





Certificate L2367

Laboratory Sample No. Lab Number

: KC108105 : 05746286

Unique Number: 10305890 Test Package : IND 2

Received **Tested** Diagnosed

: 25 Jan 2023 - Don Baldridge

: 23 Jan 2023

: 24 Jan 2023

5340 AVION PKWY HIGHLAND HEIGHTS, OH US 44143

Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:

F: