




OIL ANALYSIS REPORT

Sample Rating Trend

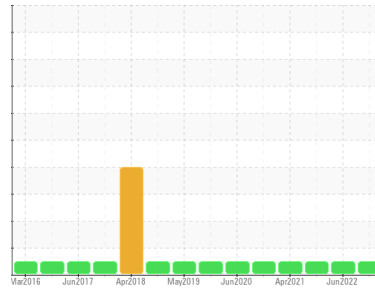

NORMAL



Area
THUNDER SPIRIT [200005313]
 Machine Id
11WEA84027 (S/N EWP07525)

Component
Wind Turbine Gearbox
 Fluid
CASTROL OPTIGEAR SYNTHETIC X 320 (--- QTS)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the component. The amount and size of particulates present in the system is acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		NX011655	NX011201	NX004439
Sample Date	Client Info		04 Nov 2022	22 Jun 2022	09 Aug 2021
Machine Age	hrs	Client Info	51210	48292	41548
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			NORMAL	NORMAL	NORMAL

WEAR METALS

	method	limit/base	current	history1	history2	
PQ	ASTM D8184	>80	7	19	16	
Iron	ppm	ASTM D5185m	>150	4	3	2
Chromium	ppm	ASTM D5185m	>5	<1	0	0
Nickel	ppm	ASTM D5185m	>10	<1	0	0
Titanium	ppm	ASTM D5185m	>10	0	0	0
Silver	ppm	ASTM D5185m		0	8	<1
Aluminum	ppm	ASTM D5185m	>10	<1	0	0
Lead	ppm	ASTM D5185m	>20	<1	<1	0
Copper	ppm	ASTM D5185m	>50	<1	<1	1
Tin	ppm	ASTM D5185m	>10	<1	0	0
Antimony	ppm	ASTM D5185m	>5	---	---	0
Vanadium	ppm	ASTM D5185m		<1	0	0
Cadmium	ppm	ASTM D5185m		0	0	0

ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m		0	<1	2
Barium	ppm	ASTM D5185m		3	0	0
Molybdenum	ppm	ASTM D5185m	1150	564	517	645
Manganese	ppm	ASTM D5185m		<1	0	0
Magnesium	ppm	ASTM D5185m		6	5	4
Calcium	ppm	ASTM D5185m	2000	1077	1068	1341
Phosphorus	ppm	ASTM D5185m	400	314	255	324
Zinc	ppm	ASTM D5185m	0	0	0	0
Sulfur	ppm	ASTM D5185m	1850	1551	1623	1570

CONTAMINANTS






	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m	>50	9	7	7
Sodium	ppm	ASTM D5185m	>20	6	4	5
Potassium	ppm	ASTM D5185m	>20	0	0	0
Water	%	ASTM D6304	>0.05	0.008	0.024	0.019
ppm Water	ppm	ASTM D6304	>500	83.7	242.7	193.9

FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		973	941	1837
Particles >6µm	ASTM D7647	>2500	165	245	336
Particles >14µm	ASTM D7647	>320	11	29	20
Particles >21µm	ASTM D7647	>80	2	7	3
Particles >38µm	ASTM D7647	>20	0	1	0
Particles >71µm	ASTM D7647	>4	0	1	0
Oil Cleanliness	ISO 4406 (c)	>--/18/15	17/15/11	17/15/12	18/16/11



OIL ANALYSIS REPORT

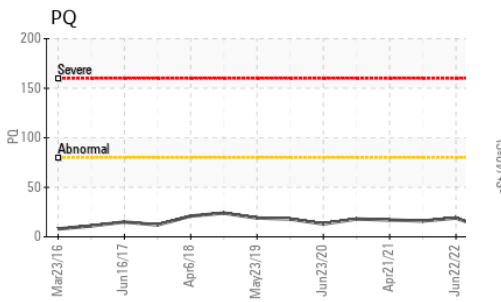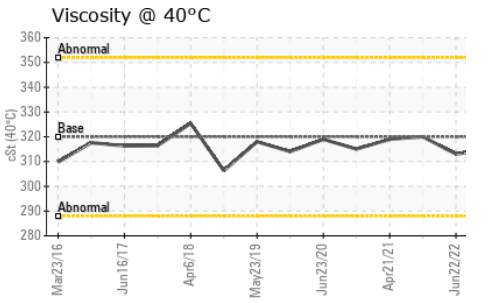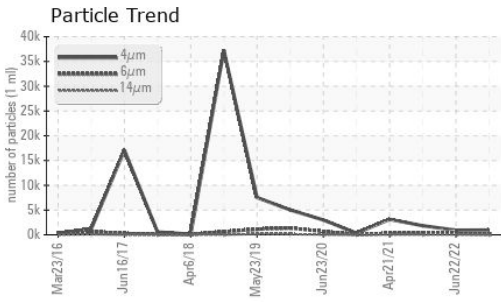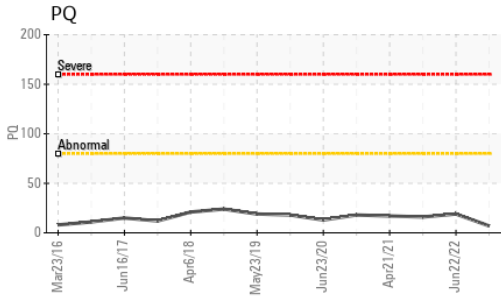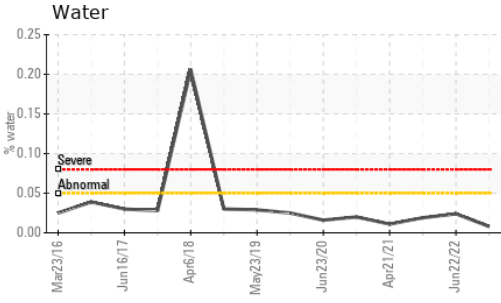


FLUID DEGRADATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 1.6	0.44	0.51	0.518

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 320	315	313	320

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------






Color



Bottom

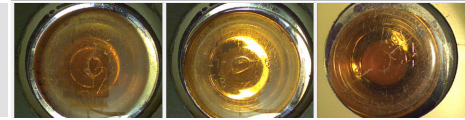

GRAPHS

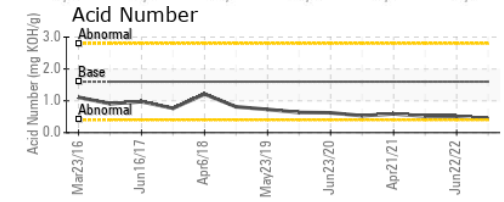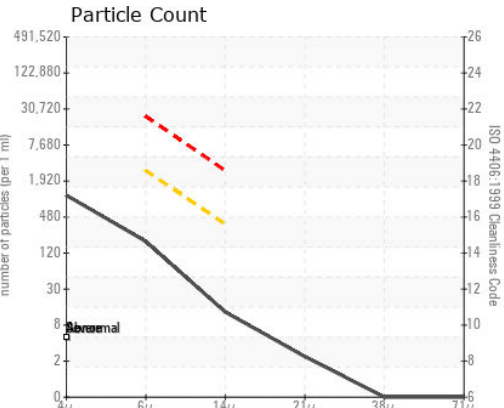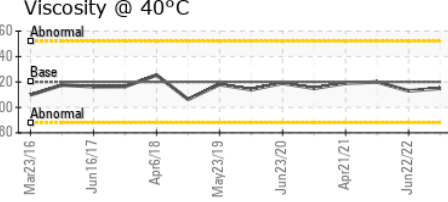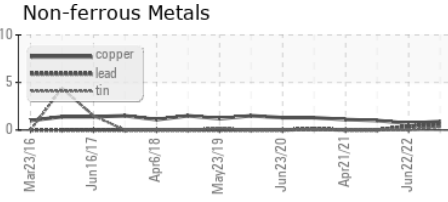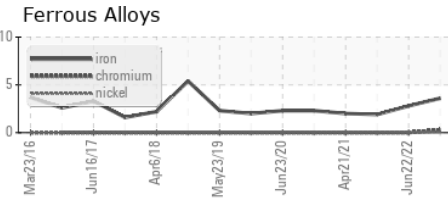

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : NX011655 **Received** : 24 Jan 2023
Lab Number : 05748992 **Diagnosed** : 26 Jan 2023
Unique Number : 10308596 **Diagnostician** : Don Baldrige

NORDEX USA - Chicago
 300 SOUTH WACKER DRIVE, SUITE 1500
 CHICAGO, IL
 US 60606
 Contact: BRIAN DOBBINS
 bdobbins@nordex-online.com
 T: (312)386-4100
 F: (312)386-7102

Test Package : IND 2 (Additional Tests: KF, PQ, PrtCount)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)