




PROBLEM SUMMARY

Sample Rating Trend

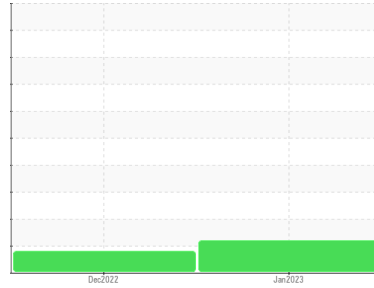

ISO




Machine Id VACUUM DEGASSER PUMP

Component
Hydraulic System

Fluid
LEYBONOL LVO 120 (15000 GAL)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

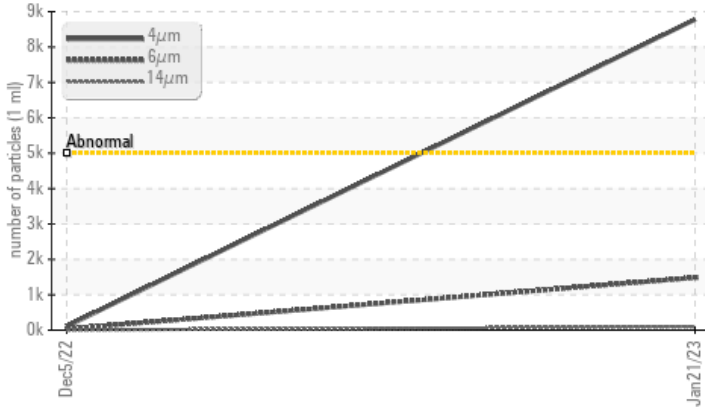

RECOMMENDATION

No corrective action is recommended at this time. Resample at the next service interval to monitor. Please note that this is a corrected copy for data entry updates.

PROBLEMATIC TEST RESULTS

Sample Status			ATTENTION	SEVERE	---
Particles >4µm	ASTM D7647	>5000	▲ 8780	106	---
Particles >6µm	ASTM D7647	>1300	▲ 1483	36	---
Oil Cleanliness	ISO 4406 (c)	>19/17/14	▲ 20/18/14	14/12/9	---

Customer Id: GENWAR
 Sample No.: WC0758504
 Lab Number: 05751404
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Doug Bogart +1 (800)237-1369 x4016
dougb@wearcheckusa.com

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

INSOLUBLES



05 Dec 2022 Diag: Aaron Black

We recommend that you use depth filtration to remove insolubles from the oil and to reduce the levels of varnish in the system. Alternatively draining a percentage of the oil and topping up with fresh oil (sweetening the oil) may provide a reduction in the varnish potential level. We recommend an early resample to monitor this condition. Additional phone discussion regarding this analysis included information that the spot test for varnish on the MPC indicated that not all of the varnish components are purely varnish. Pure varnish will react to the test chemical and this MPC did not react as typical for varnish, suggesting there is a secondary process happening in the lubricant creating solids such as ash or a chemical conversion to another chemical or polymer that is insoluble. This may be a result of mixing lubricant with incompatible additives, or may be a result of a combustion process such as filtration static arcing or microdieseling. Please note that this is a corrected copy of this report to include additional commentary to document phone conversation points. All component wear rates are normal. MPC (Membrane Patch Colorimetry) test indicates a high concentration of varnish present. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. Linear Sweep Voltammetry (RULER – ASTM D6971) testing indicates normal levels of anti-oxidants present in the oil.


view report





OIL ANALYSIS REPORT

Sample Rating Trend

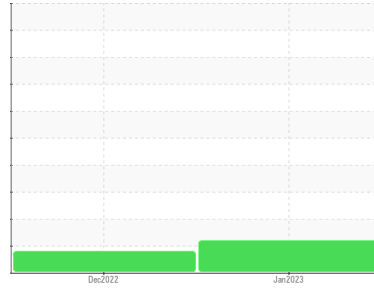

ISO



Machine Id
VACUUM DEGASSER PUMP
 Component
Hydraulic System
 Fluid
LEYBONOL LVO 120 (15000 GAL)

DIAGNOSIS

▲ Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor. Please note that this is a corrected copy for data entry updates.

Wear

All component wear rates are normal.

▲ Contamination

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			WC0758504	WC0766768	---
Sample Date	Client Info			21 Jan 2023	05 Dec 2022	---
Machine Age	hrs	Client Info		0	0	---
Oil Age	hrs	Client Info		0	0	---
Oil Changed	Client Info			Not Changed	N/A	---
Sample Status				ATTENTION	SEVERE	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>20	0	0	---
Chromium	ppm	ASTM D5185m	>20	0	0	---
Nickel	ppm	ASTM D5185m	>20	0	0	---
Titanium	ppm	ASTM D5185m		0	0	---
Silver	ppm	ASTM D5185m		0	0	---
Aluminum	ppm	ASTM D5185m	>20	0	0	---
Lead	ppm	ASTM D5185m	>20	0	0	---
Copper	ppm	ASTM D5185m	>20	0	<1	---
Tin	ppm	ASTM D5185m	>20	0	0	---
Vanadium	ppm	ASTM D5185m		0	0	---
Cadmium	ppm	ASTM D5185m		0	0	---

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	---
Barium	ppm	ASTM D5185m		0	0	---
Molybdenum	ppm	ASTM D5185m		0	0	---
Manganese	ppm	ASTM D5185m		0	0	---
Magnesium	ppm	ASTM D5185m		0	2	---
Calcium	ppm	ASTM D5185m		40	28	---
Phosphorus	ppm	ASTM D5185m		333	278	---
Zinc	ppm	ASTM D5185m		425	320	---
Sulfur	ppm	ASTM D5185m		5288	867	---






CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	<1	0	---
Sodium	ppm	ASTM D5185m		0	0	---
Potassium	ppm	ASTM D5185m	>20	0	1	---
Water	%	ASTM D6304	>0.05	0.004	0.003	---
ppm Water	ppm	ASTM D6304	>500	46.6	39.7	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>5000	▲ 8780	106	---
Particles >6µm		ASTM D7647	>1300	▲ 1483	36	---
Particles >14µm		ASTM D7647	>160	94	4	---
Particles >21µm		ASTM D7647	>40	20	2	---
Particles >38µm		ASTM D7647	>10	2	0	---
Particles >71µm		ASTM D7647	>3	0	0	---
Oil Cleanliness		ISO 4406 (c)	>19/17/14	▲ 20/18/14	14/12/9	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.61	0.33	---




OIL ANALYSIS REPORT

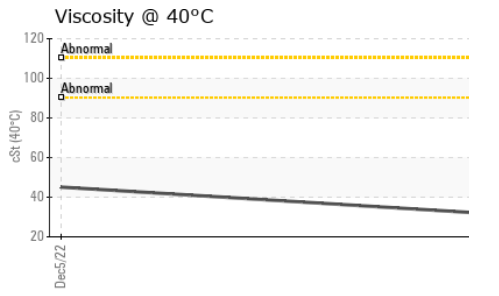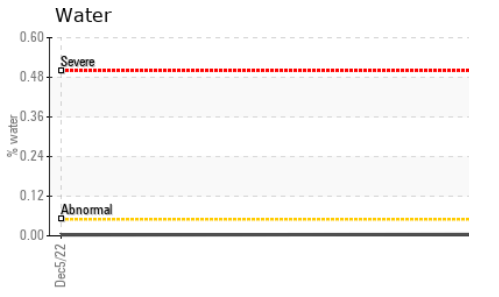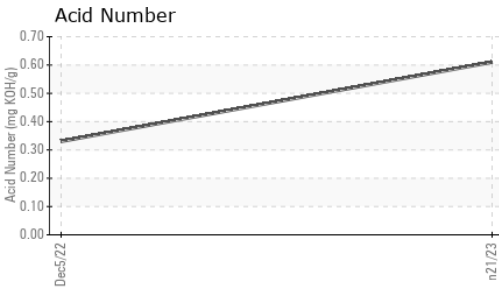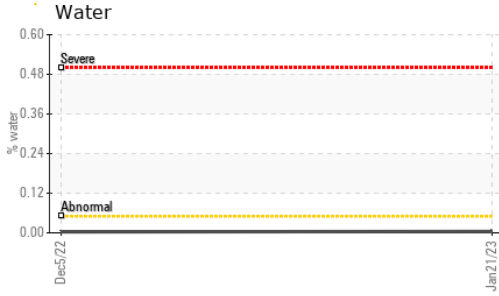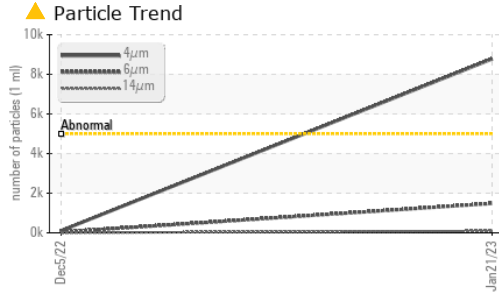






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	31.6	45.1	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

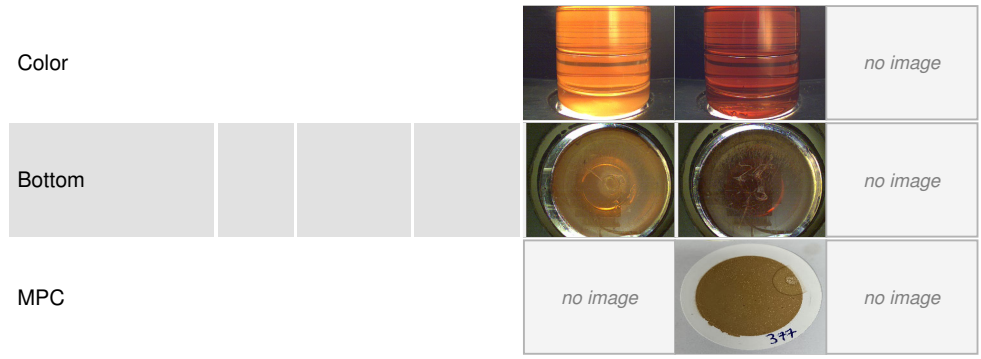

GRAPHS

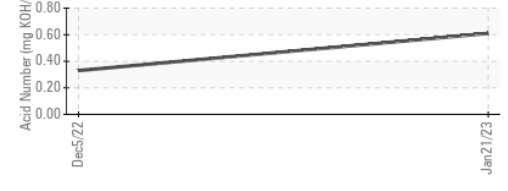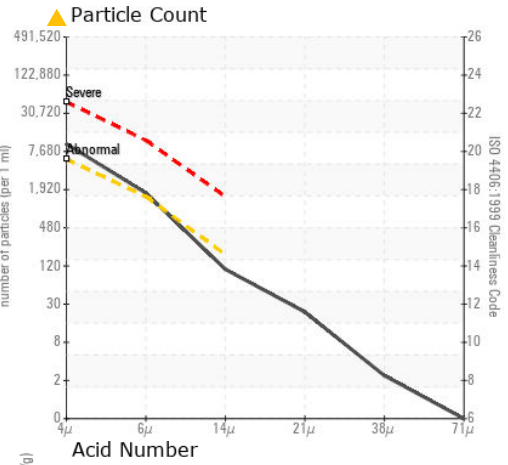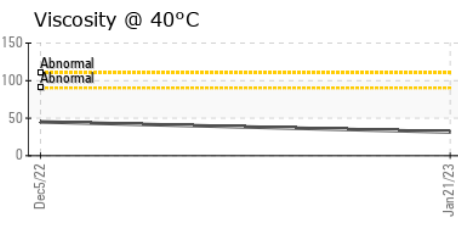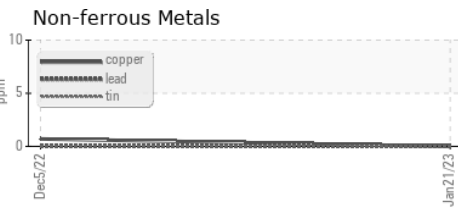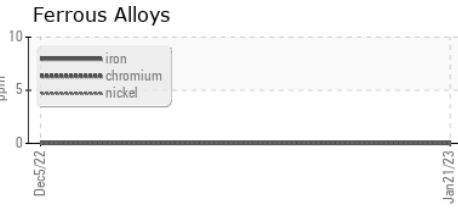

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0758504 **Received** : 26 Jan 2023
Lab Number : 05751404 **Diagnosed** : 01 Aug 2023
Unique Number : 10311008 **Diagnostician** : Doug Bogart
Test Package : IND 2 (Additional Tests: KF)

GENERAL MOTORS VPC BUILDING
 30003 VAN DYKE AVE.
 WARREN, MI
 US 48090
 Contact: DANIEL BARKUME
 daniel.barkume@gm.com
 T: (586)489-5310
 F: (586)575-1675

Certificate L2367
 To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)