

PROBLEM SUMMARY

1422254 (S/N 02610367)


Component

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

Sample Rating Trend ISO

COMPONENT CONDITION SUMMARY

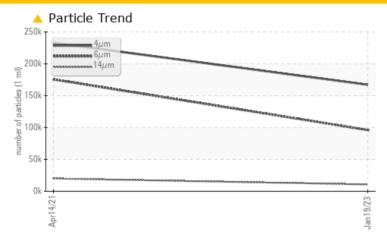

RECOMMENDATION

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS						
Sample Status	11200210	ABNORMAL	SEVERE			
Particles >6µm	ASTM D7647 >1	-	175622			
Particles >14µm	ASTM D7647 >8		▲ 19995			
Particles >21µm	ASTM D7647 >2	0 41433	1894			
Particles >38µm	ASTM D7647 >4	4 5	<u> </u>			
Particles >71µm	ASTM D7647 >3	<u>^</u> 3	1			
Oil Cleanliness	ISO 4406 (c) >	/17/13 A 25/24/21	<u>^</u> 25/21			

Customer Id: PACTRA Sample No.: KCP54361 Lab Number: 05752119 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:

Don Baldridge +1 don.b505@comcast.net

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

RECOMMENDED ACTIONS				
Action	Status	Date	Done By	Description
Change Fluid			?	Oil and filter change at the time of sampling has been noted.
Change Filter			?	Oil and filter change at the time of sampling has been noted.

HISTORICAL DIAGNOSIS

14 Apr 2021 Diag: Don Baldridge

DIRT



We advise that you check all areas where dirt can enter the system. Oil and filter change at the time of sampling has been noted. We recommend an early resample to monitor this condition. The iron level is abnormal. There is a high amount of particulates present in the oil. Elemental levels of silicon (Si) and aluminum (Al) indicate alumina-silicate (coarse dirt) ingress. The AN level is acceptable for this fluid.





OIL ANALYSIS REPORT

ISO

1422254 (S/N 02610367)

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SIS REPORT	Samp	Sample Rating Trend			
		Aprž021	Jan 2023		
SAMPLE INFORMATION	method	limit/base	current	hist	


Sample Number		Client Info		KCP54361	KCP37435	
Sample Date		Client Info		19 Jan 2023	14 Apr 2021	
Machine Age	hrs	Client Info		10524	8458	
Oil Age	hrs	Client Info		0	0	
Oil Changed		Client Info		Changed	Changed	
Sample Status				ABNORMAL	SEVERE	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	8	▲ 82	
Chromium	ppm	ASTM D5185m	>10	0	<1	
Nickel	ppm	ASTM D5185m	>3	0	<1	
Titanium	ppm	ASTM D5185m	>3	0	<1	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>10	<1	<u>^</u> 29	
Lead	ppm	ASTM D5185m	>10	0	<1	
Copper	ppm	ASTM D5185m	>50	3	<1	
Tin	ppm	ASTM D5185m	>10	0	<1	
Antimony	ppm	ASTM D5185m			0	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	
Barium	ppm	ASTM D5185m	90	0	0	
Molybdenum	ppm	ASTM D5185m	0	0	0	
Manganese	ppm	ASTM D5185m		<1	<1	
Magnesium	ppm	ASTM D5185m	100	60	7	
Calcium	ppm	ASTM D5185m	0	11	103	
Phosphorus	ppm	ASTM D5185m	0	6	25	
Zinc	ppm	ASTM D5185m	0	9	0	
Sulfur	ppm	ASTM D5185m	23500	18192	65	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	17	1 10	
Sodium	ppm	ASTM D5185m		19	7	
Potassium	ppm	ASTM D5185m	>20	3	7	
Water	%	ASTM D6304	>0.05	0.029	0.015	
ppm Water	ppm	ASTM D6304	>500	296.9	153.8	
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		167109	232950	
Particles >6µm		ASTM D7647	>1300	95995	▲ 175622	
Particles >14µm		ASTM D7647	>80	10657	<u> </u>	
Particles >21µm		ASTM D7647	>20	1433	▲ 1894	
Particles >38µm		ASTM D7647	>4	4 5	<u> </u>	
Particles >71μm		ASTM D7647	>3	△ 3	1	
Oil Cleanliness		ISO 4406 (c)	>/17/13	25/24/21	<u>\$\text{\scale}\$ 25/21</u>	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
I LOID DEGNADA	TION	method	IIIIII Dase	Carrent	HISTORY	HISTORYZ


mg KOH/g ASTM D8045 1.0

Acid Number (AN)



OIL ANALYSIS REPORT

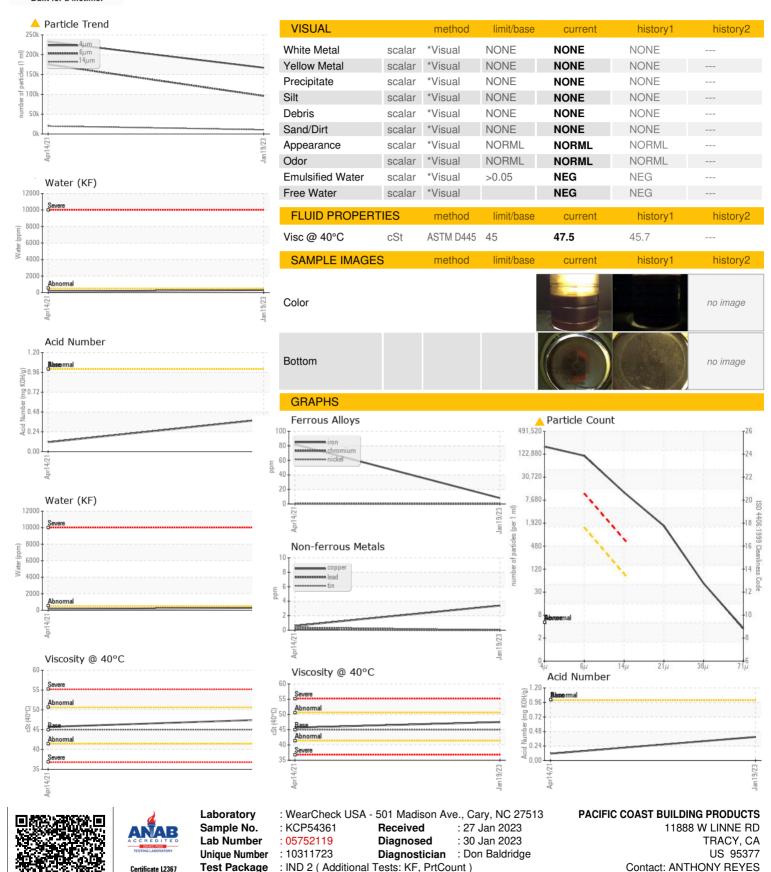



To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Certificate L2367

T: F:

anthony.reyes@basalite.com