


# **OIL ANALYSIS REPORT**

Sample Rating Trend



**NORMAL** 



7163703 (S/N 1031)

Component

**Compressor** Fluid

KAESER SIGMA (OEM) FG-460 (--- GAL)

Ν		

### Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

### Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			May2022	Jan 2023		
SAMPLE INFORM	/ATION	method	limit/base	current	history1	history2
		Client Info		KCP54319	KCP45144	
Sample Number Sample Date		Client Info		16 Jan 2023	24 May 2022	
Machine Age	hrs	Client Info		26243	20766	
Oil Age	hrs	Client Info		2000	3950	
Oil Changed	1115	Client Info		Changed	Changed	
Sample Status		Ciletit IIIIO		NORMAL	ATTENTION	
				NORMAL	ATTENTION	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	2	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m	>3	0	0	
Titanium	ppm	ASTM D5185m		0	0	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>10	3	6	
Lead	ppm	ASTM D5185m	>10	0	0	
Copper	ppm	ASTM D5185m	>50	8	12	
Tin	ppm	ASTM D5185m	>10	0	0	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	<1	
Barium	ppm	ASTM D5185m		0	0	
Molybdenum	ppm	ASTM D5185m		0	0	
Manganese	ppm	ASTM D5185m		0	<1	
Magnesium	ppm	ASTM D5185m		<1	1	
Calcium	ppm	ASTM D5185m		0	5	
Phosphorus	ppm	ASTM D5185m	500	131	341	
Zinc	ppm	ASTM D5185m		77	141	
Sulfur	ppm	ASTM D5185m		564	1411	
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	<1	
Sodium	ppm	ASTM D5185m		0	1	
Potassium	ppm	ASTM D5185m	>20	<1	0	
Water	%	ASTM D6304	>0.05	0.002	0.002	
ppm Water	ppm	ASTM D6304	>500	21.4	16.9	
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		2236	3230	
Particles >6µm		ASTM D7647	>1300	526	1127	
Particles >14µm		ASTM D7647	>80	21	<u> </u>	
Particles >21µm		ASTM D7647	>20	2	<u> 44</u>	
Particles >38µm		ASTM D7647	>4	0	1	
Particles >71µm		ASTM D7647	>3	0	0	
Oil Cleanliness		ISO 4406 (c)	>17/13	16/12	<b>▲</b> 17/14	
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
Λ = : al NI,ala = (ΛΝΙ)	1/011/-	ACTM DODAE	1 -	0.50	0.00	

Acid Number (AN)


mg KOH/g ASTM D8045 1.5

0.93

0.59



## **OIL ANALYSIS REPORT**

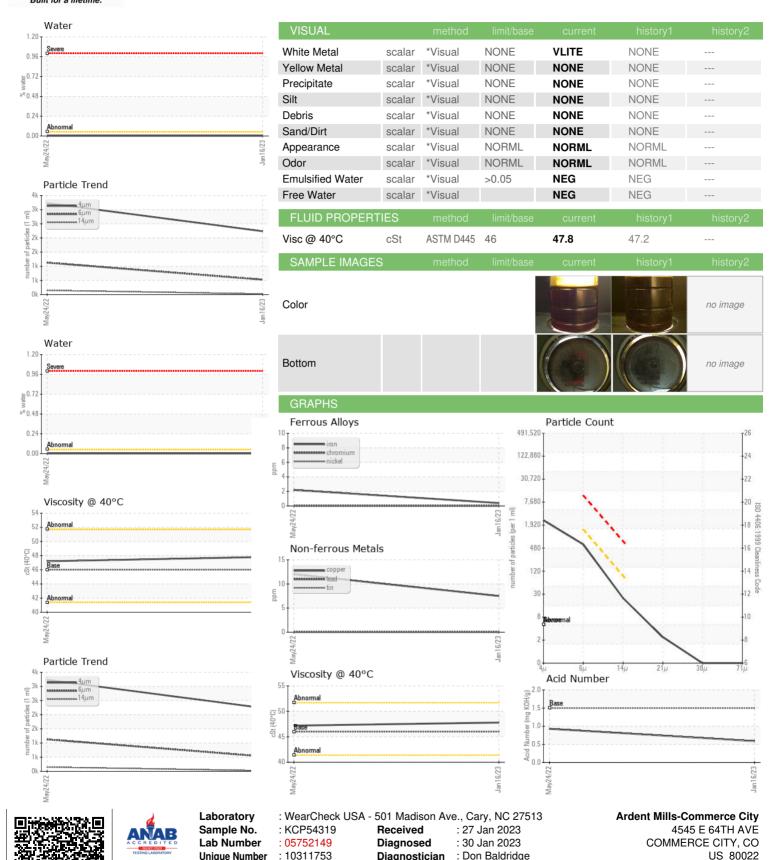



Certificate L2367

**Unique Number** 

: 10311753

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Test Package : IND 2 ( Additional Tests: KF, PrtCount )

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:

F:

Contact: HECTOR DIAZ

hector.diaz@ardentmills.com