


PROBLEM SUMMARY




AF01-4394

Component Compressor

SUMMIT ULTIMA 46 (50 GAL)

COMPONENT CONDITION SUMMARY

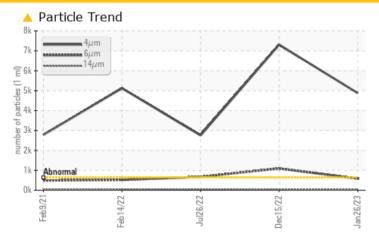

RECOMMENDATION

We recommend you service the filters on this component. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS										
Sample Status			ABNORMAL	ABNORMAL	ABNORMAL					
Particles >4μm	ASTM D7647	>640	4879	<u>▲</u> 7308	<u>△</u> 2758					
Particles >6μm	ASTM D7647	>160	△ 586	▲ 1093	△ 673					
Particles >14μm	ASTM D7647	>20	4 24	▲ 37	<u>44</u>					
Particles >21µm	ASTM D7647	>4	<u>^</u> 7	9	<u> </u>					
Oil Cleanliness	ISO 4406 (c)	>16/14/11	19/16/12	A 20/17/12	1 9/17/13					

Customer Id: FLAMONNC **Sample No.:** WC0764186 Lab Number: 05758248 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:

Don Baldridge +1 don.b505@comcast.net

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

15 Dec 2022 Diag: Don Baldridge

ISO



We recommend you service the filters on this component. Resample at the next service interval to monitor.All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



26 Jul 2022 Diag: Don Baldridge

150



No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



14 Feb 2022 Diag: Jonathan Hester

ISO




The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





OIL ANALYSIS REPORT







AF01-4394

Component

Compressor

SUMMIT ULTIMA 46 (50 GAL)

DIAGNOSIS

Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Feb 2021	Feb2022	Jul2022 Dec2022	Jan2023	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WC0764186	WC0764188	WC0635762
Sample Date		Client Info		26 Jan 2023	15 Dec 2022	26 Jul 2022
Machine Age		Client Info		0	0	0
Oil Age		Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	Not Changd
Sample Status				ABNORMAL	ABNORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
PQ		ASTM D8184		15	18	13
Iron	ppm	ASTM D5185m	>50	<1	<1	<1
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m		0	0	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>25	0	0	<1
Lead	ppm	ASTM D5185m	>25	0	0	0
Copper	ppm	ASTM D5185m	>50	7	8	8
Tin	ppm	ASTM D5185m	>15	0	0	<1
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	4
Barium	ppm	ASTM D5185m		1	1	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m		<1	0	0
Calcium	ppm	ASTM D5185m		0	0	0
Phosphorus	ppm	ASTM D5185m		10	10	18
Zinc	ppm	ASTM D5185m		16	18	7
Sulfur	ppm	ASTM D5185m		23	26	268
CONTAMINANTS	3	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	2	3	4
Sodium	ppm	ASTM D5185m		<1	0	0
Potassium	ppm	ASTM D5185m	>20	1	1	<1
Water	%	ASTM D6304	>0.1	0.013	0.015	0.052
ppm Water	ppm	ASTM D6304	>1000	136.6	157.5	524.5
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4μm		ASTM D7647	>640	4879	▲ 7308	△ 2758
Particles >6µm		ASTM D7647	>160	△ 586	△ 1093	△ 673
Particles >14μm		ASTM D7647	>20	<u>^</u> 24	▲ 37	<u>44</u>
Particles >21µm		ASTM D7647	>4	<u>^</u> 7	4 9	<u> </u>
Particles >38μm		ASTM D7647	>3	1	1	<u>^</u> 2
Particles >71μm		ASTM D7647	>3	0	0	1
Oil Cleanliness		ISO 4406 (c)	>16/14/11	1 9/16/12	<u>\</u> 20/17/12	▲ 19/17/13
FLUID DEGRADA	MOITA	method	limit/base	current	history1	history2



OIL ANALYSIS REPORT

