




OIL ANALYSIS REPORT

Sample Rating Trend

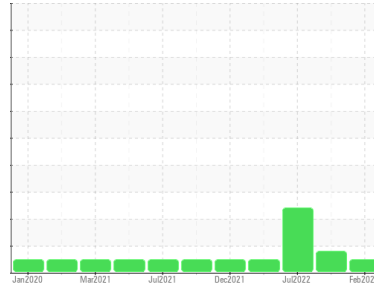

NORMAL



Area
P1
 Machine Id
3104 - 3101 EVAPORATOR
 Component
Gearbox
 Fluid
MOBIL MOBILGEAR 600 XP ISO 150 (15 QTS)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the component. The amount and size of particulates present in the system is acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0752482	WC0724719	WC0723566
Sample Date	Client Info		03 Feb 2023	20 Oct 2022	28 Jul 2022
Machine Age	hrs	Client Info	0	0	0
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			NORMAL	ATTENTION	ATTENTION

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >200	98	67	53
Chromium	ppm	ASTM D5185m >15	1	<1	<1
Nickel	ppm	ASTM D5185m >15	<1	0	0
Titanium	ppm	ASTM D5185m	3	2	1
Silver	ppm	ASTM D5185m	0	0	<1
Aluminum	ppm	ASTM D5185m >25	2	<1	<1
Lead	ppm	ASTM D5185m >100	1	<1	0
Copper	ppm	ASTM D5185m >200	7	7	8
Tin	ppm	ASTM D5185m >25	<1	<1	<1
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	<1	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	45	39	18
Barium	ppm	ASTM D5185m	0	0	<1
Molybdenum	ppm	ASTM D5185m	3	3	2
Manganese	ppm	ASTM D5185m	2	1	<1
Magnesium	ppm	ASTM D5185m	5	4	<1
Calcium	ppm	ASTM D5185m	20	17	8
Phosphorus	ppm	ASTM D5185m	346	329	327
Zinc	ppm	ASTM D5185m	21	14	7
Sulfur	ppm	ASTM D5185m	17168	16828	16228

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >50	2	1	0
Sodium	ppm	ASTM D5185m	2	0	1
Potassium	ppm	ASTM D5185m >20	7	9	0
Water	%	ASTM D6304 >0.2	0.114	0.110	▲ 0.328
ppm Water	ppm	ASTM D6304 >2000	1146.5	1105.7	▲ 3280

FLUID CLEANLINESS






	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		120017	113951	141870
Particles >6µm	ASTM D7647	>40000	18297	18735	24743
Particles >14µm	ASTM D7647	>10000	182	273	341
Particles >21µm	ASTM D7647	>2500	20	36	49
Particles >38µm	ASTM D7647	>640	1	2	4
Particles >71µm	ASTM D7647	>160	0	0	0
Oil Cleanliness	ISO 4406 (c)	>22/20	21/15	21/15	22/16

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.07	1.13	1.16




OIL ANALYSIS REPORT

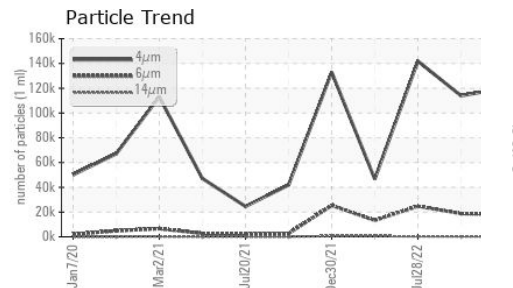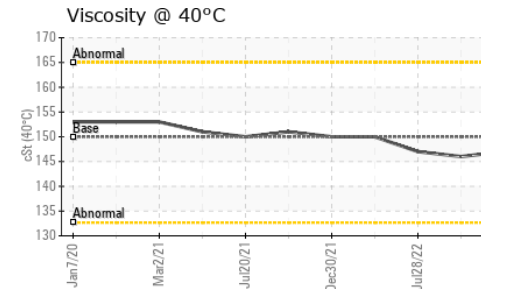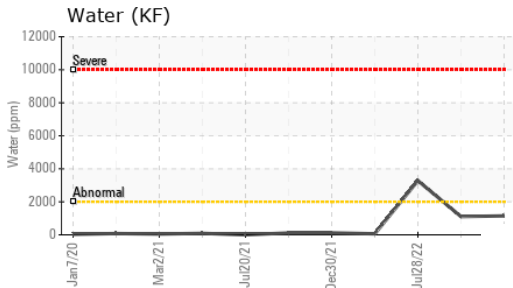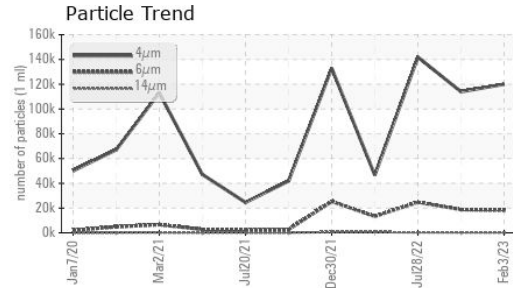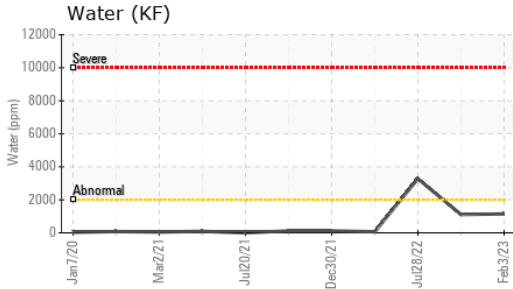






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	HAZY ▲	HAZY ▲
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	0.2%
Free Water	scalar	*Visual	NEG	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	150	147	146

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

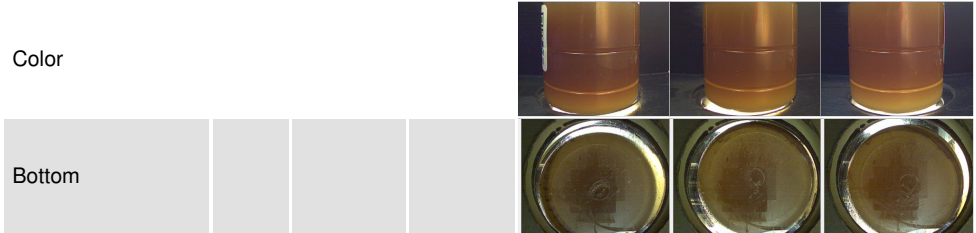

GRAPHS

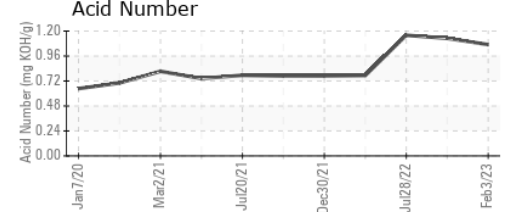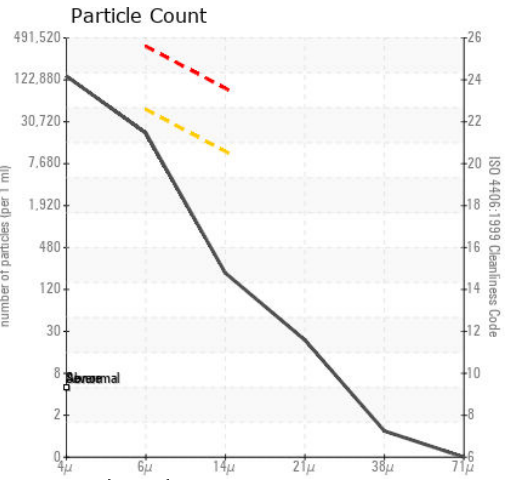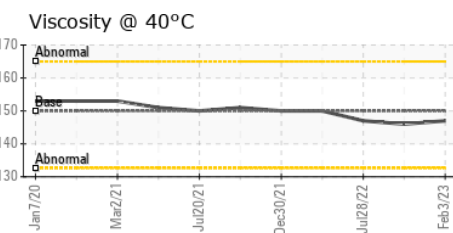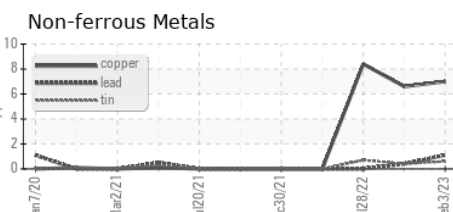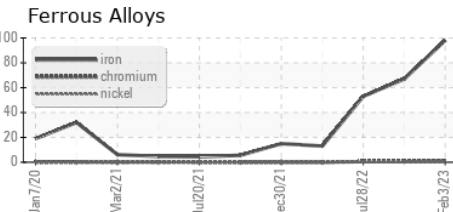

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0752482 **Received** : 07 Feb 2023
Lab Number : 05761355 **Diagnosed** : 08 Feb 2023
Unique Number : 10325962 **Diagnostician** : Doug Bogart
Test Package : IND 2 (Additional Tests: KF, PrtCount)

AJINOMOTO USA
 4020 AJINOMOTO DRIVE
 RALEIGH, NC
 US 27610
 Contact: Michael Thompson
 thompsonm@ajiusa.com
 T: (919)723-2142
 F:

Certificate L2367
 To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)