




# OIL ANALYSIS REPORT

Sample Rating Trend

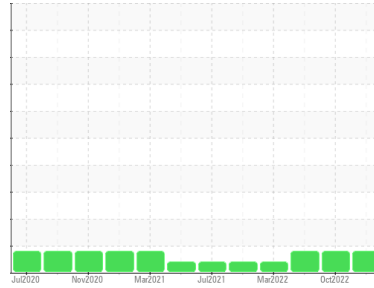

ISO



Area  
**P3**  
 Machine Id  
**3543-D Crystallizer Gearbox (S/N N/A)**  
 Component  
**Agitator Gearbox**  
 Fluid  
**Mobilgear 629 (44 QTS)**

## DIAGNOSIS

### ▲ Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### ▲ Contamination

There is a moderate amount of silt (particulates < 6 microns in size) present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>WC0784161</b>	WC0752474	WC0687532
Sample Date	Client Info	<b>03 Feb 2023</b>	20 Oct 2022	18 Jul 2022
Machine Age	hrs	Client Info	<b>0</b>	0
Oil Age	hrs	Client Info	<b>0</b>	0
Oil Changed	Client Info	<b>N/A</b>	N/A	N/A
Sample Status		<b>ATTENTION</b>	ATTENTION	ABNORMAL

## WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >150	<b>5</b>	4	2
Chromium	ppm	ASTM D5185m >10	<b>&lt;1</b>	0	0
Nickel	ppm	ASTM D5185m >10	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >25	<b>2</b>	0	0
Lead	ppm	ASTM D5185m >100	<b>&lt;1</b>	0	0
Copper	ppm	ASTM D5185m >50	<b>0</b>	0	0
Tin	ppm	ASTM D5185m >10	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	<b>16</b>	15	17
Barium	ppm	ASTM D5185m	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	<1	<1
Magnesium	ppm	ASTM D5185m	<b>&lt;1</b>	<1	<1
Calcium	ppm	ASTM D5185m	<b>1</b>	1	<1
Phosphorus	ppm	ASTM D5185m	<b>348</b>	319	298
Zinc	ppm	ASTM D5185m	<b>4</b>	2	3
Sulfur	ppm	ASTM D5185m	<b>19038</b>	17867	16026

## CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >50	<b>&lt;1</b>	0	<1
Sodium	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Potassium	ppm	ASTM D5185m >20	<b>0</b>	1	0
Water	%	ASTM D6304 >0.1	<b>0.010</b>	0.017	0.012
ppm Water	ppm	ASTM D6304 >1000	<b>103.5</b>	172.7	124.2

## FLUID CLEANLINESS






method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647 >20000	<b>▲ 31935</b>	▲ 39181	▲ 45287
Particles >6µm	ASTM D7647 >5000	<b>2279</b>	2428	2479
Particles >14µm	ASTM D7647 >640	<b>42</b>	55	57
Particles >21µm	ASTM D7647 >160	<b>7</b>	8	10
Particles >38µm	ASTM D7647 >40	<b>1</b>	0	1
Particles >71µm	ASTM D7647 >10	<b>1</b>	0	0
Oil Cleanliness	ISO 4406 (c) >21/19/16	<b>▲ 22/18/13</b>	▲ 22/18/13	▲ 23/18/13

## FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045	<b>0.79</b>	0.82	0.86



# OIL ANALYSIS REPORT

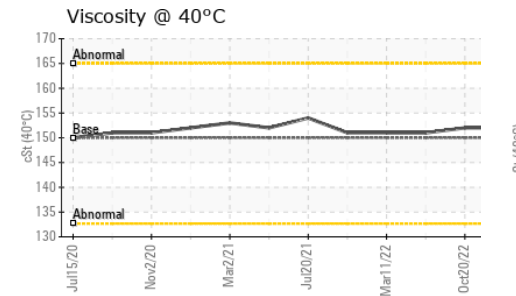
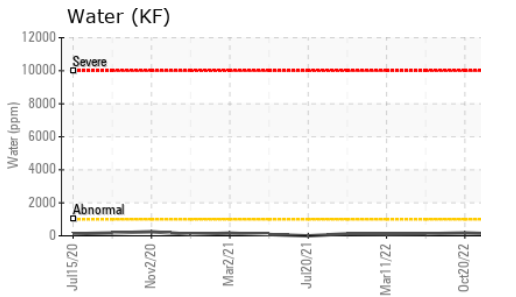
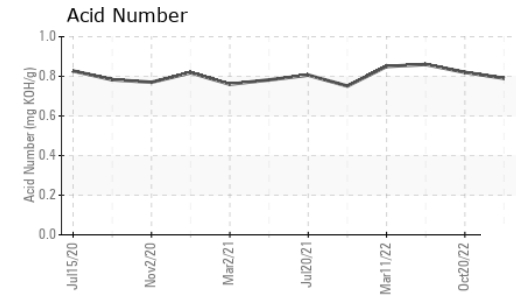
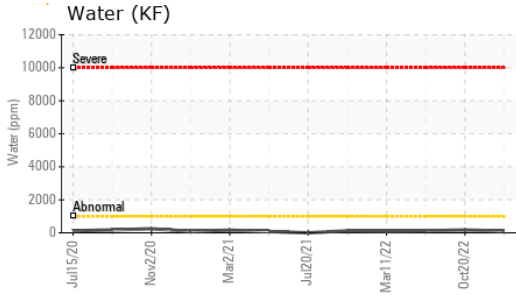
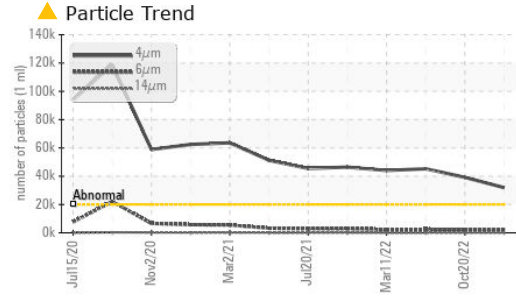


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	150	152	151

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

## GRAPHS

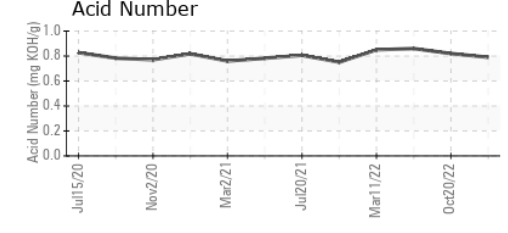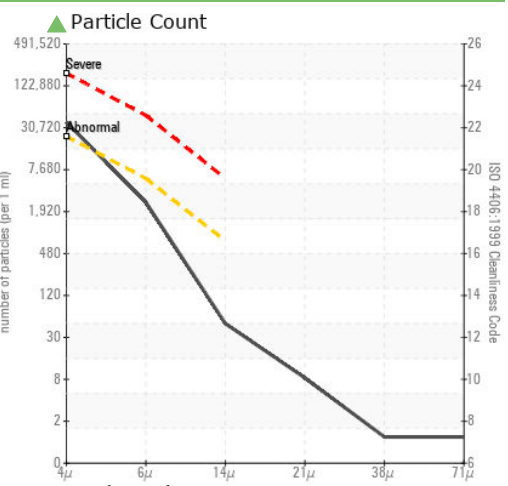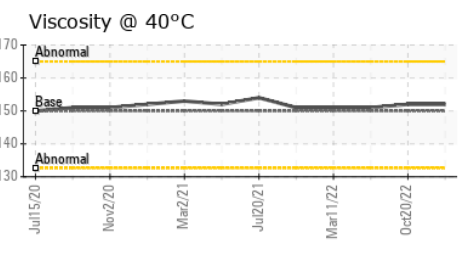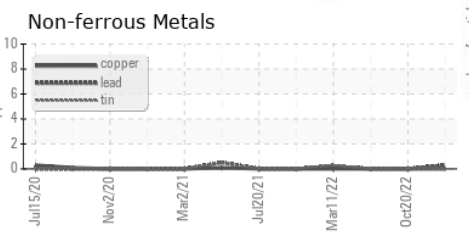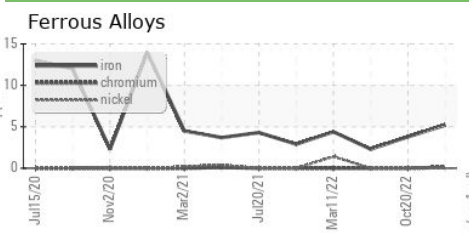

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0784161 **Received** : 07 Feb 2023  
**Lab Number** : **05761359** **Diagnosed** : 08 Feb 2023  
**Unique Number** : 10325966 **Diagnostician** : Doug Bogart  
**Test Package** : PLANT

**AJINOMOTO USA**  
 4020 AJINOMOTO DRIVE  
 RALEIGH, NC  
 US 27610  
 Contact: AJINOMOTO ACCOUNT  
 ANGELA.BORELLA@WEARCHECKUSA.COM  
 T:  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)