

Machine Id
QUINCY STATION SERVICE 1
 Component
Air Compressor
 Fluid
QUINCY QUINSYN F (7 GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the fluid. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the fluid is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			ST39286	ST34608	ST34604
Sample Date	Client Info			27 Jan 2023	06 Sep 2018	28 Sep 2017
Machine Age	hrs	Client Info		5544	2517	2745
Oil Age	hrs	Client Info		1287	815	1702
Oil Changed	Client Info			N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	NORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	<1
Chromium	ppm	ASTM D5185m	>4	0	0	0
Nickel	ppm	ASTM D5185m	>4	0	0	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m		<1	0	0
Aluminum	ppm	ASTM D5185m	>10	0	<1	<1
Lead	ppm	ASTM D5185m	>20	0	0	2
Copper	ppm	ASTM D5185m	>40	0	0	0
Tin	ppm	ASTM D5185m	>5	0	0	0
Antimony	ppm	ASTM D5185m		---	0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m		0	0	0
Calcium	ppm	ASTM D5185m		0	0	0
Phosphorus	ppm	ASTM D5185m		405	<1	3
Zinc	ppm	ASTM D5185m		2	2	0
Sulfur	ppm	ASTM D5185m		365	33	5

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	<1	<1
Sodium	ppm	ASTM D5185m		0	<1	0
Potassium	ppm	ASTM D5185m	>20	0	<1	<1
Water	%	ASTM D6304	>0.6	0.007	0.007	0.003
ppm Water	ppm	ASTM D6304	>6000	73.0	70	30

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	6844	677	6306
Particles >6µm		ASTM D7647	>2500	1794	178	2250
Particles >14µm		ASTM D7647	>320	120	9	299
Particles >21µm		ASTM D7647	>80	30	2	104
Particles >38µm		ASTM D7647	>20	2	0	15
Particles >71µm		ASTM D7647	>4	1	0	3
Oil Cleanliness		ISO 4406 (c)	>20/18/15	20/18/14	17/15/10	20/18/15

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	.10	0.22	0.198	0.168


OIL ANALYSIS REPORT

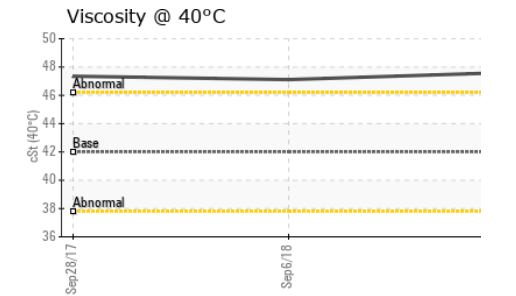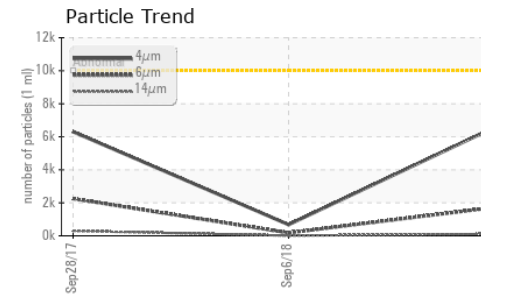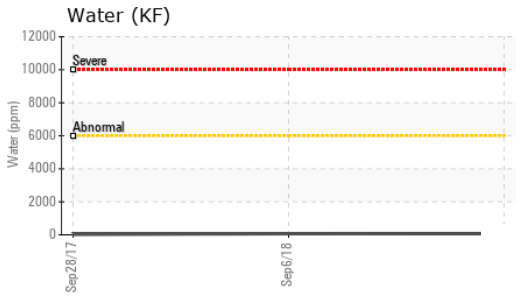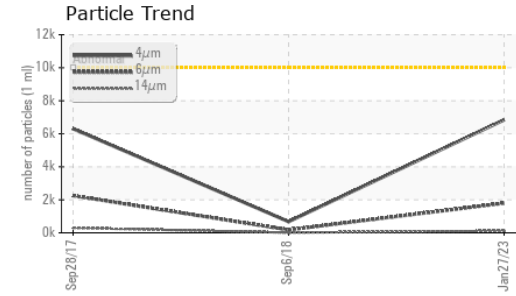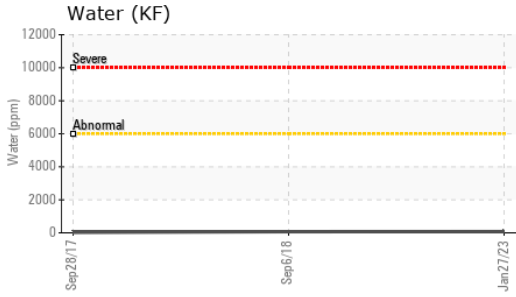






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	VLITE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.6	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 42	47.6	47.11	47.35

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

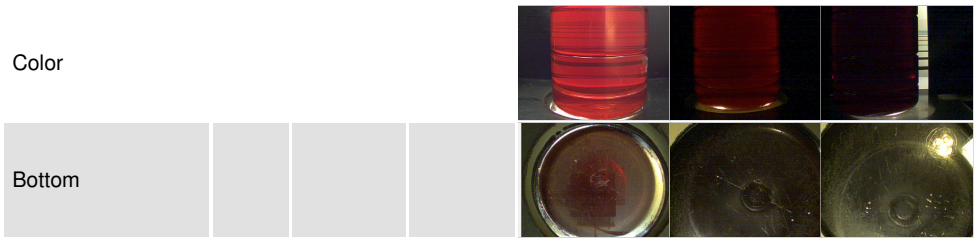

GRAPHS

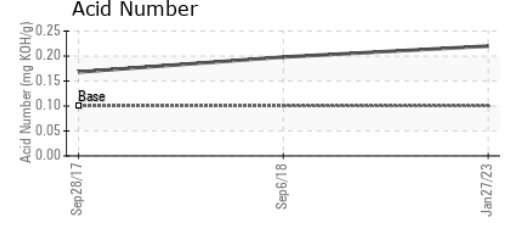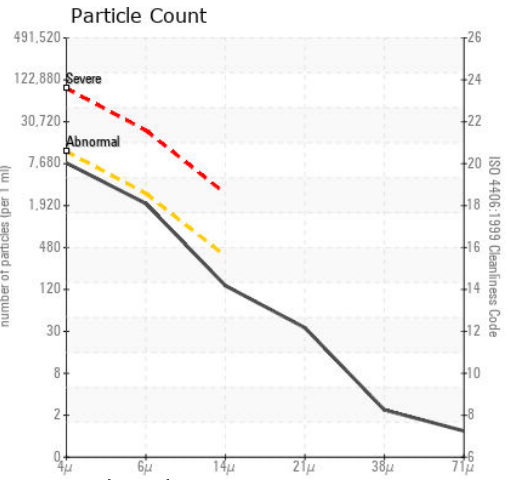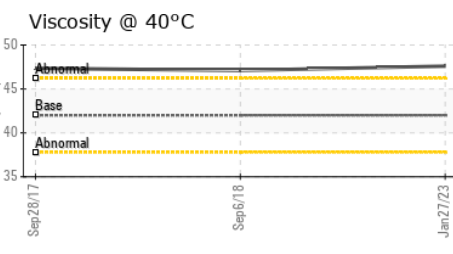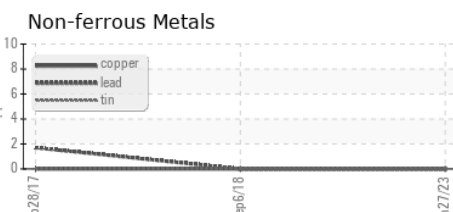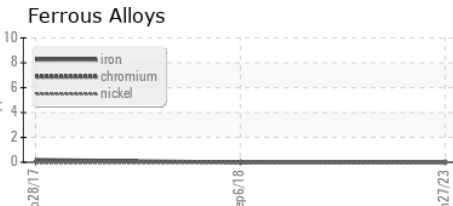

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : ST39286 **Received** : 08 Feb 2023
Lab Number : 05762885 **Diagnosed** : 14 Feb 2023
Unique Number : 10332493 **Diagnostician** : Jonathan Hester
Test Package : IND 2 (Additional Tests: KF, PrtCount)

US ARMY CORP OF ENGINEERS
 1397 POWERHOUSE RD
 SHORTERVILLE, AL
 US 36373
 Contact: JEFF MONEY
 jeffery.w.money@usace.army.mil
 T: (229)768-2635
 F: x:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)