


OIL ANALYSIS REPORT

Sample Rating Trend



WEAR

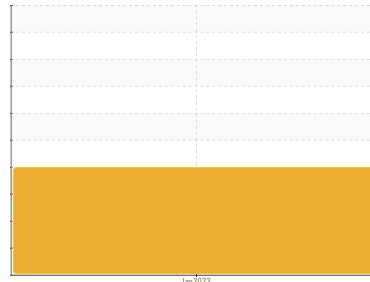

Machine Id
5449184 (S/N 1405)

Component
Compressor

Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

▲ Recommendation

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

▲ Wear

The aluminum level is abnormal. All other component wear rates are normal.

▲ Contamination

There is a high amount of particulates present in the oil.

▲ Fluid Condition

The oil viscosity is higher than normal. This plus the additive levels indicates the addition of a different brand, or type of oil. Confirm oil type. The AN level is acceptable for this fluid.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		KCP53136	---	---
Sample Date	Client Info		18 Jan 2023	---	---
Machine Age	hrs	Client Info	22500	---	---
Oil Age	hrs	Client Info	0	---	---
Oil Changed	Client Info		Changed	---	---
Sample Status			ABNORMAL	---	---

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	13	---	---
Chromium	ppm	ASTM D5185m >10	0	---	---
Nickel	ppm	ASTM D5185m >3	0	---	---
Titanium	ppm	ASTM D5185m >3	<1	---	---
Silver	ppm	ASTM D5185m >2	0	---	---
Aluminum	ppm	ASTM D5185m >10	▲ 14	---	---
Lead	ppm	ASTM D5185m >10	<1	---	---
Copper	ppm	ASTM D5185m >50	16	---	---
Tin	ppm	ASTM D5185m >10	0	---	---
Vanadium	ppm	ASTM D5185m	0	---	---
Cadmium	ppm	ASTM D5185m	0	---	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	0	---	---
Barium	ppm	ASTM D5185m 90	59	---	---
Molybdenum	ppm	ASTM D5185m 0	0	---	---
Manganese	ppm	ASTM D5185m	1	---	---
Magnesium	ppm	ASTM D5185m 100	68	---	---
Calcium	ppm	ASTM D5185m 0	▲ 25	---	---
Phosphorus	ppm	ASTM D5185m 0	▲ 107	---	---
Zinc	ppm	ASTM D5185m 0	▲ 109	---	---
Sulfur	ppm	ASTM D5185m 23500	14652	---	---

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	5	---	---
Sodium	ppm	ASTM D5185m	49	---	---
Potassium	ppm	ASTM D5185m >20	9	---	---
Water	%	ASTM D6304 >0.05	0.024	---	---
ppm Water	ppm	ASTM D6304 >500	244.2	---	---

FLUID CLEANLINESS


	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		9842	---	---
Particles >6µm	ASTM D7647	>1300	▲ 2632	---	---
Particles >14µm	ASTM D7647	>80	▲ 141	---	---
Particles >21µm	ASTM D7647	>20	▲ 22	---	---
Particles >38µm	ASTM D7647	>4	0	---	---
Particles >71µm	ASTM D7647	>3	0	---	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 20/19/14	---	---

FLUID DEGRADATION


	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 1.0	0.55	---	---

OIL ANALYSIS REPORT


▲ Particle Trend

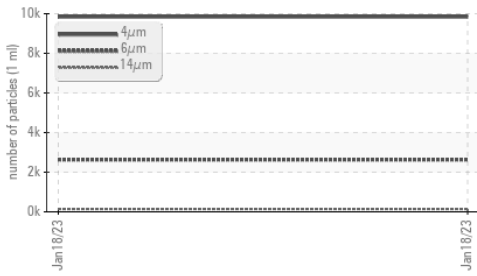


▲ Aluminum (ppm)

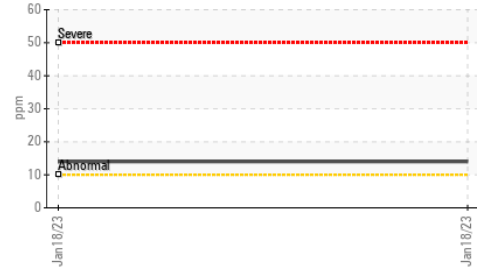


▲ Additives

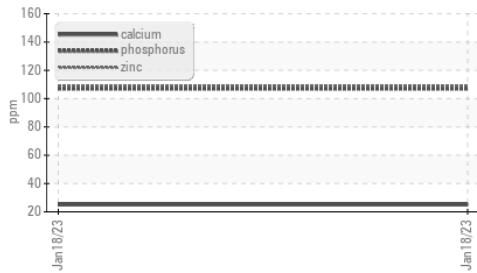

Water (KF)

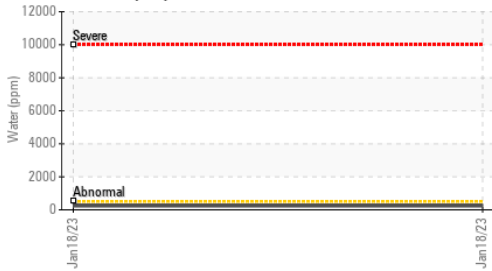

▲ Additives

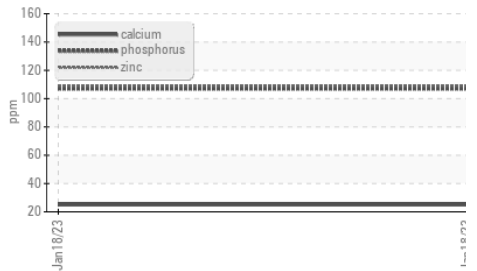

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	LIGHT	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---





FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	▲ 85.86	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color

Bottom

GRAPHS

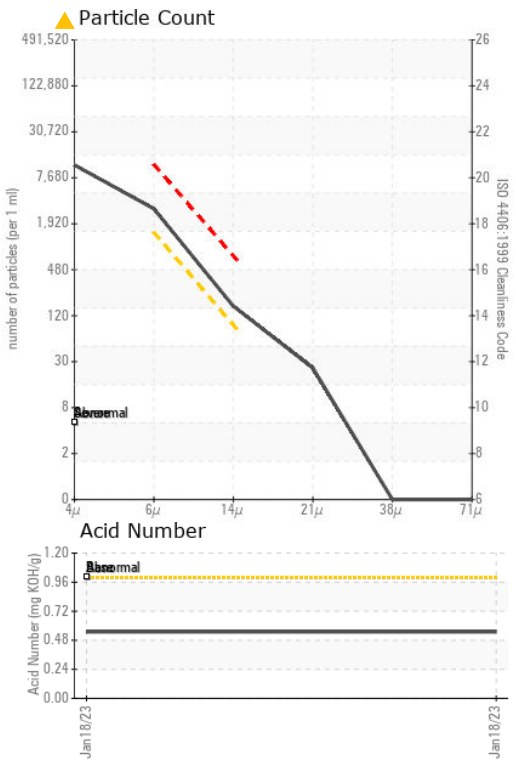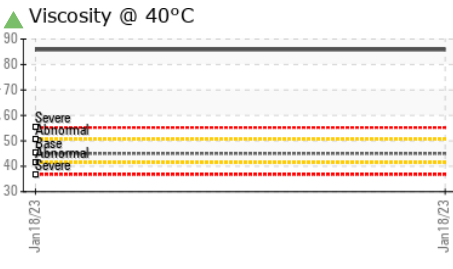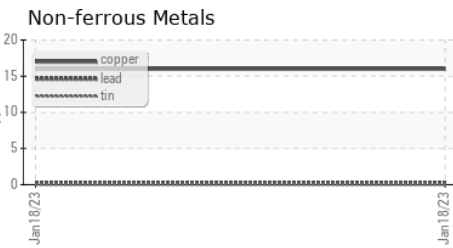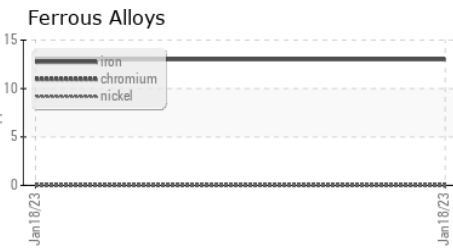

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCP53136 **Received** : 10 Feb 2023
Lab Number : 05765160 **Tested** : 15 Feb 2023
Unique Number : 10334768 **Diagnosed** : 17 Feb 2023 - Doug Bogart
Test Package : IND 2 (Additional Tests: KF, PrtCount)

EXECUTIVE CASE WORK
 945 BARRYESSA RD
 SAN JOSE, CA
 US 95111
 Contact: M. BROWN
 mbrown@executivecasework.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: