


OIL ANALYSIS REPORT



NORMAL



Machine Id KAESER AS25T 8027865 (S/N 1677)

Compressor

KAESER SIGMA (OEM) M-460 (--- QTS)

Recommendation

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Jan2023		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC97043		
Sample Date		Client Info		16 Jan 2023		
Machine Age	hrs	Client Info		834		
Oil Age	hrs	Client Info		834		
Oil Changed	1110	Client Info		Changed		
Sample Status		Olichi illio		NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m		0		
Lead		ASTM D5185m	>10	0		
Copper	ppm	ASTM D5185m		6		
Coppei Tin		ASTM D5185m	>10	0		
Vanadium	ppm		>10	0		
	ppm	ASTM D5185m		-		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0		
Barium	ppm	ASTM D5185m	90	0		
Molybdenum	ppm	ASTM D5185m	0	0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m	100	57		
Calcium	ppm	ASTM D5185m	0	<1		
Phosphorus	ppm	ASTM D5185m	0	8		
Zinc	ppm	ASTM D5185m	0	0		
CONTAMINANTS	3	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1		
Sodium	ppm	ASTM D5185m		22		
Potassium	ppm	ASTM D5185m	>20	<1		
Water	%	ASTM D6304	>0.05	0.023		
opm Water	ppm	ASTM D6304	>500	232.8		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4μm		ASTM D7647		1990		
Particles >6μm		ASTM D7647	>1300	805		
Particles >14μm		ASTM D7647	>80	31		
Particles >21µm		ASTM D7647	>20	2		
Particles >38µm		ASTM D7647	>4	0		
Particles >71μm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>17/13	17/12		
FLUID DEGRADA	NOITA	method	limit/base	current	history1	history2


Acid Number (AN)

mg KOH/g ASTM D8045 1.0

0.28



OIL ANALYSIS REPORT

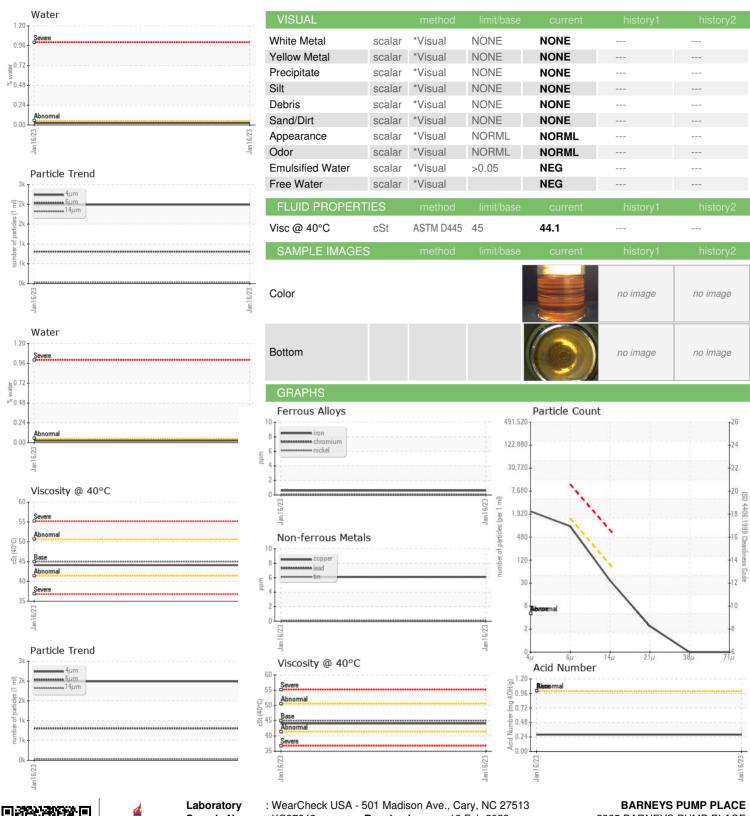





Certificate L2367

Sample No. Lab Number **Unique Number** Test Package

Received : 13 Feb 2023 : KC97043 : 05766606 Diagnosed : 15 Feb 2023 : 10336214 Diagnostician : Angela Borella : IND 2

2965 BARNEYS PUMP PLACE

LAKELAND, FL US 33812

Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: F: