




# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**

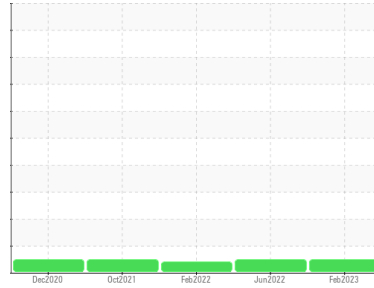

Machine Id  
**KAESER 7148725**

Component  
**Compressor**

Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KCP55924</b>	KCP41349	KCP41987
Sample Date	Client Info			<b>08 Feb 2023</b>	16 Jun 2022	22 Feb 2022
Machine Age	hrs	Client Info		<b>11940</b>	8353	6589
Oil Age	hrs	Client Info		<b>3587</b>	1764	1870
Oil Changed	Client Info			<b>Changed</b>	Not Changd	Changed
Sample Status				<b>NORMAL</b>	NORMAL	ATTENTION

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>0</b>	0	<1
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>10	<b>0</b>	<1	<1
Lead	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>50	<b>5</b>	1	2
Tin	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Antimony	ppm	ASTM D5185m		<b>---</b>	---	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	1	0
Barium	ppm	ASTM D5185m	90	<b>0</b>	25	6
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0	0
Manganese	ppm	ASTM D5185m		<b>0</b>	0	0
Magnesium	ppm	ASTM D5185m	90	<b>0</b>	63	76
Calcium	ppm	ASTM D5185m	2	<b>0</b>	1	0
Phosphorus	ppm	ASTM D5185m		<b>7</b>	3	2
Zinc	ppm	ASTM D5185m		<b>0</b>	5	0
Sulfur	ppm	ASTM D5185m		<b>22673</b>	19300	17060

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>1</b>	2	<1
Sodium	ppm	ASTM D5185m		<b>&lt;1</b>	14	10
Potassium	ppm	ASTM D5185m	>20	<b>0</b>	2	0
Water	%	ASTM D6304	>0.05	<b>0.007</b>	0.020	0.026
ppm Water	ppm	ASTM D6304	>500	<b>77.3</b>	201.7	264.7

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>2873</b>	4071	2925
Particles >6µm		ASTM D7647	>1300	<b>597</b>	930	964
Particles >14µm		ASTM D7647	>80	<b>14</b>	36	▲ 92
Particles >21µm		ASTM D7647	>20	<b>3</b>	6	15
Particles >38µm		ASTM D7647	>4	<b>1</b>	0	0
Particles >71µm		ASTM D7647	>3	<b>1</b>	0	0
Oil Cleanliness		ISO 4406 (c)	>--/17/13	<b>19/16/11</b>	19/17/12	▲ 17/14

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	<b>0.38</b>	0.40	0.42


# OIL ANALYSIS REPORT

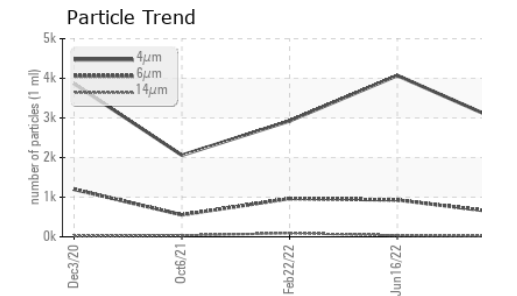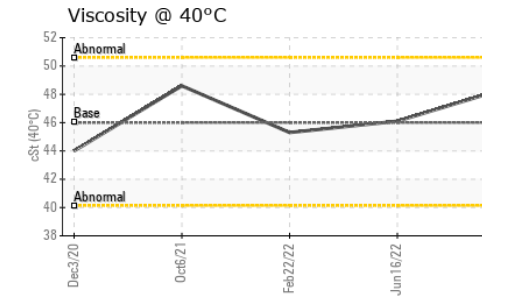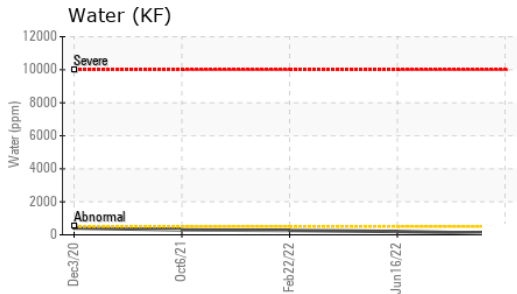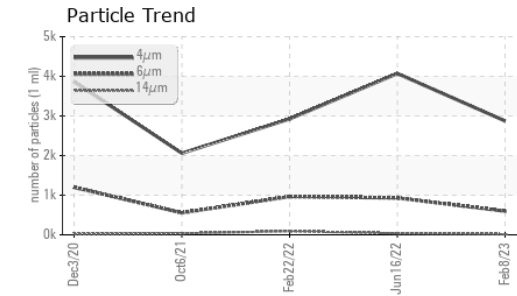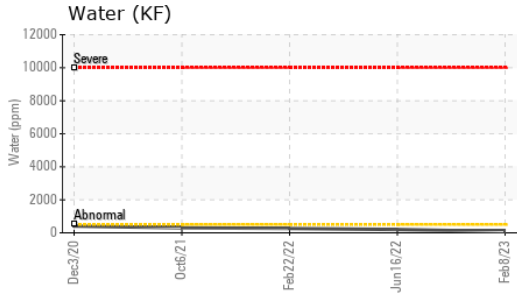




VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	46	48.4	46.1	45.3

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

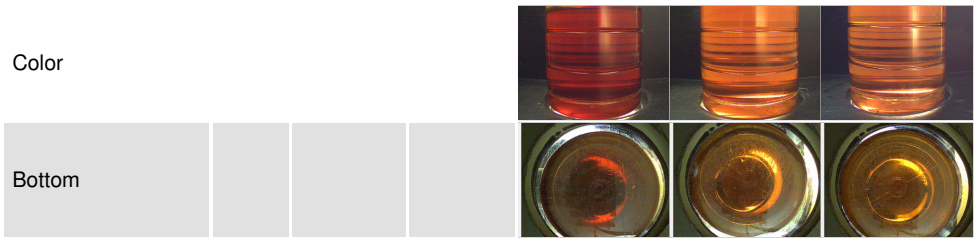

## GRAPHS

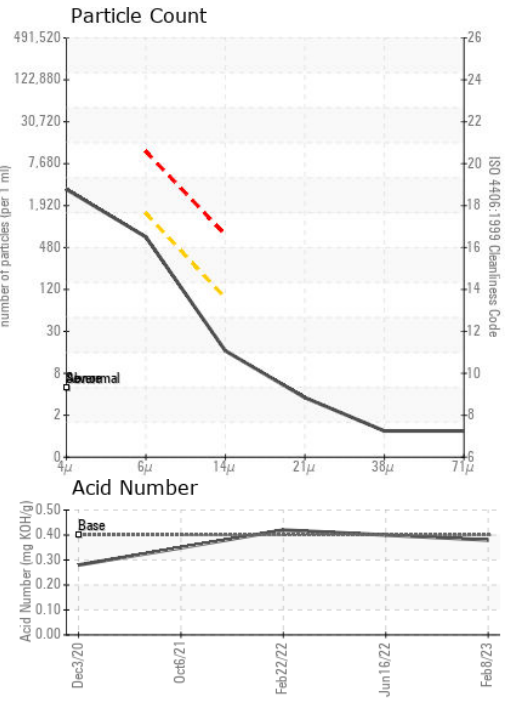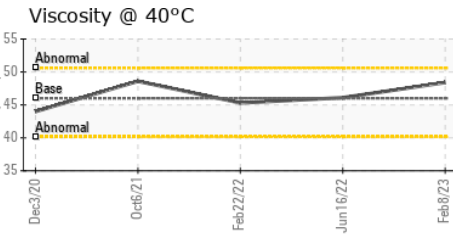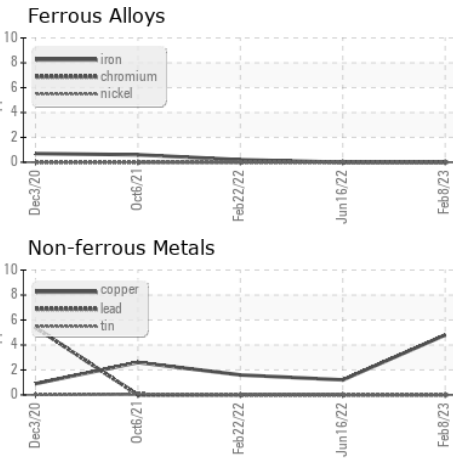

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCP55924 **Received** : 13 Feb 2023  
**Lab Number** : 05766624 **Diagnosed** : 15 Feb 2023  
**Unique Number** : 10336232 **Diagnostician** : Angela Borella  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**AMAZON**  
 4851 JONES SAUSAGE RD  
 GARNER, NC  
 US 27529  
 Contact: Service Manager  
 elzatracc@amazon.com

Certificate L2367  
 To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: