


PROBLEM SUMMARY

Sample Rating Trend



ADDITIVES

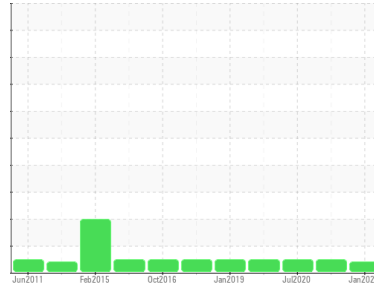


Machine Id
B303 (S/N 6412-04)

Component
Wind Turbine Gearbox

Fluid
MOBIL MOBILGEAR SHC XMP 320 (74 GAL)

COMPONENT CONDITION SUMMARY

▲ Additives

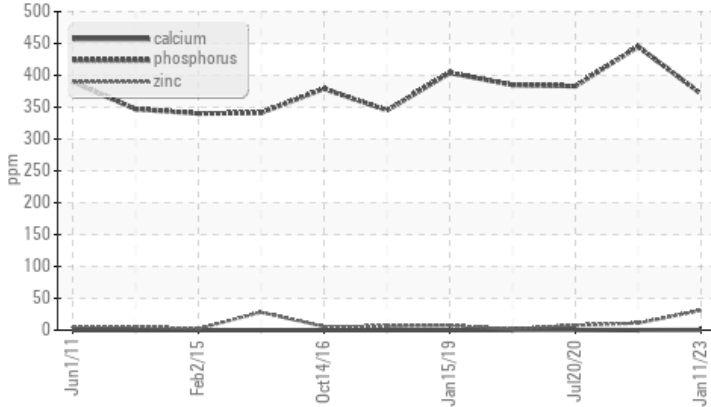

RECOMMENDATION

Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status				ATTENTION	NORMAL	NORMAL
Zinc	ppm	ASTM D5185m	0	▲ 31	11	8

Customer Id: DIADIL
Sample No.: MHI025172
Lab Number: 05767636
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Jonathan Hester +1 919-379-4092 x4092
jhester@wearcheckusa.com

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

12 Jan 2022 Diag: Don Baldrige

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



20 Jul 2020 Diag: Jonathan Hester

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. The water content is negligible. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



18 Dec 2019 Diag: Jonathan Hester

NORMAL




Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the component. The amount and size of particulates present in the system is acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



OIL ANALYSIS REPORT

Sample Rating Trend

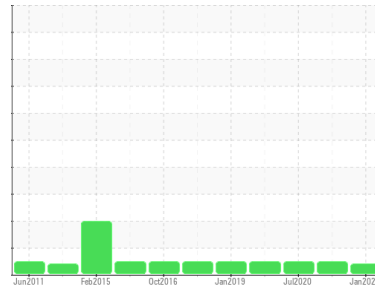

ADDITIVES



Machine Id
B303 (S/N 6412-04)

Component
Wind Turbine Gearbox

Fluid
MOBIL MOBILGEAR SHC XMP 320 (74 GAL)

DIAGNOSIS

▲ Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

▲ Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service. Zn level is elevated.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		MHI025172	MHI025288	MHI017441
Sample Date	Client Info		11 Jan 2023	12 Jan 2022	20 Jul 2020
Machine Age	hrs	Client Info	0	0	0
Oil Age	hrs	Client Info	86564	80645	74293
Oil Changed	Client Info		Not Chngd	Not Chngd	N/A
Sample Status			ATTENTION	NORMAL	NORMAL

WEAR METALS

	method	limit/base	current	history1	history2
PQ	ASTM D8184	>200	11	14	11
Iron	ppm	ASTM D5185m	>200	8	7
Chromium	ppm	ASTM D5185m	>3	0	0
Nickel	ppm	ASTM D5185m	>3	<1	0
Titanium	ppm	ASTM D5185m	>10	0	0
Silver	ppm	ASTM D5185m		0	<1
Aluminum	ppm	ASTM D5185m	>30	0	<1
Lead	ppm	ASTM D5185m	>15	<1	0
Copper	ppm	ASTM D5185m	>75	28	12
Tin	ppm	ASTM D5185m	>10	<1	<1
Antimony	ppm	ASTM D5185m	>5	---	0
Vanadium	ppm	ASTM D5185m		0	0
Cadmium	ppm	ASTM D5185m		0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	2
Barium	ppm	ASTM D5185m		0	0
Molybdenum	ppm	ASTM D5185m	0	0	<1
Manganese	ppm	ASTM D5185m		<1	<1
Magnesium	ppm	ASTM D5185m		1	0
Calcium	ppm	ASTM D5185m	0	<1	0
Phosphorus	ppm	ASTM D5185m	485	371	445
Zinc	ppm	ASTM D5185m	0	▲ 31	11
Sulfur	ppm	ASTM D5185m		3970	3861






CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>+30	0	0
Sodium	ppm	ASTM D5185m	>15	0	0
Potassium	ppm	ASTM D5185m	>20	<1	0
Water	%	ASTM D6304	>0.1	0.007	0.004
ppm Water	ppm	ASTM D6304	>1000	75.3	44.5

FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		278	323	147
Particles >6µm	ASTM D7647	>5000	84	105	71
Particles >14µm	ASTM D7647	>640	8	13	15
Particles >21µm	ASTM D7647	>160	2	4	7
Particles >38µm	ASTM D7647	>40	0	0	0
Particles >71µm	ASTM D7647	>10	0	0	0
Oil Cleanliness	ISO 4406 (c)	>--/19/16	15/14/10	16/14/11	14/13/11

OIL ANALYSIS REPORT

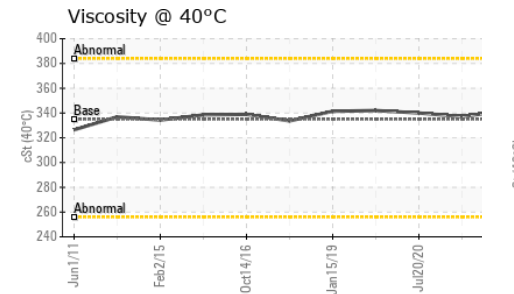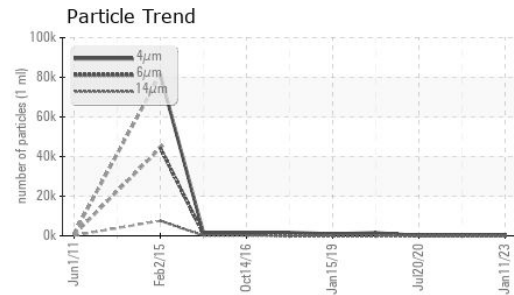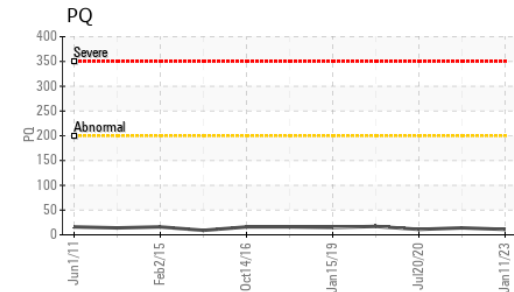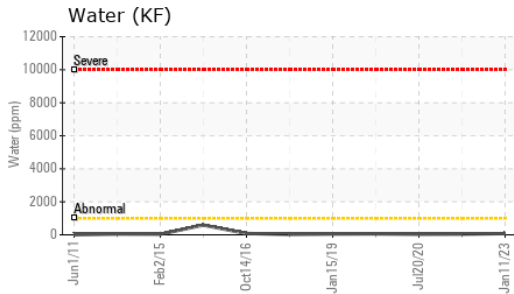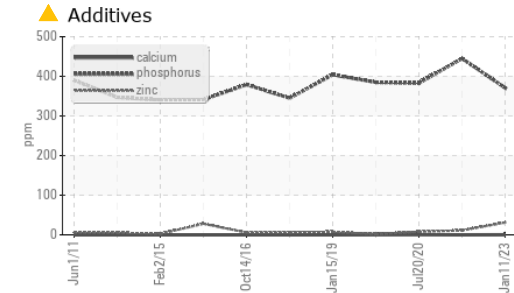


FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.85	1.31	1.40	1.326






VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	VLITE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	335	342	337	340

SAMPLE IMAGES

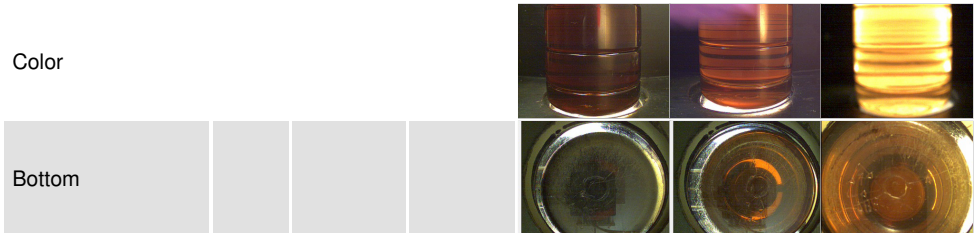

GRAPHS

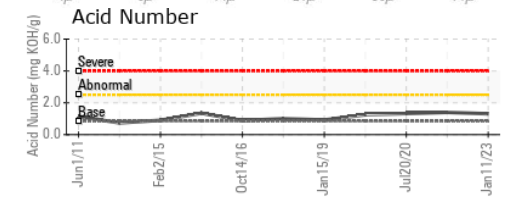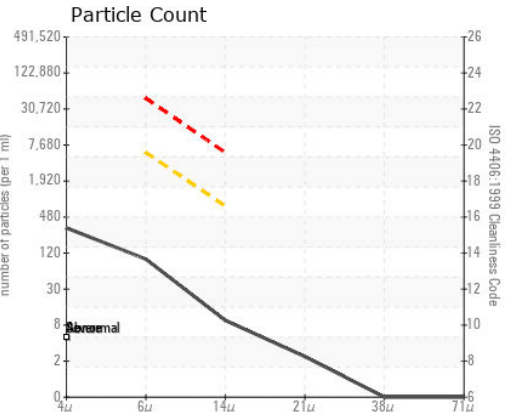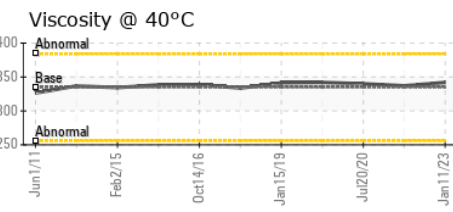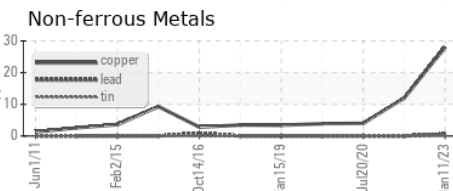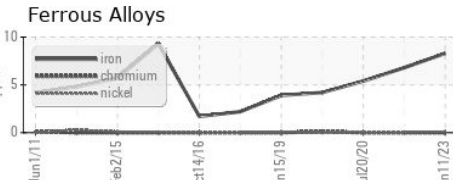

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : MHI025172 **Received** : 14 Feb 2023
Lab Number : 05767636 **Diagnosed** : 17 Feb 2023
Unique Number : 10337244 **Diagnostician** : Jonathan Hester
Test Package : IND 2 (Additional Tests: KF, PQ, PrtCount)

DIAMOND WTG - DILLON
P.O. BOX 880
DESERT HOT SPRINGS, CA
US 92240
Contact: DANIEL BOYD
daniel.boyd@diamondwtg.com
T: (760)329-7171
F: (760)329-7122

To discuss this sample report, contact Customer Service at 1-800-237-1369.
* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)