


# OIL ANALYSIS REPORT

## Sample Rating Trend



**NORMAL**

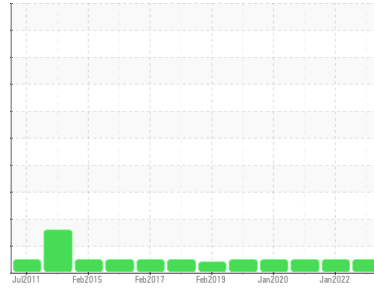

Machine Id  
**C303 (S/N 6413-01)**

Component  
**Wind Turbine Gearbox**

Fluid  
**MOBIL MOBILGEAR SHC XMP 320 (74 GAL)**

### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the component. The amount and size of particulates present in the system is acceptable.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>MHI026232</b>	MHI025272	MHI017370
Sample Date	Client Info			<b>26 Jan 2023</b>	21 Jan 2022	30 Dec 2020
Machine Age	hrs	Client Info		<b>0</b>	0	0
Oil Age	hrs	Client Info		<b>86529</b>	81001	74595
Oil Changed	Client Info			<b>Not Chngd</b>	Not Chngd	Not Chngd
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL






WEAR METALS		method	limit/base	current	history1	history2
PQ		ASTM D8184	>200	<b>13</b>	17	23
Iron	ppm	ASTM D5185m	>200	<b>23</b>	29	31
Chromium	ppm	ASTM D5185m	>3	<b>&lt;1</b>	<1	<1
Nickel	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Silver	ppm	ASTM D5185m		<b>0</b>	0	<1
Aluminum	ppm	ASTM D5185m	>30	<b>0</b>	0	0
Lead	ppm	ASTM D5185m	>15	<b>&lt;1</b>	0	0
Copper	ppm	ASTM D5185m	>75	<b>3</b>	2	1
Tin	ppm	ASTM D5185m	>10	<b>0</b>	<1	0
Antimony	ppm	ASTM D5185m	>5	<b>---</b>	0	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	<b>0</b>	2	<1
Barium	ppm	ASTM D5185m		<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	0	<b>&lt;1</b>	<1	<1
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	<1	<1
Magnesium	ppm	ASTM D5185m		<b>2</b>	0	0
Calcium	ppm	ASTM D5185m	0	<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185m	485	<b>371</b>	441	381
Zinc	ppm	ASTM D5185m	0	<b>21</b>	4	0
Sulfur	ppm	ASTM D5185m		<b>4543</b>	4039	3527

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>+30	<b>&lt;1</b>	<1	<1
Sodium	ppm	ASTM D5185m	>15	<b>0</b>	0	1
Potassium	ppm	ASTM D5185m	>20	<b>&lt;1</b>	<1	<1
Water	%	ASTM D6304	>0.1	<b>0.006</b>	0.005	0.002
ppm Water	ppm	ASTM D6304	>1000	<b>61.0</b>	51.3	21.6

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>725</b>	345	772
Particles >6µm		ASTM D7647	>5000	<b>198</b>	79	232
Particles >14µm		ASTM D7647	>640	<b>15</b>	7	44
Particles >21µm		ASTM D7647	>160	<b>4</b>	2	19
Particles >38µm		ASTM D7647	>40	<b>1</b>	0	1
Particles >71µm		ASTM D7647	>10	<b>0</b>	0	0
Oil Cleanliness		ISO 4406 (c)	>--/19/16	<b>17/15/11</b>	16/13/10	17/15/13

# OIL ANALYSIS REPORT

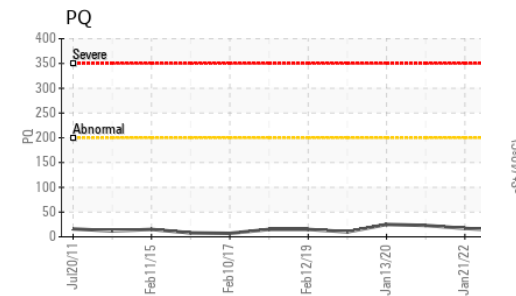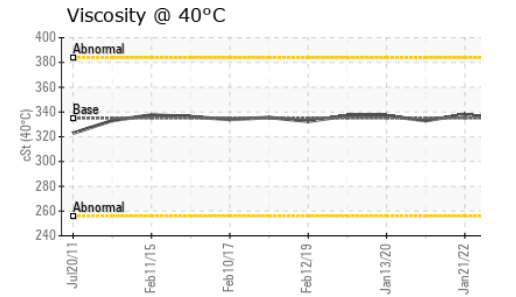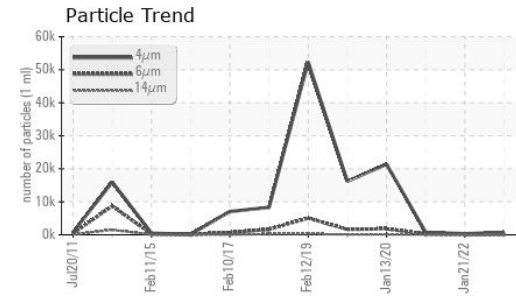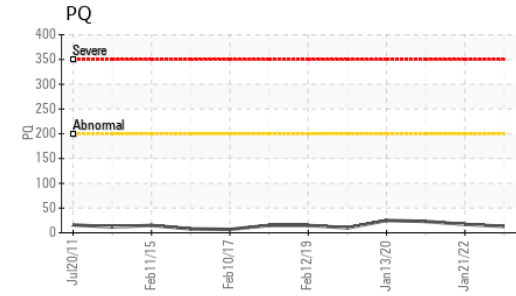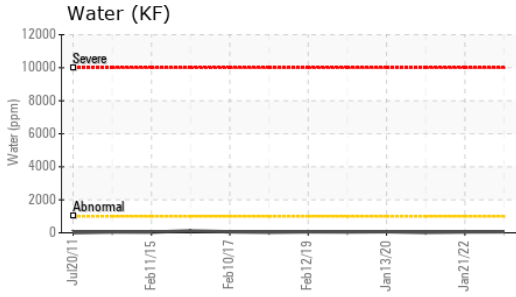


FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.85	<b>1.24</b>	1.30	0.804






VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	<b>NEG</b>	NEG	NEG
Free Water	scalar	*Visual		<b>NEG</b>	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	335	<b>334</b>	338	333

SAMPLE IMAGES		method	limit/base	current	history1	history2
---------------	--	--------	------------	---------	----------	----------

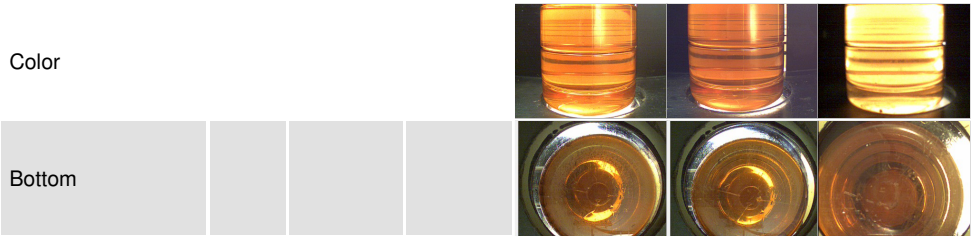

## GRAPHS

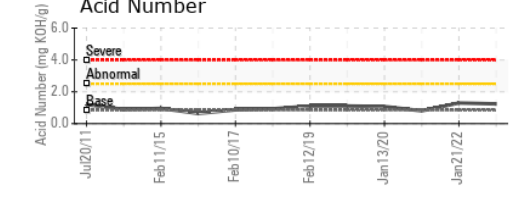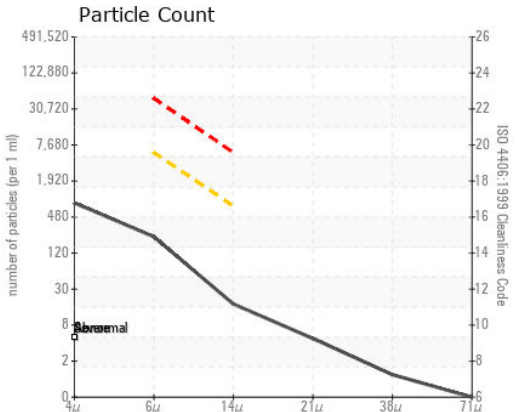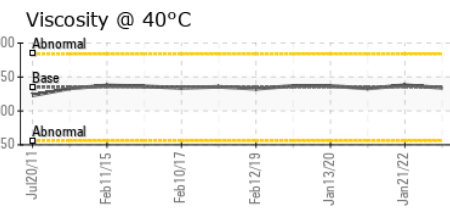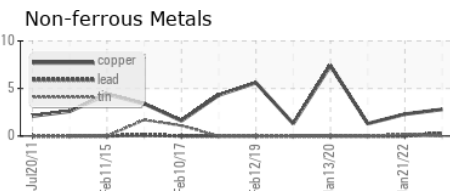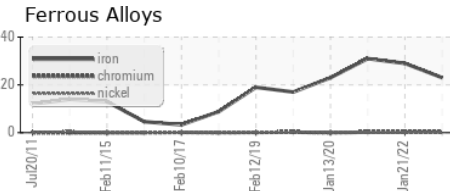

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : MH1026232 **Received** : 14 Feb 2023  
**Lab Number** : **05767637** **Diagnosed** : 16 Feb 2023  
**Unique Number** : 10337245 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: KF, PQ, PrtCount )

**DIAMOND WTG - DILLON**  
P.O. BOX 880  
DESERT HOT SPRINGS, CA  
US 92240  
Contact: DANIEL BOYD  
daniel.boyd@diamondwtg.com  
T: (760)329-7171  
F: (760)329-7122

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)