




OIL ANALYSIS REPORT

Sample Rating Trend

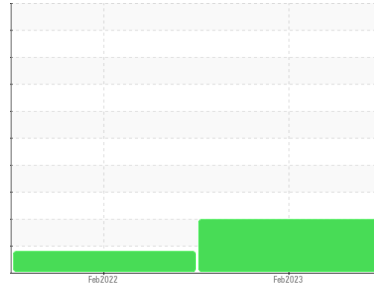

Machine Id
7319181 (S/N 1068)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation
 No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear
 All component wear rates are normal.

Contamination
 There is a high amount of particulates present in the oil.

Fluid Condition
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			KCP55886	KCP05505197	---
Sample Date	Client Info			10 Feb 2023	11 Feb 2022	---
Machine Age	hrs	Client Info		3947	1707	---
Oil Age	hrs	Client Info		2000	1707	---
Oil Changed	Client Info			Not Chngd	Changed	---
Sample Status				ABNORMAL	ATTENTION	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	<1	---
Chromium	ppm	ASTM D5185m	>10	0	0	---
Nickel	ppm	ASTM D5185m	>3	0	0	---
Titanium	ppm	ASTM D5185m	>3	0	0	---
Silver	ppm	ASTM D5185m	>2	0	0	---
Aluminum	ppm	ASTM D5185m	>10	<1	<1	---
Lead	ppm	ASTM D5185m	>10	<1	0	---
Copper	ppm	ASTM D5185m	>50	2	1	---
Tin	ppm	ASTM D5185m	>10	0	0	---
Vanadium	ppm	ASTM D5185m		0	0	---
Cadmium	ppm	ASTM D5185m		0	0	---






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	---
Barium	ppm	ASTM D5185m	90	3	<1	---
Molybdenum	ppm	ASTM D5185m		0	0	---
Manganese	ppm	ASTM D5185m		0	0	---
Magnesium	ppm	ASTM D5185m	90	61	83	---
Calcium	ppm	ASTM D5185m	2	1	<1	---
Phosphorus	ppm	ASTM D5185m		3	3	---
Zinc	ppm	ASTM D5185m		6	0	---
Sulfur	ppm	ASTM D5185m		20108	17227	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	1	<1	---
Sodium	ppm	ASTM D5185m		20	13	---
Potassium	ppm	ASTM D5185m	>20	6	10	---
Water	%	ASTM D6304	>0.05	0.016	0.020	---
ppm Water	ppm	ASTM D6304	>500	165.4	208.8	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		15238	4223	---
Particles >6µm		ASTM D7647	>1300	▲ 7509	945	---
Particles >14µm		ASTM D7647	>80	▲ 629	▲ 86	---
Particles >21µm		ASTM D7647	>20	▲ 95	▲ 23	---
Particles >38µm		ASTM D7647	>4	▲ 6	0	---
Particles >71µm		ASTM D7647	>3	1	0	---
Oil Cleanliness		ISO 4406 (c)	>--/17/13	▲ 21/20/16	▲ 17/14	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.32	0.37	---


OIL ANALYSIS REPORT

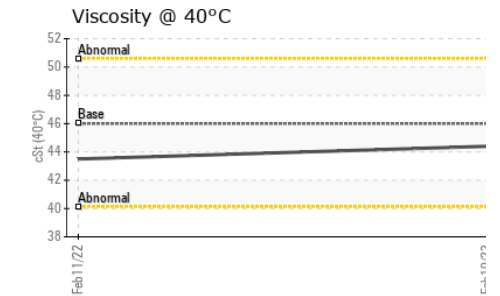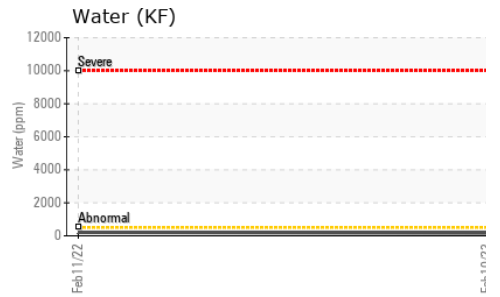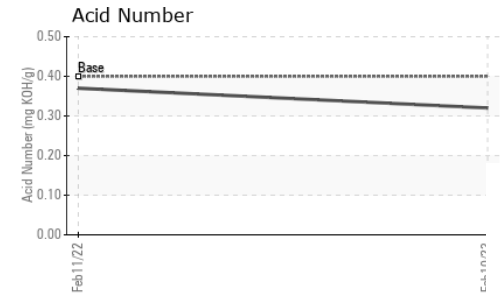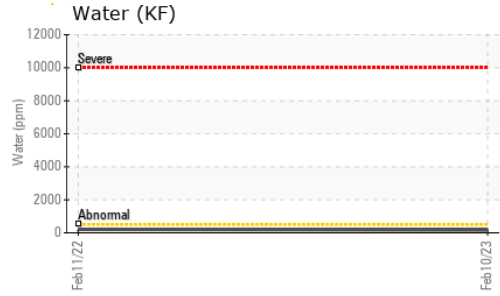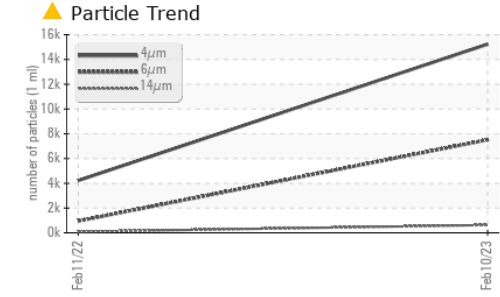






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	44.4	43.5

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

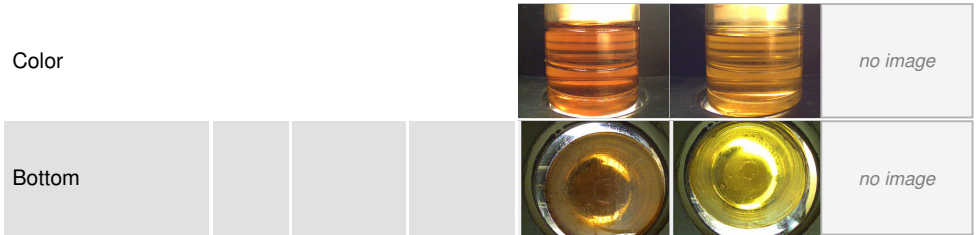

GRAPHS

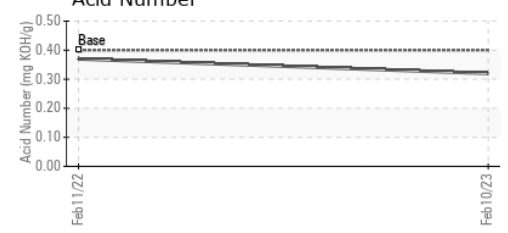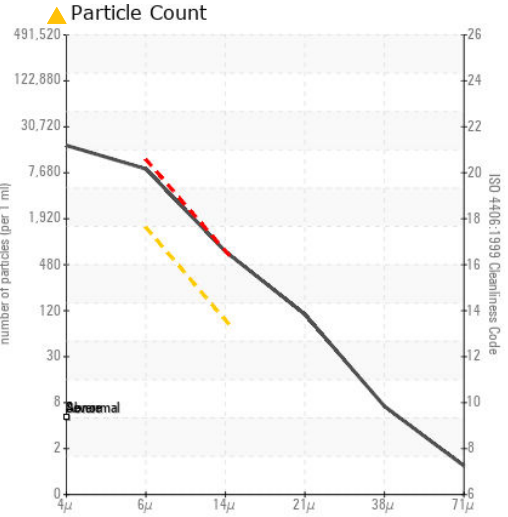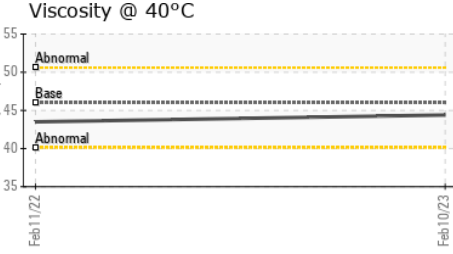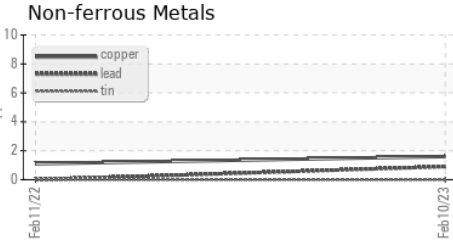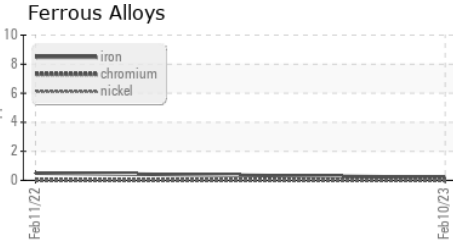

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCP55886 **Received** : 15 Feb 2023
Lab Number : 05768863 **Tested** : 16 Feb 2023
Unique Number : 10338471 **Diagnosed** : 17 Feb 2023 - Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)

LODGE MANUFACTURING COMPANY
 204 E 5TH ST
 SOUTH PITTSBURG, TN
 US 37380
 Contact: G. HEFFLEY
 gheffley@lodgecastiron.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)