




PROBLEM SUMMARY

Sample Rating Trend

WEAR




Machine Id
HT 05
Component
Agitator Gearbox
Fluid
NOT GIVEN (--- LTR)

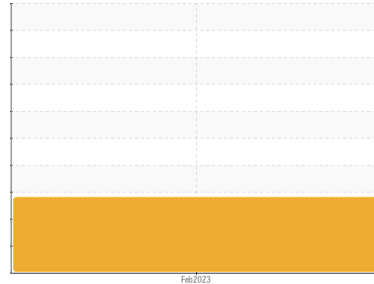


COMPONENT CONDITION SUMMARY

▲ Non-ferrous Metals

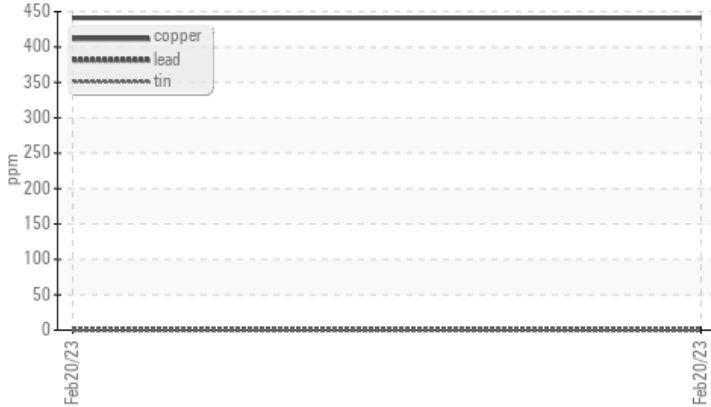

▲ Particle Trend

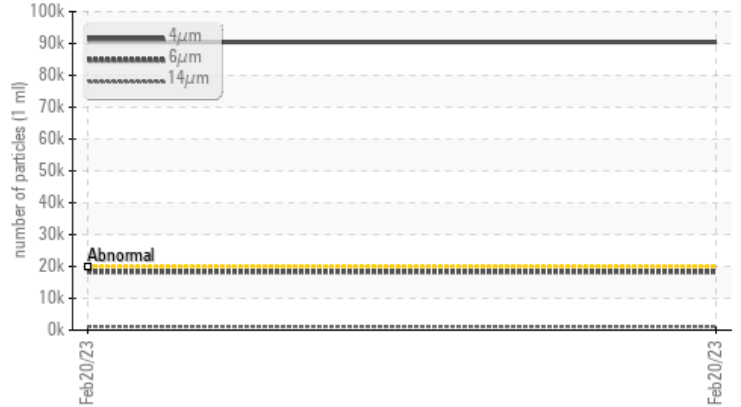

RECOMMENDATION

We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor. Please specify the brand and viscosity of the oil on your next sample.

PROBLEMATIC TEST RESULTS

Sample Status			ABNORMAL	---	---
Copper	ppm	ASTM D5185m >50	▲ 441	---	---
Particles >4µm		ASTM D7647 >20000	▲ 90446	---	---
Particles >6µm		ASTM D7647 >5000	▲ 18337	---	---
Particles >14µm		ASTM D7647 >640	▲ 1093	---	---
Particles >21µm		ASTM D7647 >160	▲ 316	---	---
Oil Cleanliness		ISO 4406 (c) >21/19/16	▲ 24/21/17	---	---

Customer Id: KRAMASIOW
Sample No.: USP247606
Lab Number: 05777503
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Doug Bogart +1 (800)237-1369 x4016
dougb@wearcheckusa.com

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS


Action	Status	Date	Done By	Description
Change Filter	---	---	?	We recommend you service the filters on this component if applicable.
Information Required	---	---	?	Please specify the brand, type, and viscosity of the oil on your next sample.
Other Action (see Note)	DONE	May 17 2023	?	No recommended actions

HISTORICAL DIAGNOSIS



OIL ANALYSIS REPORT

Sample Rating Trend

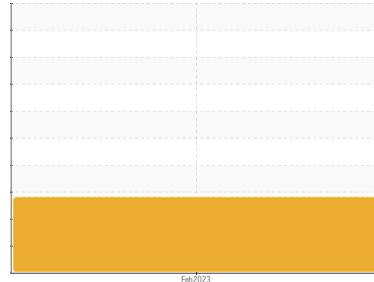

WEAR



Machine Id

HT 05

Component

Agitator Gearbox

Fluid

NOT GIVEN (--- LTR)

DIAGNOSIS

Recommendation

We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor. Please specify the brand and viscosity of the oil on your next sample.

Wear

The copper level is abnormal. All other component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	USP247606	---	---
Sample Date	Client Info	20 Feb 2023	---	---
Machine Age	yrs Client Info	0	---	---
Oil Age	yrs Client Info	27	---	---
Oil Changed	Client Info	N/A	---	---
Sample Status		ABNORMAL	---	---

WEAR METALS

method	limit/base	current	history1	history2
Iron ppm ASTM D5185m	>150	15	---	---
Chromium ppm ASTM D5185m	>10	<1	---	---
Nickel ppm ASTM D5185m	>10	0	---	---
Titanium ppm ASTM D5185m		0	---	---
Silver ppm ASTM D5185m		0	---	---
Aluminum ppm ASTM D5185m	>25	5	---	---
Lead ppm ASTM D5185m	>100	<1	---	---
Copper ppm ASTM D5185m	>50	▲ 441	---	---
Tin ppm ASTM D5185m	>10	0	---	---
Vanadium ppm ASTM D5185m		0	---	---
Cadmium ppm ASTM D5185m		0	---	---

ADDITIVES

method	limit/base	current	history1	history2
Boron ppm ASTM D5185m		76	---	---
Barium ppm ASTM D5185m		0	---	---
Molybdenum ppm ASTM D5185m		0	---	---
Manganese ppm ASTM D5185m		1	---	---
Magnesium ppm ASTM D5185m		0	---	---
Calcium ppm ASTM D5185m		2	---	---
Phosphorus ppm ASTM D5185m		1353	---	---
Zinc ppm ASTM D5185m		40	---	---
Sulfur ppm ASTM D5185m		20203	---	---

CONTAMINANTS

method	limit/base	current	history1	history2
Silicon ppm ASTM D5185m	>50	13	---	---
Sodium ppm ASTM D5185m		0	---	---
Potassium ppm ASTM D5185m	>20	<1	---	---
Water % ASTM D6304	>0.1	0.036	---	---
ppm Water ppm ASTM D6304	>1000	360.4	---	---

FLUID CLEANLINESS






method	limit/base	current	history1	history2
Particles >4µm ASTM D7647	>20000	▲ 90446	---	---
Particles >6µm ASTM D7647	>5000	▲ 18337	---	---
Particles >14µm ASTM D7647	>640	▲ 1093	---	---
Particles >21µm ASTM D7647	>160	▲ 316	---	---
Particles >38µm ASTM D7647	>40	16	---	---
Particles >71µm ASTM D7647	>10	1	---	---
Oil Cleanliness ISO 4406 (c)	>21/19/16	▲ 24/21/17	---	---

FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN) mg KOH/g ASTM D8045		3.10	---	---



OIL ANALYSIS REPORT

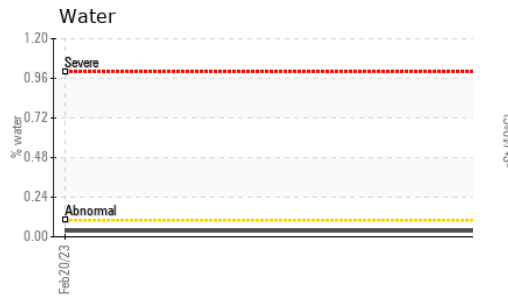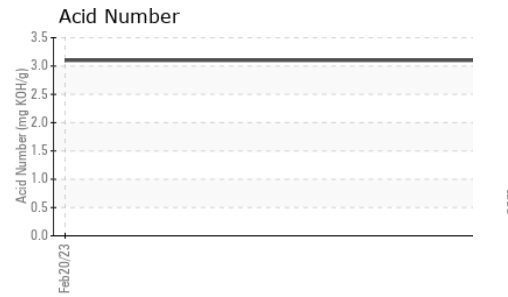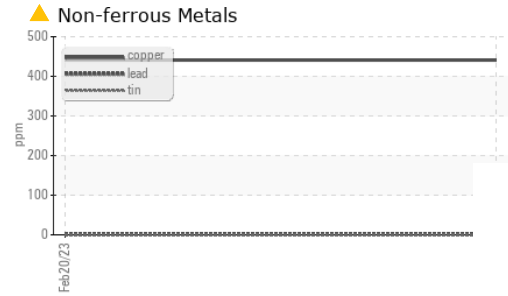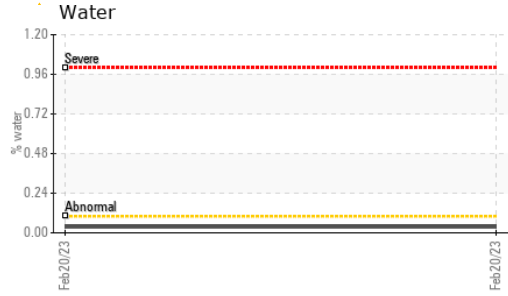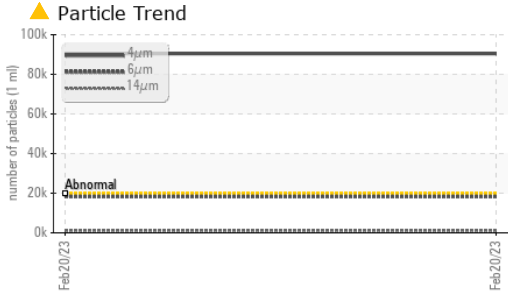






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	---	---
Precipitate	scalar	*Visual	NONE	---	---
Silt	scalar	*Visual	NONE	---	---
Debris	scalar	*Visual	NONE	---	---
Sand/Dirt	scalar	*Visual	NONE	---	---
Appearance	scalar	*Visual	NORML	---	---
Odor	scalar	*Visual	NORML	---	---
Emulsified Water	scalar	*Visual	>0.1	---	---
Free Water	scalar	*Visual	---	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	204	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color				no image	no image
Bottom				no image	no image

GRAPHS

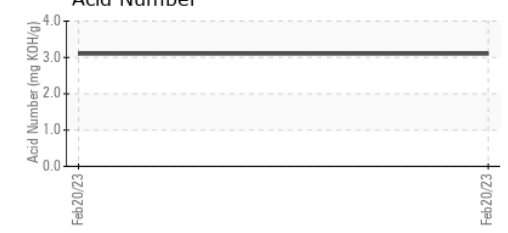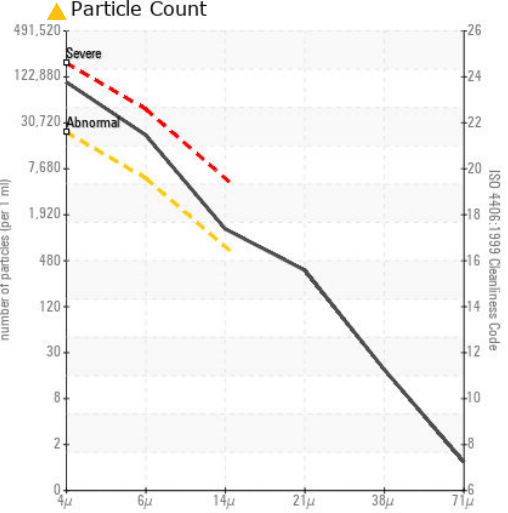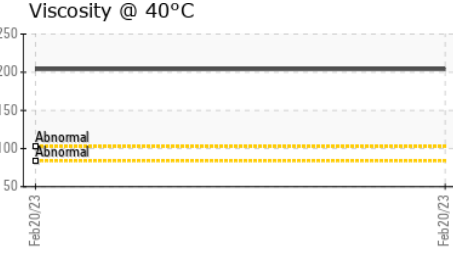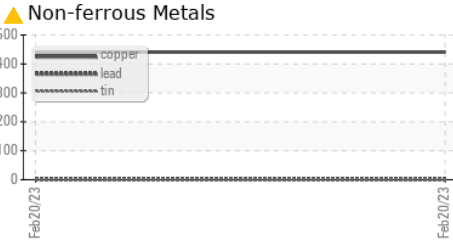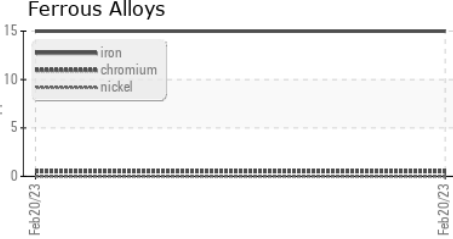

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : USP247606 **Received** : 27 Feb 2023
Lab Number : 05777503 **Diagnosed** : 28 Feb 2023
Unique Number : 10352120 **Diagnostician** : Doug Bogart
Test Package : IND 2

KraftHeinz - Mason City - Plant 8360
 1022 12TH ST
 MASON CITY, IA
 US 50401
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)