


### **PROBLEM SUMMARY**

# KAESER ASD 25 8070081 (S/N 1152)

Compressor

### KAESER SIGMA (OEM) S-460 (--- GAL)

### COMPONENT CONDITION SUMMARY

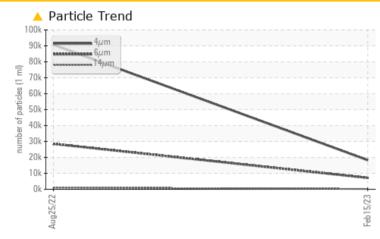

### RECOMMENDATION

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

### PROBLEMATIC TEST RESULTS

Sample Status		ABNORMAL	ABNORMAL	
Particles >6µm	ASTM D7647 >1300	<b>A</b> 7143	<u> </u>	
Particles >14µm	ASTM D7647 >80	🔺 162	1049	
Particles >21µm	ASTM D7647 >20	<u> </u>	<u> </u>	
Oil Cleanliness	ISO 4406 (c) >/17/13	3 🔺 21/20/15	🔺 24/22/17	


Customer Id: SMOMAC Sample No.: KC104399 Lab Number: 05777526 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data: Don Baldridge +1 don.b505@comcast.net

*To change component or sample information:* Customer Service +1 1-800-237-1369 <u>customerservice@wearcheck.com</u>

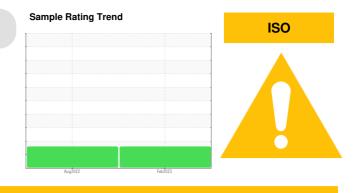

RECOMMENDED ACTIONS							
Action	Status	Date	Done By	Description			
Change Fluid			?	Oil and filter change at the time of sampling has been noted.			
Change Filter			?	Oil and filter change at the time of sampling has been noted.			

### HISTORICAL DIAGNOSIS



### 25 Aug 2022 Diag: Don Baldridge

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





### **OIL ANALYSIS REPORT**

## KAESER ASD 25 8070081 (S/N 1152)

**Compressor** Fluid

KAESER SIGMA (OEM) S-460 (--- GAL)

### DIAGNOSIS

#### Recommendation

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

### Wear


All component wear rates are normal.

### Contamination

There is a high amount of particulates present in the oil.

#### Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

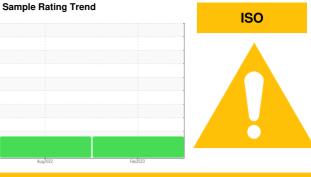


SAMPLE INFORM	<b>IATION</b>	method	limit/base	current	history1	history2
Sample Number		Client Info		KC104399	KC93078	
Sample Date		Client Info		15 Feb 2023	25 Aug 2022	
Machine Age	hrs	Client Info		4604	3077	
Oil Age	hrs	Client Info		1200	3077	
Oil Changed		Client Info		Changed	Changed	
Sample Status				ABNORMAL	ABNORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	1	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m	>3	0	0	
Titanium	ppm	ASTM D5185m	>3	0	0	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>10	<1	<1	
Lead	ppm	ASTM D5185m	>10	2	0	
Copper	ppm	ASTM D5185m		5	4	
Tin	ppm		>10	0	0	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	nnm	ASTM D5185m		0	0	
Barium	ppm	ASTM D5185m	90	25	0	
	ppm	ASTM D5185m	90	25	0	
Molybdenum	ppm			0	0	
Manganese	ppm	ASTM D5185m	00	-	44	
Magnesium	ppm	ASTM D5185m	90	72 0		
Calcium	ppm	ASTM D5185m	2		0	
Phosphorus	ppm	ASTM D5185m		4		
Zinc	ppm	ASTM D5185m		4	8	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	7	5	
Sodium	ppm	ASTM D5185m		27	15	
Potassium	ppm	ASTM D5185m	>20	7	4	
Water	%	ASTM D6304	>0.05	0.011	0.023	
ppm Water	ppm	ASTM D6304	>500	117.8	236.2	
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		18247	90729	
Particles >6µm		ASTM D7647	>1300	<u> </u>	<b>A</b> 28510	
Particles >14µm		ASTM D7647	>80	<u> </u>	<b>1</b> 049	
Particles >21µm		ASTM D7647	>20	<u> </u>	<u> </u>	
Particles >38µm		ASTM D7647	>4	1	0	
Particles >71µm		ASTM D7647	>3	0	0	
Oil Cleanliness		ISO 4406 (c)	>/17/13	<b>A</b> 21/20/15	<b>4</b> /22/17	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.30	0.34	




## **OIL ANALYSIS REPORT**





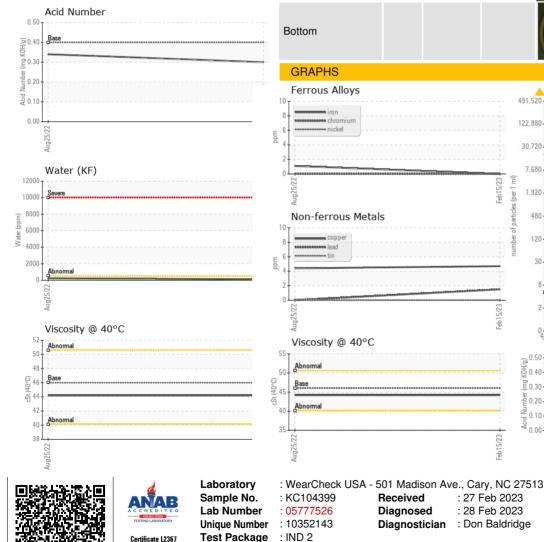

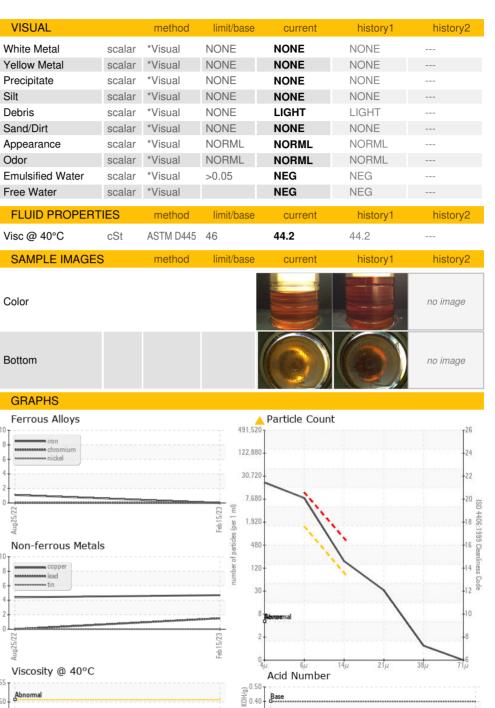

Ē 0.30

· 문 0.20

Acid

Feb15/23.

: 27 Feb 2023

: 28 Feb 2023

: Don Baldridge

0.10

0.00

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Abnorma

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Received

Diagnosed

Diagnostician

US 18062

Contact:

T:

F:

SMOOTH-ON

MACUNGIE, PA

-8

5600 LOWER MACUNGIE RD