

# **PROBLEM SUMMARY**

Sample Rating Trend

**ADDITIVES** 

Machine Id


# KAESER AS 30 8301641 (S/N 1882)


Component

Compressor

KAESER SIGMA (OEM) FG-460 (--- GAL)

## **COMPONENT CONDITION SUMMARY**

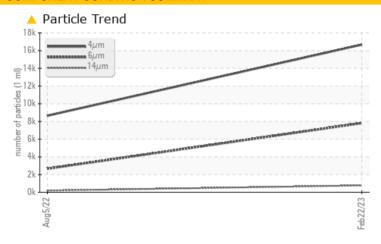

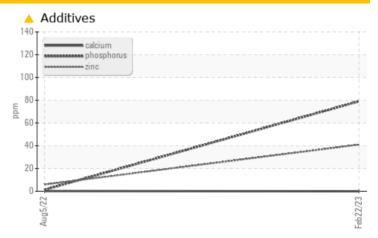

### RECOMMENDATION

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS								
Sample Status				ABNORMAL	ABNORMAL			
Phosphorus	ppm	ASTM D5185m	500	<b>^</b> 79	1			
Zinc	ppm	ASTM D5185m		<b>41</b>	6			
Sulfur	ppm	ASTM D5185m		<u></u> 5613	17421			
Particles >6µm		ASTM D7647	>1300	<b>7820</b>	<u>^</u> 2660			
Particles >14μm		ASTM D7647	>80	<b>^</b> 769	<u>▲</u> 186			
Particles >21µm		ASTM D7647	>20	<u> </u>	<u>^</u> 28			
Particles >38µm		ASTM D7647	>4	<u> </u>	0			
Oil Cleanliness		ISO 4406 (c)	>/17/13	<b>21/20/17</b>	20/19/15			

Customer Id: MENEDW Sample No.: KCP46216 Lab Number: 05778188 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data: Doug Bogart +1 (800)237-1369 x4016 dougb@wearcheckusa.com

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

RECOMMENDED ACTIONS							
Action	Status	Date	Done By	Description			
Change Fluid			?	Oil and filter change at the time of sampling has been noted.			
Change Filter			?	Oil and filter change at the time of sampling has been noted.			

## HISTORICAL DIAGNOSIS

05 Aug 2022 Diag: Doug Bogart





No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





# **OIL ANALYSIS REPORT**

Sample Rating Trend **ADDITIVES** 

# KAESER AS 30 8301641 (S/N 1882)

Compressor

KAESER SIGMA (OEM) FG-460 (--- GAL)

## **DIAGNOSIS**

#### Recommendation

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is a high amount of particulates present in the oil.

#### ▲ Fluid Condition

Additive levels indicate the addition of a different brand, or type of oil. Confirm oil type. The AN level is acceptable for this fluid.

			Aug <sup>2</sup> 022	Feb 2023		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCP46216	KCP48220	
Sample Date		Client Info		22 Feb 2023	05 Aug 2022	
Machine Age	hrs	Client Info		8122	3636	
Oil Age	hrs	Client Info		5000	3600	
Oil Changed		Client Info		Changed	Changed	
Sample Status				ABNORMAL	ABNORMAL	
WEAR METALS		method	limit/base	current	history1	history2
ron	ppm	ASTM D5185m	>50	0	<1	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m	>3	0	<1	
Γitanium	ppm	ASTM D5185m	>3	0	0	
Silver	ppm	ASTM D5185m	>2	0	<1	
Aluminum	ppm	ASTM D5185m	>10	3	1	
_ead	ppm	ASTM D5185m	>10	0	0	
Copper	ppm	ASTM D5185m	>50	2	7	
Гin	ppm	ASTM D5185m	>10	0	<1	
/anadium	ppm	ASTM D5185m	-	0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES	le le	method	limit/base	current	history1	history2
Boron	D 10 100	ASTM D5185m	III III DAGC		<1	
	ppm			0		
Barium Ashdadaan	ppm	ASTM D5185m		7	56	
Molybdenum	ppm	ASTM D5185m		0	0	
Manganese	ppm	ASTM D5185m		0	0	
Magnesium	ppm	ASTM D5185m		2	43	
Calcium	ppm	ASTM D5185m	=00	0	<1	
Phosphorus	ppm	ASTM D5185m	500	<u>^</u> 79	1	
Zinc	ppm	ASTM D5185m		<u>41</u>	6	
Sulfur	ppm	ASTM D5185m		<u>▲</u> 5613	17421	
CONTAMINANTS	i	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	4	
Sodium	ppm	ASTM D5185m		0	17	
Potassium	ppm	ASTM D5185m	>20	<1	18	
<i>N</i> ater	%	ASTM D6304	>0.05	0.006	0.022	
opm Water	ppm	ASTM D6304	>500	63.5	223.3	
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		16680	8654	
Particles >6µm		ASTM D7647	>1300	<b>△</b> 7820	<u>▲</u> 2660	
Particles >14µm		ASTM D7647	>80	<b>^</b> 769	<u> </u>	
Particles >21µm		ASTM D7647	>20	<u> </u>	<u>^</u> 28	
Particles >38µm		ASTM D7647	>4	<u> </u>	0	
Particles >71µm		ASTM D7647	>3	0	0	
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u>^</u> 21/20/17	<u>^</u> 20/19/15	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	ma KOH/a	<b>ASTM D8045</b>	1.5	0.33	0.29	

Acid Number (AN)


mg KOH/g ASTM D8045 1.5

0.33

0.29



## **OIL ANALYSIS REPORT**

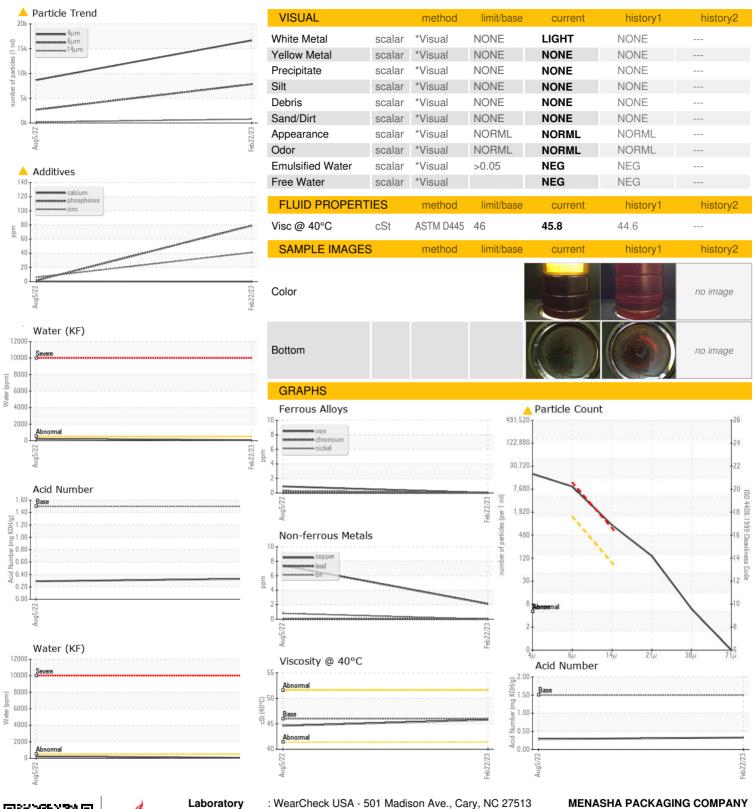



Laboratory Sample No. Lab Number **Unique Number** 

: KCP46216 : 05778188 : 10357858

Received

: 27 Feb 2023 Diagnosed : 28 Feb 2023

Diagnostician : Doug Bogart Test Package : IND 2 ( Additional Tests: KF, PrtCount )

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

9 GATEWAY COMMERCE CENTER DR E EDWARDSVILLE, IL

US 62025 Contact: A/P

ssc.ap@menasha.com

T:

F: Contact/Location: A/P ? - MENEDW