

OIL ANALYSIS REPORT

Sample Rating Trend



WATER



KAESER AIRCENTER SK 20 6191770 (S/N 1076)

Component

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

Recommendation

No corrective action is recommended at this time. We recommend an early resample in 500 hours to monitor this condition.

All component wear rates are normal.

Contamination

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil. There is a trace of moisture present in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Feb 201	9 Feb 2021	Feb 2022 J	an2023	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC101958	KC103186	KC73108
Sample Date		Client Info		26 Jan 2023	15 Feb 2022	22 Feb 2021
Machine Age	hrs	Client Info		8156	6386	4557
Oil Age	hrs	Client Info		1770	2929	1100
Oil Changed		Client Info		Not Changd	Changed	Not Changd
Sample Status				ATTENTION	ABNORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
ron	ppm	ASTM D5185m	>50	<1	<1	0
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	<1
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	<1	0
Aluminum	ppm	ASTM D5185m	>10	<1	<1	0
_ead	ppm	ASTM D5185m	>10	0	2	<1
Copper	ppm	ASTM D5185m	>50	7	12	2
Tin .	ppm	ASTM D5185m	>10	0	<1	0
Antimony	ppm	ASTM D5185m				0
√anadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	<1
Barium	ppm	ASTM D5185m	90	2	0	0
Molybdenum	ppm	ASTM D5185m		0	<1	0
Manganese	ppm	ASTM D5185m		0	<1	0
Magnesium	ppm	ASTM D5185m	90	48	51	75
Calcium	ppm	ASTM D5185m	2	<1	4	0
Phosphorus	ppm	ASTM D5185m		8	10	2
Zinc	ppm	ASTM D5185m		6	6	0
CONTAMINANTS	3	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	1	0
Sodium	ppm	ASTM D5185m		16	21	21
Potassium	ppm	ASTM D5185m	>20	3	4	2
Water	%	ASTM D6304	>0.05	<u> </u>	0.022	0.040
opm Water	ppm	ASTM D6304	>500	△ 618.3	226.8	404.9
FLUID CLEANLIN	NESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		14410	13110	59140
Particles >6µm		ASTM D7647	>1300	2019	4 084	<u>^</u> 29209
Particles >14µm		ASTM D7647	>80	39	1 14	<u>\$\text{\Delta}\$</u> 2543
Particles >21µm		ASTM D7647	>20	9	9	<u>^</u> 291
Particles >38μm		ASTM D7647	>4	0	0	3
Particles >71µm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	2 1/18/12	△ 19/14	<u>22/19</u>
FLUID DEGRADA	NOITA	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.31	0.35	0.337



OIL ANALYSIS REPORT

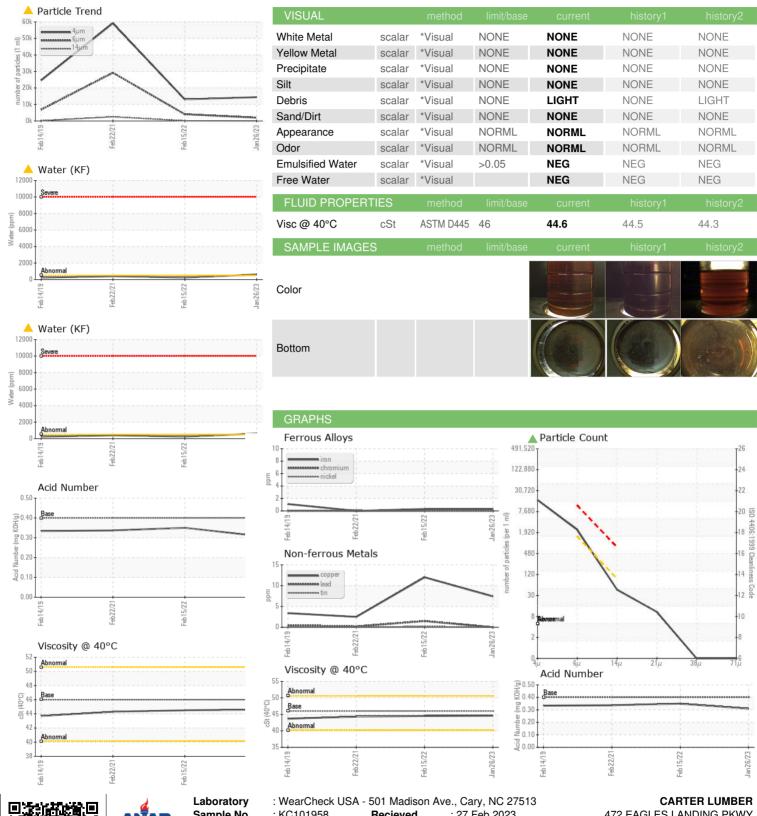





Certificate L2367

Sample No. Lab Number **Unique Number** Test Package

: KC101958 : 05778247

: 10357917 : IND 2

: 27 Feb 2023 Recieved Diagnosed : 01 Mar 2023 Diagnostician

: Don Baldridge

472 EAGLES LANDING PKWY STOCKBRIDGE, GA US 30281

Contact: JOSHUA BURKHOLDER joshua.burkholder@carterslumber.com

To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: F: