




OIL ANALYSIS REPORT

Sample Rating Trend

ISO



Area
Separation
 Machine Id
2325-B Evap (S/N lightning)
 Component
Agitator Gearbox
 Fluid
Mobilgear 629 (--- GAL)

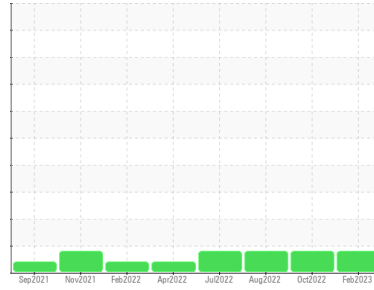

DIAGNOSIS

Recommendation
 No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear
 All component wear rates are normal.

Contamination
 There is a high amount of silt (particulates < 6 microns in size) present in the oil.

Fluid Condition
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0784164	WC0724714	WC0724707
Sample Date	Client Info		24 Feb 2023	13 Oct 2022	26 Aug 2022
Machine Age	hrs	Client Info	0	0	0
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			ABNORMAL	ABNORMAL	ABNORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >150	7	1	4
Chromium	ppm	ASTM D5185m >10	0	0	0
Nickel	ppm	ASTM D5185m >10	0	0	0
Titanium	ppm	ASTM D5185m	3	2	2
Silver	ppm	ASTM D5185m	0	0	<1
Aluminum	ppm	ASTM D5185m >25	<1	<1	<1
Lead	ppm	ASTM D5185m >100	0	2	0
Copper	ppm	ASTM D5185m >50	0	0	0
Tin	ppm	ASTM D5185m >10	0	<1	0
Vanadium	ppm	ASTM D5185m	0	<1	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	22	13	13
Barium	ppm	ASTM D5185m	9	0	5
Molybdenum	ppm	ASTM D5185m	<1	<1	<1
Manganese	ppm	ASTM D5185m	1	<1	<1
Magnesium	ppm	ASTM D5185m	11	6	0
Calcium	ppm	ASTM D5185m	13	0	8
Phosphorus	ppm	ASTM D5185m	332	352	344
Zinc	ppm	ASTM D5185m	28	0	4
Sulfur	ppm	ASTM D5185m	14229	14571	12374

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >50	3	1	1
Sodium	ppm	ASTM D5185m	0	1	<1
Potassium	ppm	ASTM D5185m >20	<1	3	0
Water	%	ASTM D6304 >0.1	0.011	0.009	0.014
ppm Water	ppm	ASTM D6304 >1000	111.2	97.7	147.5

FLUID CLEANLINESS






	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>20000	▲ 75615	▲ 51408	▲ 48208
Particles >6µm	ASTM D7647	>5000	4581	1613	1744
Particles >14µm	ASTM D7647	>640	46	22	40
Particles >21µm	ASTM D7647	>160	13	6	11
Particles >38µm	ASTM D7647	>40	0	0	1
Particles >71µm	ASTM D7647	>10	0	0	0
Oil Cleanliness	ISO 4406 (c)	>21/19/16	▲ 23/19/13	▲ 23/18/12	▲ 23/18/12

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.79	0.80	0.76




OIL ANALYSIS REPORT

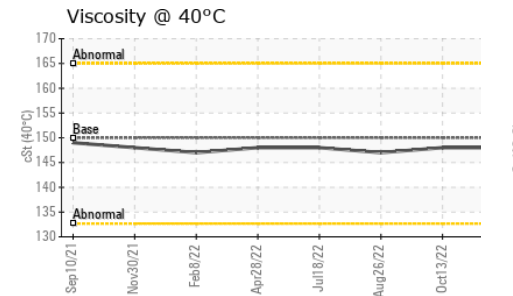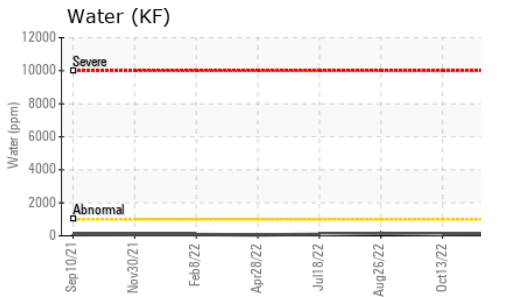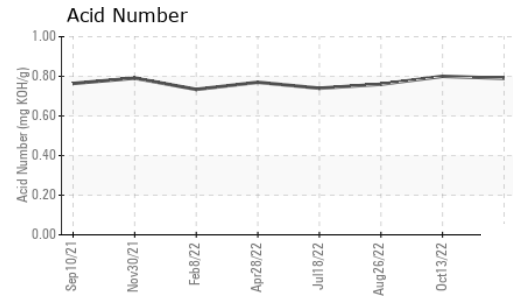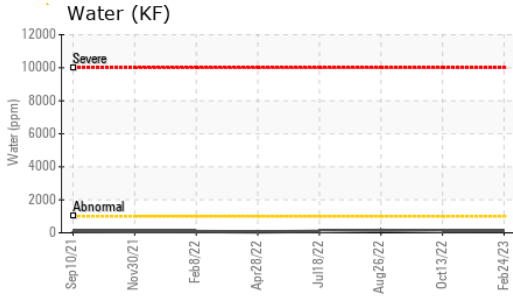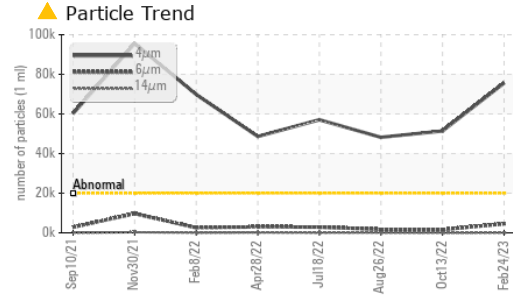






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	150	148	147

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

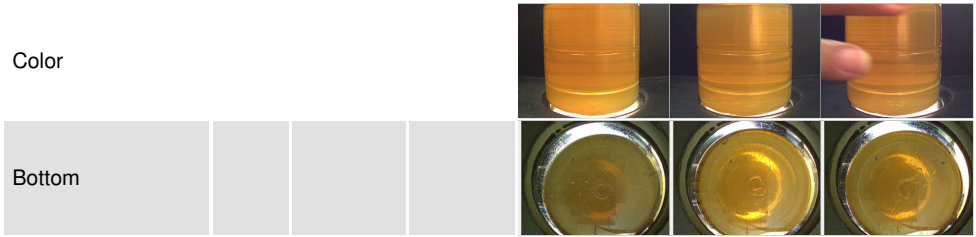

GRAPHS

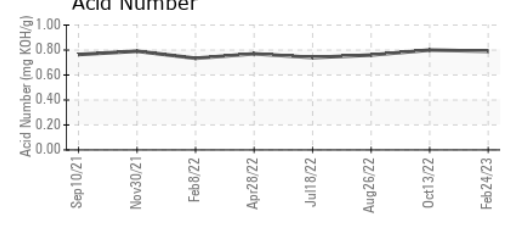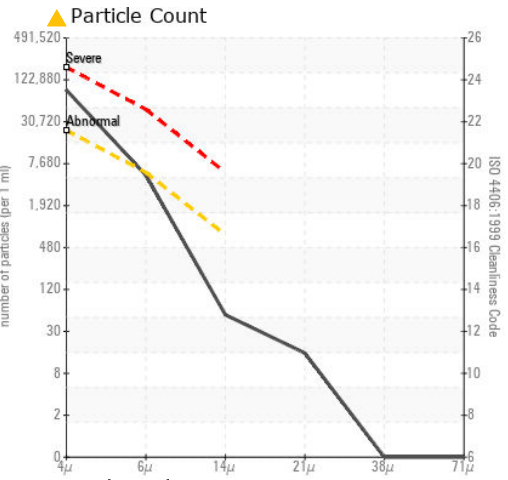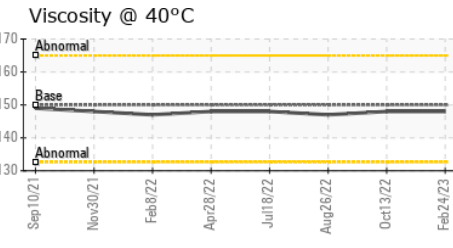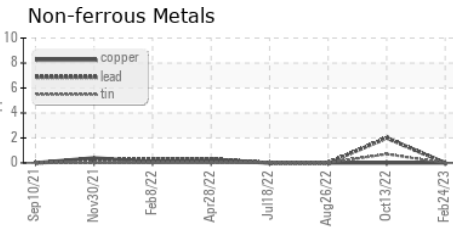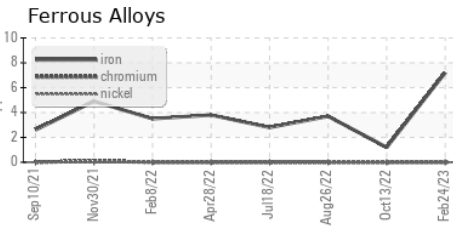

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0784164 **Received** : 28 Feb 2023
Lab Number : 05779462 **Diagnosed** : 01 Mar 2023
Unique Number : 10359132 **Diagnostician** : Doug Bogart
Test Package : PLANT

AJINOMOTO USA
 4020 AJINOMOTO DRIVE
 RALEIGH, NC
 US 27610
 Contact: BRENT FORSYTHE
 FORSYTHEB@AJIUSA.COM
 T:
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)