

# **OIL ANALYSIS REPORT**

Sample Rating Trend



TRANE 1151 STS BD 39 CH 1 (S/N L15J04686)

**Refrigeration Compressor** 

**TRANE 0022 (10 GAL)** 

## Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the

## Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

	Feb. 2023					
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WC0783450		
Sample Date		Client Info		18 Feb 2023		
Machine Age	hrs	Client Info		28937		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	1		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m		0		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>10	<1		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm	ASTM D5185m	>50	0		
Tin	ppm	ASTM D5185m	>10	2		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m		3		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		1		
Magnesium	ppm	ASTM D5185m		9		
Calcium	ppm	ASTM D5185m		<1		
Phosphorus	ppm	ASTM D5185m		<1		
Zinc	ppm	ASTM D5185m		23		
Sulfur	ppm	ASTM D5185m		0		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	4		
Sodium	ppm	ASTM D5185m		0		
Potassium	ppm	ASTM D5185m	>20	0		
Water	%	ASTM D6304	>0.01	0.002		
ppm Water	ppm	ASTM D6304	>100	18.1		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2


Acid Number (AN)

mg KOH/g ASTM D974

0.077



# **OIL ANALYSIS REPORT**

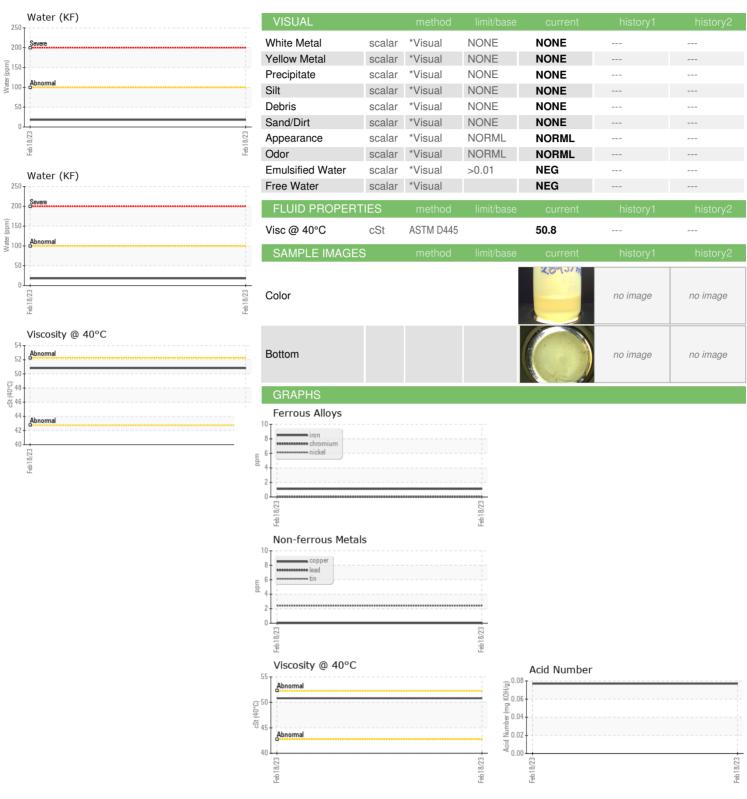





Certificate L2367

Laboratory Sample No. Lab Number Unique Number

: WC0783450 : 05779555 : 10359225 Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513

Diagnosed Diagnostician

: 28 Feb 2023 Recieved : 02 Mar 2023 : Jonathan Hester

**DAIKIN APPLIED** 5021 HOWERTON WAY SUITE P BOWIE, MD US 20715

Contact: ANDREW TURLINGTON andrew.turlington@daikinapplied.com

T: (301)735-1440 F: (301)735-1838

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)