



OIL ANALYSIS REPORT

Sample Rating Trend

VISCOSITY



Area

[SV2208310569]

Machine Id


MCQUAY NORTHROP GRUMMAN CENTRAL SCENIC BLDG (S/N STNU041200026)

Component

Refrigeration Compressor

Fluid

EMKARATE RL 32H (12 GAL)

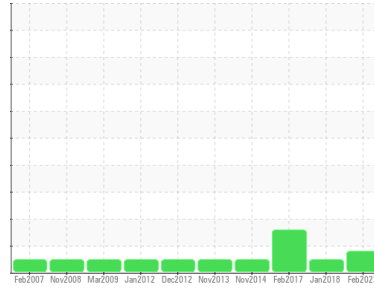

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

Additive levels indicate the addition of a different brand, or type of oil. Viscosity of sample indicates oil is within ISO 46 range, advise investigate. Confirm oil type. The AN level is acceptable for this fluid.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0384581	WCI2277773	WCI2260054
Sample Date	Client Info		27 Feb 2023	12 Jan 2018	17 Feb 2017
Machine Age	hrs	Client Info	36000	86120	78270
Oil Age	hrs	Client Info	0	86120	78270
Oil Changed	Client Info		Not Chngd	N/A	Not Chngd
Sample Status			ATTENTION	NORMAL	MARGINAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >100	1	2	4
Chromium	ppm	ASTM D5185m >10	0	0	0
Nickel	ppm	ASTM D5185m	0	0	0
Titanium	ppm	ASTM D5185m	0	0	0
Silver	ppm	ASTM D5185m	0	0	0
Aluminum	ppm	ASTM D5185m >50	0	1	<1
Lead	ppm	ASTM D5185m >10	0	3	1
Copper	ppm	ASTM D5185m >100	4	16	20
Tin	ppm	ASTM D5185m >10	<1	0	1
Antimony	ppm	ASTM D5185m	---	0	0
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	0	0	<1
Barium	ppm	ASTM D5185m 0	0	0	0
Molybdenum	ppm	ASTM D5185m 0	0	0	0
Manganese	ppm	ASTM D5185m	<1	0	<1
Magnesium	ppm	ASTM D5185m 0	2	0	0
Calcium	ppm	ASTM D5185m 0	0	0	0
Phosphorus	ppm	ASTM D5185m 5	▲ 1964	0	5
Zinc	ppm	ASTM D5185m 10	0	5	11
Sulfur	ppm	ASTM D5185m 50	0	0	35

CONTAMINANTS





	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >50	2	8	11
Sodium	ppm	ASTM D5185m	1	0	1
Potassium	ppm	ASTM D5185m >20	0	0	0
Water	%	ASTM D6304 >0.02	0.012	0.005	▲ 0.030
ppm Water	ppm	ASTM D6304 >250	128.1	50	▲ 300

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974 .05	0.056	0.030	0.047



OIL ANALYSIS REPORT

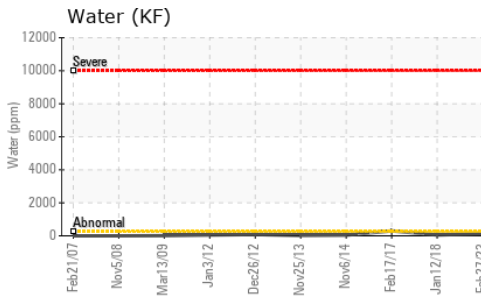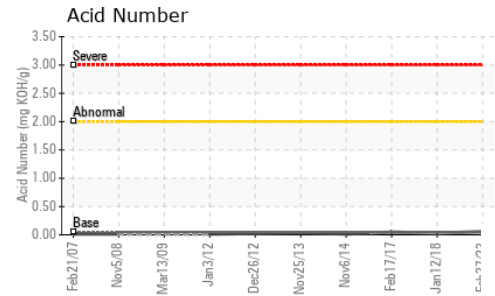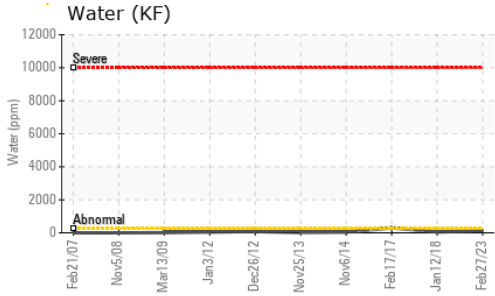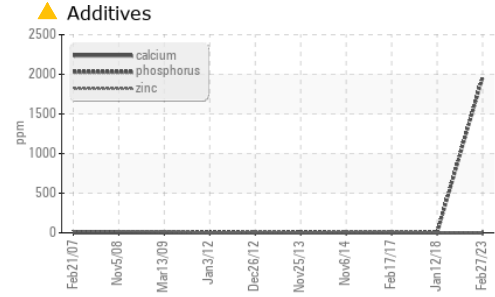





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.02	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	31.5 ▲ 38.1	32.47	30.62

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------



GRAPHS

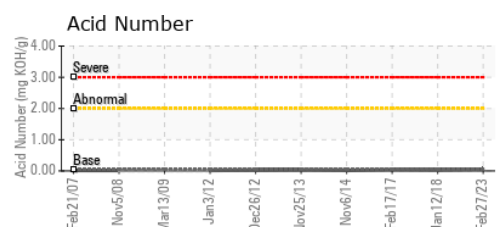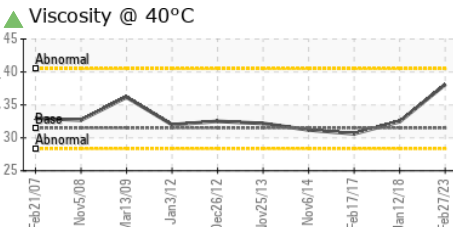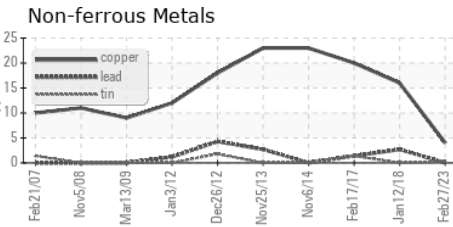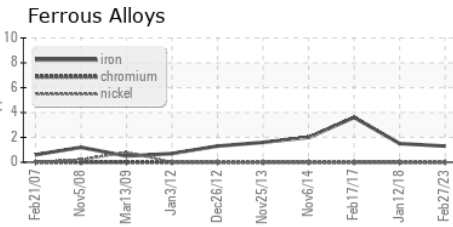

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0384581 **Received** : 01 Mar 2023
Lab Number : 05780183 **Tested** : 06 Mar 2023
Unique Number : 10359853 **Diagnosed** : 06 Mar 2023 - Jonathan Hester
Test Package : IND 2

DAIKIN APPLIED
 5021 HOWERTON WAY SUITE P
 BOWIE, MD
 US 20715
 Contact: MARK WARRINGTON
 mark.warrington@daikinapplied.com; dougb@wearcheckusa.com
 T: (301)805-9800
 F: (301)805-9806

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)