




# OIL ANALYSIS REPORT

Sample Rating Trend

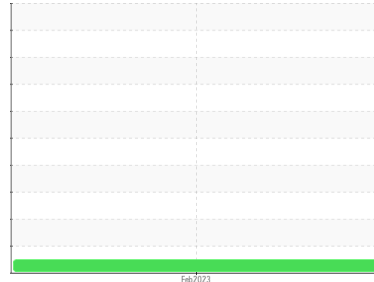

**NORMAL**



Machine Id  
**35147**

Component  
**Diesel Engine**

Fluid  
**DIESEL ENGINE OIL SAE 40 (--- QTS)**

## DIAGNOSIS

### Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>KLM2339298</b>	---	---
Sample Date	Client Info	<b>12 Feb 2023</b>	---	---
Machine Age	mls Client Info	<b>154402</b>	---	---
Oil Age	mls Client Info	<b>53977</b>	---	---
Oil Changed	Client Info	<b>N/A</b>	---	---
Sample Status		<b>NORMAL</b>	---	---

## CONTAMINATION

method	limit/base	current	history1	history2
Fuel	WC Method >5	<b>&lt;1.0</b>	---	---
Glycol	WC Method	<b>NEG</b>	---	---

## WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm ASTM D5185m >100	<b>11</b>	---	---
Chromium	ppm ASTM D5185m >20	<b>2</b>	---	---
Nickel	ppm ASTM D5185m >4	<b>0</b>	---	---
Titanium	ppm ASTM D5185m	<b>&lt;1</b>	---	---
Silver	ppm ASTM D5185m >3	<b>0</b>	---	---
Aluminum	ppm ASTM D5185m >20	<b>4</b>	---	---
Lead	ppm ASTM D5185m >40	<b>&lt;1</b>	---	---
Copper	ppm ASTM D5185m >330	<b>5</b>	---	---
Tin	ppm ASTM D5185m >15	<b>0</b>	---	---
Vanadium	ppm ASTM D5185m	<b>0</b>	---	---
Cadmium	ppm ASTM D5185m	<b>0</b>	---	---

## ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185m 250	<b>43</b>	---	---
Barium	ppm ASTM D5185m 10	<b>0</b>	---	---
Molybdenum	ppm ASTM D5185m 100	<b>49</b>	---	---
Manganese	ppm ASTM D5185m	<b>1</b>	---	---
Magnesium	ppm ASTM D5185m 450	<b>896</b>	---	---
Calcium	ppm ASTM D5185m 3000	<b>1348</b>	---	---
Phosphorus	ppm ASTM D5185m 1150	<b>970</b>	---	---
Zinc	ppm ASTM D5185m 1350	<b>1313</b>	---	---
Sulfur	ppm ASTM D5185m 4250	<b>3867</b>	---	---

## CONTAMINANTS





method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185m >25	<b>6</b>	---	---
Sodium	ppm ASTM D5185m >216	<b>4</b>	---	---
Potassium	ppm ASTM D5185m >20	<b>7</b>	---	---

## INFRA-RED

method	limit/base	current	history1	history2
Soot %	% *ASTM D7844 >3	<b>0.4</b>	---	---
Nitration	Abs/cm *ASTM D7624 >20	<b>8.1</b>	---	---
Sulfation	Abs./1mm *ASTM D7415 >30	<b>20.7</b>	---	---



# OIL ANALYSIS REPORT

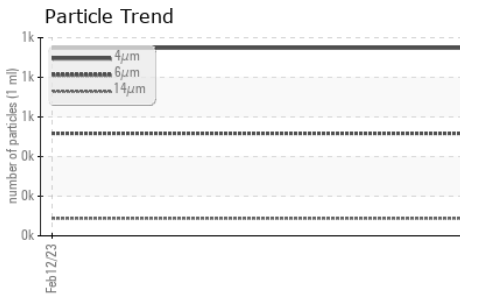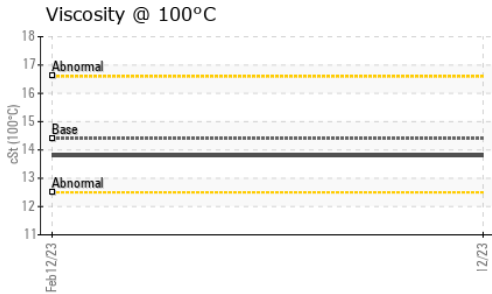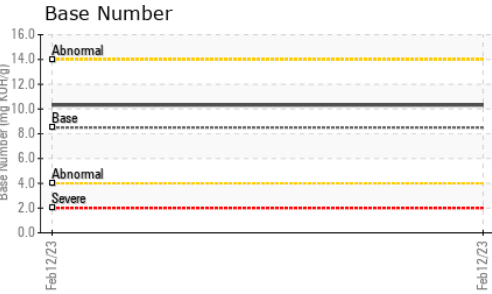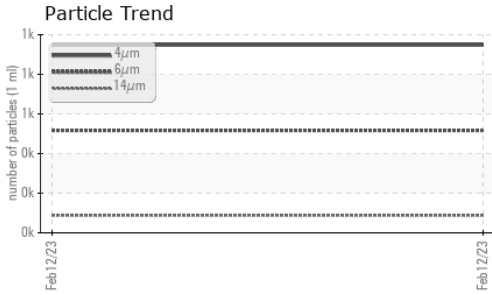






FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>948</b>	---	---
Particles >6µm	ASTM D7647	>5000	<b>517</b>	---	---
Particles >14µm	ASTM D7647	>640	<b>88</b>	---	---
Particles >21µm	ASTM D7647	>160	<b>30</b>	---	---
Particles >38µm	ASTM D7647	>40	<b>5</b>	---	---
Particles >71µm	ASTM D7647	>10	<b>0</b>	---	---
Oil Cleanliness	ISO 4406 (c)	>19/16	<b>16/14</b>	---	---

FLUID DEGRADATION	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm *ASTM D7414	>25	<b>15.6</b>	---	---
Base Number (BN)	mg KOH/g ASTM D2896	8.5	<b>10.32</b>	---	---

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar *Visual	NONE	<b>NONE</b>	---	---
Yellow Metal	scalar *Visual	NONE	<b>NONE</b>	---	---
Precipitate	scalar *Visual	NONE	<b>NONE</b>	---	---
Silt	scalar *Visual	NONE	<b>NONE</b>	---	---
Debris	scalar *Visual	NONE	<b>NONE</b>	---	---
Sand/Dirt	scalar *Visual	NONE	<b>NONE</b>	---	---
Appearance	scalar *Visual	NORML	<b>NORML</b>	---	---
Odor	scalar *Visual	NORML	<b>NORML</b>	---	---
Emulsified Water	scalar *Visual	>0.2	<b>NEG</b>	---	---
Free Water	scalar *Visual		<b>NEG</b>	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt ASTM D445	14.4	<b>13.8</b>	---	---

## GRAPHS

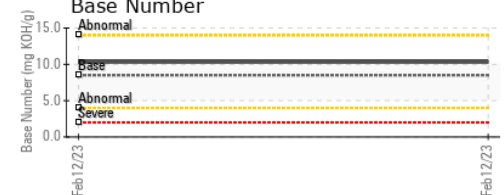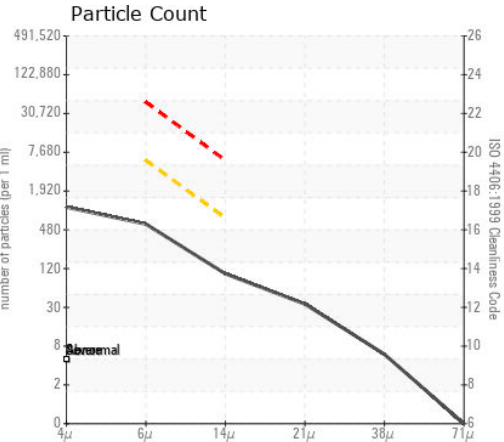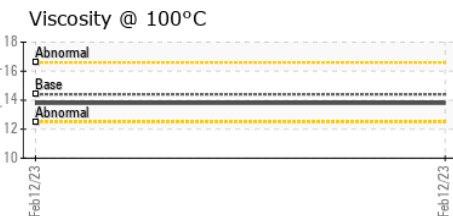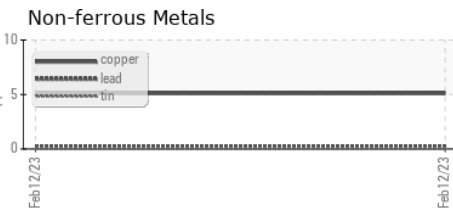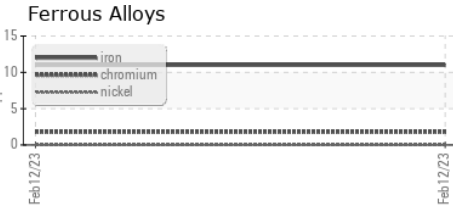

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KLM2339298 **Received** : 02 Mar 2023  
**Lab Number** : **05782006** **Diagnosed** : 04 Mar 2023  
**Unique Number** : 10361676 **Diagnostician** : Doug Bogart  
**Test Package** : MOB 2 ( Additional Tests: PrtCount )

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

**CITY & COUNTY HONOLULU**  
 99-999 IWAENA RD  
 AIEA, HI  
 US 96701  
 Contact: CLYDE OMIJA  
 comija@honolulu.gov  
 T: (575)623-9952  
 F: