

No relevant graphs to display

RECOMMENDATION

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample.

PROBLEMATIC TEST RESULTS							
Sample Status				ABNORMAL	NORMAL	NORMAL	
Debris	scalar	*Visual	NONE	A MODER	LIGHT	VLITE	

Customer Id: SCOWOO Sample No.: KC101396 Lab Number: 05783200 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data: Angela Borella +1 800-237-1369 angela.borella@wearcheckusa.com

To change component or sample information: Customer Service +1 1-800-237-1369 <u>customerservice@wearcheck.com</u>

RECOMMENDED ACTIONS								
Action	Status	Date	Done By	Description				
Change Fluid			?	Oil and filter change at the time of sampling has been noted.				
Change Filter			?	Oil and filter change at the time of sampling has been noted.				
Alert			?	We were unable to perform a particle count due to a high concentration of particles present in this sample.				

HISTORICAL DIAGNOSIS



NORMAL

13 May 2022 Diag: Don Baldridge

Resample at the next service interval to monitor.All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



view report

22 Sep 2021 Diag: Doug Bogart



No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

08 Apr 2021 Diag: Angela Borella



Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.All component wear rates are normal. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





OIL ANALYSIS REPORT

KAESER SFC 37 6754036 (S/N 1155)

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample.

Wear


All component wear rates are normal.

Contamination

Moderate concentration of visible dirt/debris present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

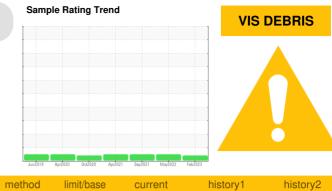


		Jun2019	Apr2020 Oct2020	Apr2021 Sep2021 May2022	Feb2023	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC101396	KC97214	KC92968
Sample Date		Client Info		27 Feb 2023	13 May 2022	22 Sep 2021
Machine Age	hrs	Client Info		25400	20480	16472
Oil Age	hrs	Client Info		4900	4008	3083
Oil Changed		Client Info		Changed	Changed	Not Changd
Sample Status				ABNORMAL	NORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	1	2
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	<1	0	0
Silver	ppm	ASTM D5185m	>2	0	<1	0
Aluminum	ppm	ASTM D5185m	>10	1	<1	<1
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	2	4	6
Tin	ppm	ASTM D5185m	>10	0	0	0
Antimony	ppm	ASTM D5185m				0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	<1	<1
Barium	ppm	ASTM D5185m	90	0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		<1	0	<1
Magnesium	ppm	ASTM D5185m	90	4	0	2
Calcium	ppm	ASTM D5185m	2	0	0	0
Phosphorus	ppm	ASTM D5185m		0	8	3
Zinc	ppm	ASTM D5185m		48	28	27
CONTAMINANTS	6	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	1	1	0
Sodium	ppm	ASTM D5185m		1	1	<1
Potassium	ppm	ASTM D5185m	>20	0	0	2
Water	%	ASTM D6304	>0.05	0.009	0.007	0.009
ppm Water	ppm	ASTM D6304	>500	99.0	73.5	93.0
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647			3546	2926
Particles >6µm		ASTM D7647	>1300		1025	690
Particles >14µm		ASTM D7647	>80		70	74


Particles >6µm		ASTM D7647	>1300		1025	690
Particles >14µm		ASTM D7647	>80		70	74
Particles >21µm		ASTM D7647	>20		23	33
Particles >38µm		ASTM D7647	>4		0	4
Particles >71µm		ASTM D7647	>3		0	0
Oil Cleanliness		ISO 4406 (c)	>/17/13		19/17/13	17/13
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.40	0.40	0.337


Contact/Location: Service Manager - SCOWOO



OIL ANALYSIS REPORT









VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	🔺 MODER	LIGHT	VLITE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG
FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	42.5	43.3	43.9
SAMPLE IMAGES	6	method	limit/base	current	history1	history2

Color



Bottom

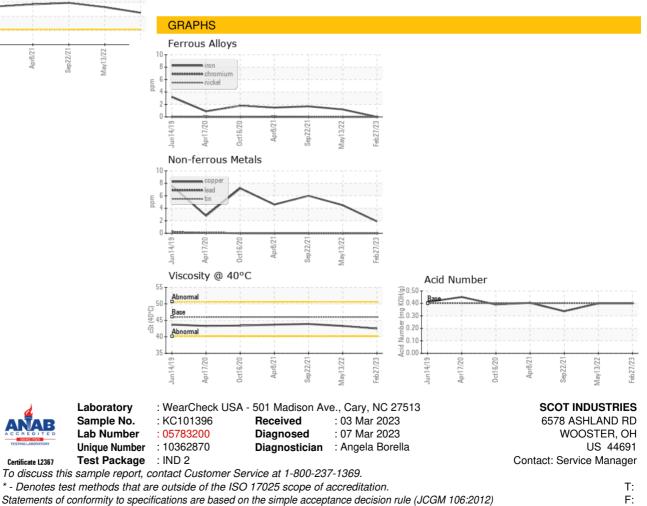

Contact/Location: Service Manager - SCOWOO