


OIL ANALYSIS REPORT

Sample Rating Trend



ISO

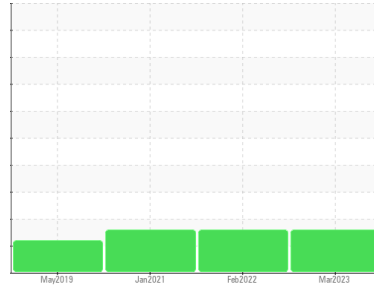

Machine Id
KAESER ASD 25 2329152 (S/N 1137)

Component
Compressor

Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

▲ Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

▲ Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	KCP54530	KCP38283	KCP28093
Sample Date	Client Info	02 Mar 2023	10 Feb 2022	08 Jan 2021
Machine Age	hrs	48930	41804	41803
Oil Age	hrs	3414	0	4807
Oil Changed	Client Info	Not Chngd	Changed	Changed
Sample Status		ABNORMAL	ABNORMAL	ABNORMAL

WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >50	<1	<1	<1
Chromium	ppm	ASTM D5185m >10	0	0	0
Nickel	ppm	ASTM D5185m >3	0	0	0
Titanium	ppm	ASTM D5185m >3	0	0	0
Silver	ppm	ASTM D5185m >2	<1	0	0
Aluminum	ppm	ASTM D5185m >10	<1	0	<1
Lead	ppm	ASTM D5185m >10	0	0	0
Copper	ppm	ASTM D5185m >50	6	6	11
Tin	ppm	ASTM D5185m >10	0	0	<1
Antimony	ppm	ASTM D5185m	---	0	<1
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m 0	0	<1	7
Barium	ppm	ASTM D5185m 90	0	0	0
Molybdenum	ppm	ASTM D5185m 0	0	0	0
Manganese	ppm	ASTM D5185m	0	0	0
Magnesium	ppm	ASTM D5185m 100	39	44	15
Calcium	ppm	ASTM D5185m 0	<1	0	0
Phosphorus	ppm	ASTM D5185m 0	5	14	110
Zinc	ppm	ASTM D5185m 0	23	23	25
Sulfur	ppm	ASTM D5185m 23500	20989	16227	11475

CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >25	<1	<1	<1
Sodium	ppm	ASTM D5185m	20	22	10
Potassium	ppm	ASTM D5185m >20	6	7	6
Water	%	ASTM D6304 >0.05	0.010	0.021	0.010
ppm Water	ppm	ASTM D6304 >500	104.5	213.0	102.6






FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	17350	9172	6257
Particles >6µm	ASTM D7647 >1300	▲ 6896	▲ 3006	▲ 2117
Particles >14µm	ASTM D7647 >80	▲ 428	▲ 233	▲ 222
Particles >21µm	ASTM D7647 >20	▲ 61	▲ 58	▲ 72
Particles >38µm	ASTM D7647 >4	0	● 10	▲ 6
Particles >71µm	ASTM D7647 >3	0	2	0
Oil Cleanliness	ISO 4406 (c) >--/17/13	▲ 21/20/16	▲ 19/15	▲ 18/15

FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045 1.0	0.37	0.377	0.288

OIL ANALYSIS REPORT

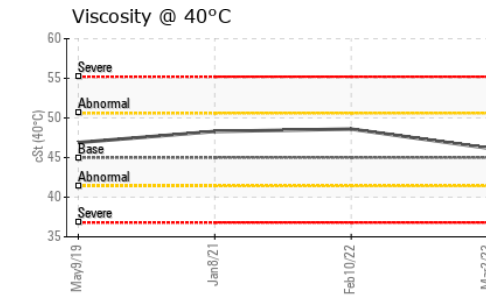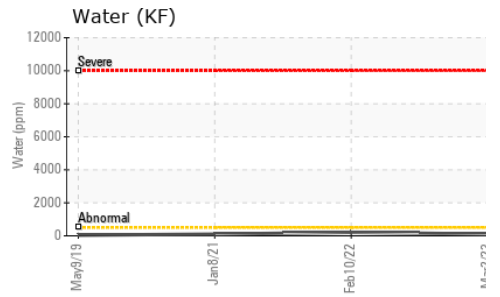
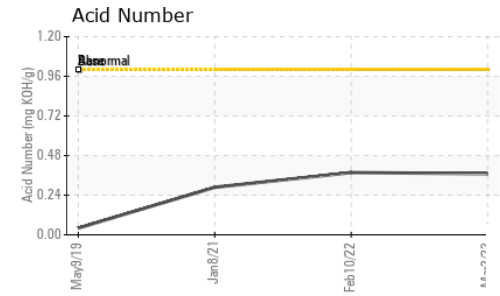
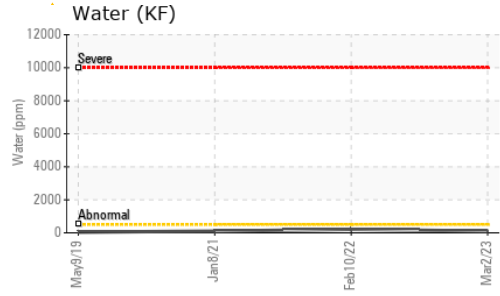
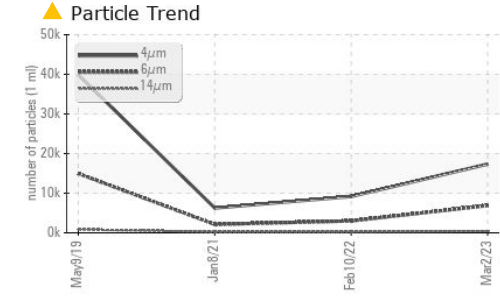


PARAMETER	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 45	46.2	48.6	48.3

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

GRAPHS

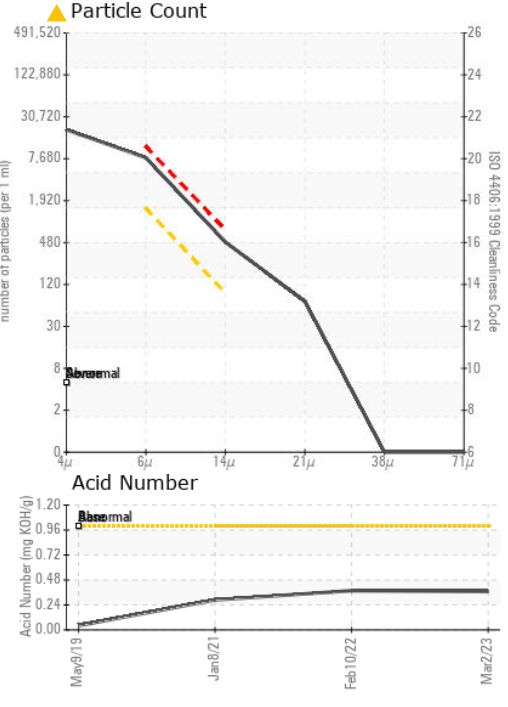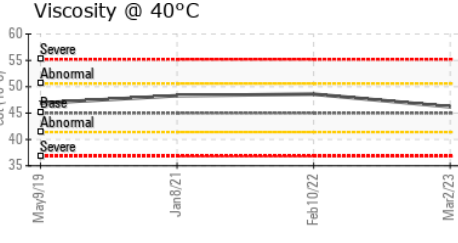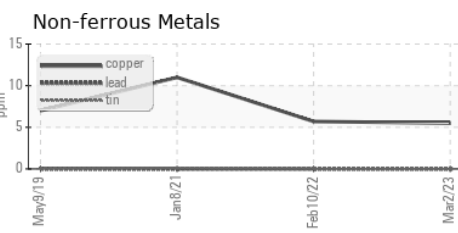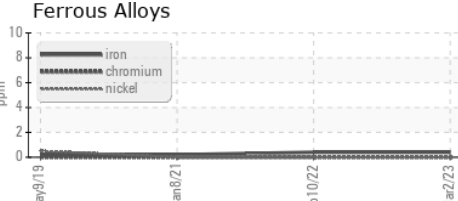

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCP54530 **Received** : 06 Mar 2023
Lab Number : 05784562 **Tested** : 07 Mar 2023
Unique Number : 10364232 **Diagnosed** : 08 Mar 2023 - Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)

HUTTIG BUILDING PRODUCTS
 407 ALUMNI RD
 NEWINGTON, CT
 US 06111
 Contact: D. DORFINGER
 DDORFINGER@HUTTIG.COM
 T:
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)