

# **OIL ANALYSIS REPORT**

Sample Rating Trend

NORMAL



# TARB FLOC DRIVE 1

Component

**Front Gearbox** 

**ROYAL PURPLE POLYGUARD FDA 220 (22 GAL)** 

### Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the

### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

2 GAL)				Mar2023		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		RP0018209		
Sample Date		Client Info		01 Mar 2023		
Machine Age	yrs	Client Info		0		
Oil Age	yrs	Client Info		2		
Oil Changed		Client Info		N/A		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>200	4		
Chromium	ppm	ASTM D5185m	>15	0		
Nickel	ppm	ASTM D5185m	>15	0		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>25	<1		
Lead	ppm	ASTM D5185m	>100	<1		
Copper	ppm	ASTM D5185m	>200	<1		
Tin	ppm	ASTM D5185m	>25	0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		2		
Barium	ppm	ASTM D5185m		0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m		<1		
Calcium	ppm	ASTM D5185m		1		
Phosphorus	ppm	ASTM D5185m		476		
Zinc	ppm	ASTM D5185m		3		
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>50	2		
Sodium	ppm	ASTM D5185m		0		
Potassium	ppm	ASTM D5185m	>20	2		
Water	%	ASTM D6304	>0.2	0.010		
ppm Water	ppm	ASTM D6304	>2000	106.4		
FLUID DEGRADA	NOITA	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		1.50		
VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE		
Yellow Metal	scalar	*Visual	NONE	NONE		
Precipitate	scalar	*Visual	NONE	NONE		
Silt	scalar	*Visual	NONE	NONE		
Debris	scalar	*Visual	NONE	NONE		
Sand/Dirt	scalar	*Visual	NONE	NONE		
Appearance	scalar	*Visual	NORML	NORML		
Odor	scalar	*Visual	NORML	NORML		
<b>Emulsified Water</b>	scalar	*Visual	>0.2	NEG		


NEG

scalar \*Visual

WYATT MURRAY -- CITVALCA



## **OIL ANALYSIS REPORT**

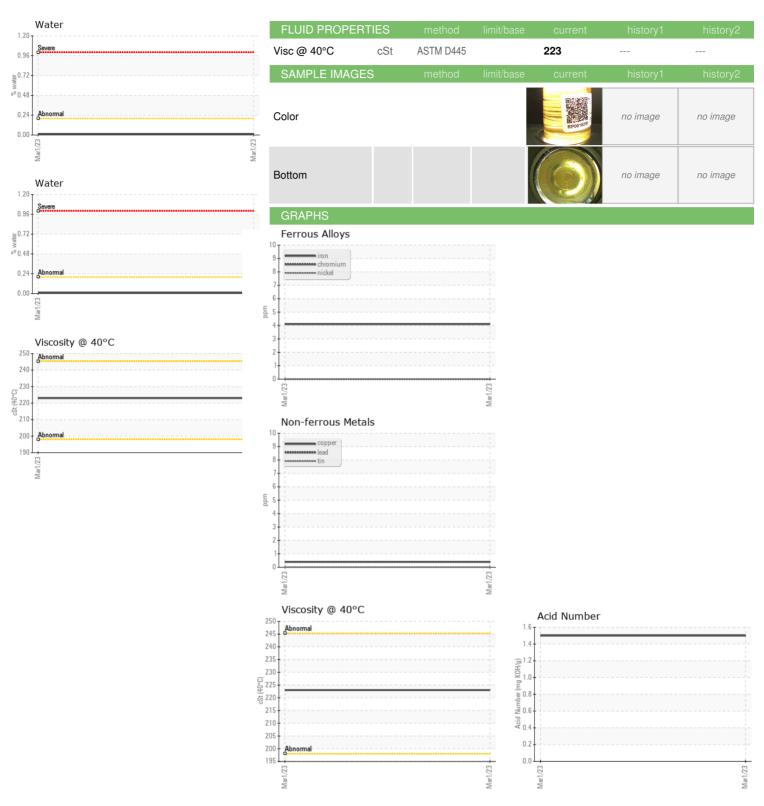





Laboratory Sample No. Lab Number Unique Number : 10372074

Test Package : IND 2

: RP0018209 : 05787403

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 09 Mar 2023 Diagnosed

: 10 Mar 2023 Diagnostician : Don Baldridge

**CITY OF VALLEJO** 202 FLEMING HILL RD. VALLEJO, CA US 94589

T: (707)333-0327

Contact: WYATT MURRAY

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: