




# PROBLEM SUMMARY


Sample Rating Trend

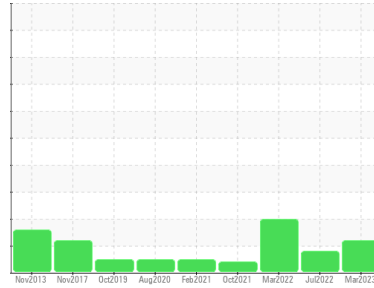

Machine Id  
**KAESER DSD150 4108007 (S/N 1093)**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) FG-460 (--- GAL)**

## COMPONENT CONDITION SUMMARY

▲ Particle Trend

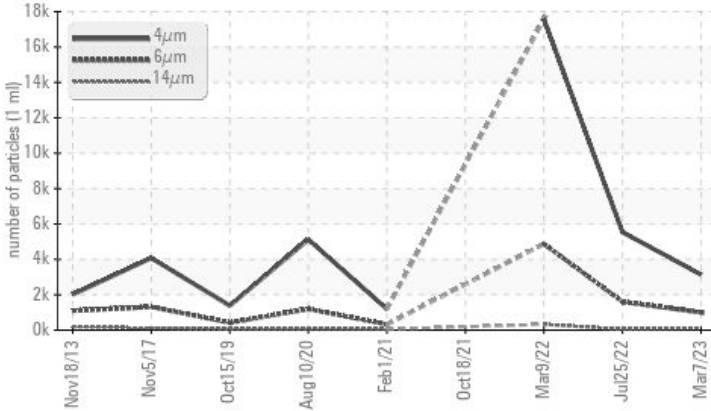

## RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

## PROBLEMATIC TEST RESULTS

Sample Status			ATTENTION	ATTENTION	ABNORMAL
Particles >14µm	ASTM D7647	>80	▲ <b>103</b>	45	▲ 324
Particles >21µm	ASTM D7647	>20	▲ <b>33</b>	10	▲ 90
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ <b>19/17/14</b>	▲ 20/18/13	▲ 19/16

Customer Id: GREKNO  
 Sample No.: KCPA000287  
 Lab Number: 05790454  
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
 Don Baldrige +1  
[don.b505@comcast.net](mailto:don.b505@comcast.net)

To change component or sample information:  
 Customer Service +1 1-800-237-1369  
[customerservice@wearcheck.com](mailto:customerservice@wearcheck.com)

## RECOMMENDED ACTIONS

*There are no recommended actions for this sample.*

## HISTORICAL DIAGNOSIS

### 25 Jul 2022 Diag: Angela Borella

#### ISO



Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



### 09 Mar 2022 Diag: Don Baldrige

#### WEAR



No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. The aluminum level is abnormal. All other component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



### 18 Oct 2021 Diag: Jonathan Hester

#### VIS DEBRIS



Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample. All component wear rates are normal. Moderate concentration of visible dirt/debris present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


view report





# OIL ANALYSIS REPORT

Sample Rating Trend

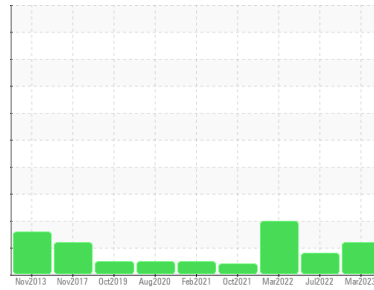

Machine Id  
**KAESER DSD150 4108007 (S/N 1093)**

Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) FG-460 (--- GAL)**

## DIAGNOSIS

**Recommendation**  
 No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

**Wear**  
 All component wear rates are normal.

**Contamination**  
 There is a moderate amount of particulates present in the oil.

**Fluid Condition**  
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>KCPA000287</b>	KCP51578	KCP41143
Sample Date	Client Info		<b>07 Mar 2023</b>	25 Jul 2022	09 Mar 2022
Machine Age	hrs	Client Info	<b>79609</b>	76005	73538
Oil Age	hrs	Client Info	<b>0</b>	4435	2487
Oil Changed	Client Info		<b>N/A</b>	Changed	Changed
Sample Status			<b>ATTENTION</b>	ATTENTION	ABNORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>2</b>	4	7
Chromium	ppm	ASTM D5185m >10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m >3	<b>0</b>	<1	0
Titanium	ppm	ASTM D5185m >3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m >2	<b>0</b>	<1	<1
Aluminum	ppm	ASTM D5185m >10	<b>4</b>	6	<b>▲ 13</b>
Lead	ppm	ASTM D5185m >10	<b>0</b>	0	<1
Copper	ppm	ASTM D5185m >50	<b>1</b>	3	1
Tin	ppm	ASTM D5185m >10	<b>0</b>	<1	<1
Antimony	ppm	ASTM D5185m	<b>---</b>	---	---
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	<1

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	0	<1
Barium	ppm	ASTM D5185m	<b>1</b>	0	0
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>0</b>	0	<1
Magnesium	ppm	ASTM D5185m	<b>2</b>	1	0
Calcium	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Phosphorus	ppm	ASTM D5185m 500	<b>31</b>	109	148
Zinc	ppm	ASTM D5185m	<b>4</b>	35	26
Sulfur	ppm	ASTM D5185m	<b>981</b>	1082	1085

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>&lt;1</b>	0	0
Sodium	ppm	ASTM D5185m	<b>1</b>	<1	0
Potassium	ppm	ASTM D5185m >20	<b>&lt;1</b>	0	1
Water	%	ASTM D6304 >0.05	<b>0.003</b>	0.003	0.003
ppm Water	ppm	ASTM D6304 >500	<b>39.6</b>	29.8	29.0

## FLUID CLEANLINESS


	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>3139</b>	5539	17569
Particles >6µm	ASTM D7647 >1300		<b>1001</b>	<b>▲ 1604</b>	<b>▲ 4872</b>
Particles >14µm	ASTM D7647 >80		<b>▲ 103</b>	45	<b>▲ 324</b>
Particles >21µm	ASTM D7647 >20		<b>▲ 33</b>	10	<b>▲ 90</b>
Particles >38µm	ASTM D7647 >4		<b>1</b>	2	3
Particles >71µm	ASTM D7647 >3		<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>--/17/13	<b>▲ 19/17/14</b>	<b>▲ 20/18/13</b>	<b>▲ 19/16</b>

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 1.5	<b>0.40</b>	0.66	0.649


# OIL ANALYSIS REPORT

### ▲ Particle Trend

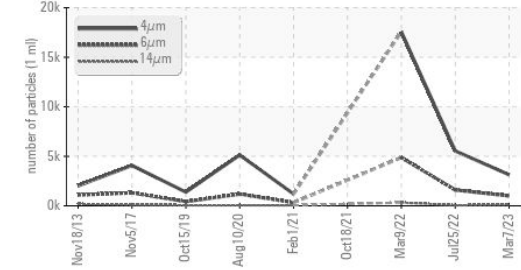


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

### Water (KF)

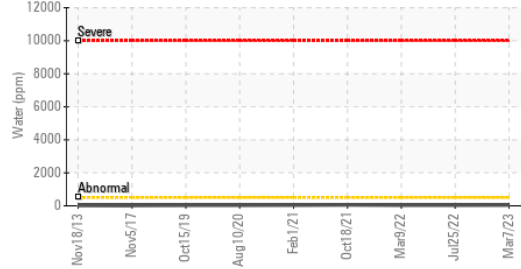


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	47.6	47.9

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

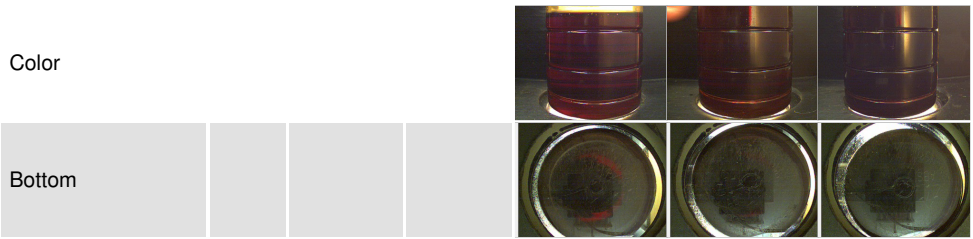


### Acid Number

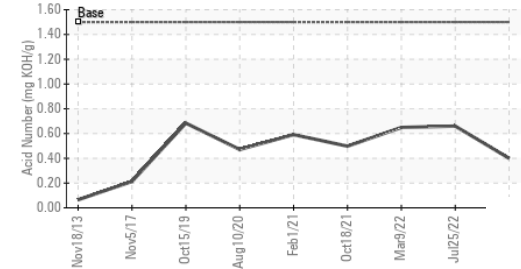


### GRAPHS


#### Ferrous Alloys

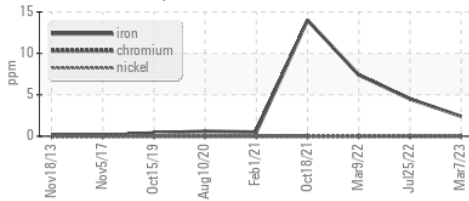


#### Non-ferrous Metals

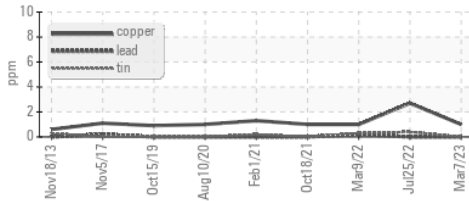


#### Viscosity @ 40°C

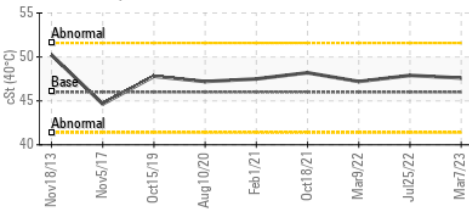

#### ▲ Particle Count

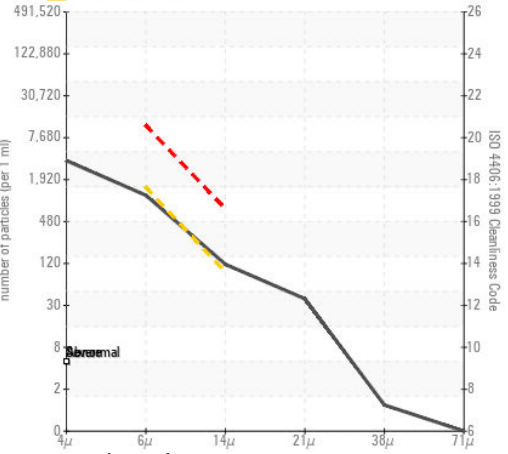

#### Acid Number

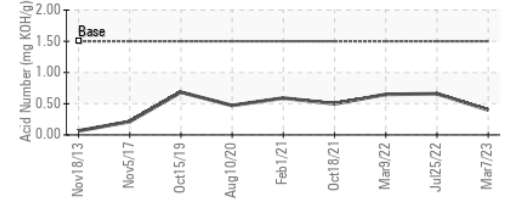

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA000287 **Received** : 13 Mar 2023  
**Lab Number** : 05790454 **Diagnosed** : 15 Mar 2023  
**Unique Number** : 10375125 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**GREEN MOUNTAIN COFFEE**  
 3109 WATER PLANT RD  
 KNOXVILLE, TN  
 US 37914  
 Contact: RONNIE BURCHFIELD  
 ronnie.burchfield@kdrp.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)