


OIL ANALYSIS REPORT

Sample Rating Trend



WATER

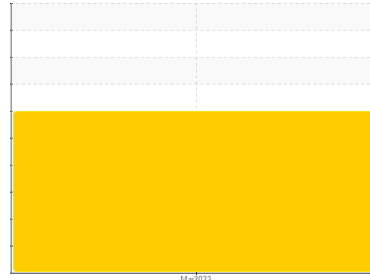

Machine Id
KAESER AS 36 3613067 (S/N 19898)

Component
Compressor
Fluid
{not provided} (--- GAL)

DIAGNOSIS

▲ Recommendation

We advise that you stop the unit and follow the water drain-off procedure for this component. We recommend an early resample in 500 hours to monitor this condition.

▲ Wear

The copper level is abnormal. All other component wear rates are normal.

▲ Contamination

There is a high amount of particulates present in the oil. Free water present. There is a light concentration of water present in the oil.

● Fluid Condition

The oil viscosity is lower than normal. Additive levels consistent with Kaeser Sigma type of oil. The AN level is acceptable for this fluid.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	KCP47539D	---	---
Sample Date	Client Info	19 Mar 2023	---	---
Machine Age	hrs Client Info	0	---	---
Oil Age	hrs Client Info	0	---	---
Oil Changed	Client Info	Not Changed	---	---
Sample Status		ABNORMAL	---	---

WEAR METALS

method	limit/base	current	history1	history2
Iron ppm ASTM D5185m	>50	3	---	---
Chromium ppm ASTM D5185m	>10	0	---	---
Nickel ppm ASTM D5185m	>3	0	---	---
Titanium ppm ASTM D5185m	>3	0	---	---
Silver ppm ASTM D5185m	>2	<1	---	---
Aluminum ppm ASTM D5185m	>10	3	---	---
Lead ppm ASTM D5185m	>10	0	---	---
Copper ppm ASTM D5185m	>50	▲ 74	---	---
Tin ppm ASTM D5185m	>10	1	---	---
Vanadium ppm ASTM D5185m		0	---	---
Cadmium ppm ASTM D5185m		0	---	---

ADDITIVES

method	limit/base	current	history1	history2
Boron ppm ASTM D5185m		0	---	---
Barium ppm ASTM D5185m		0	---	---
Molybdenum ppm ASTM D5185m		0	---	---
Manganese ppm ASTM D5185m		<1	---	---
Magnesium ppm ASTM D5185m		0	---	---
Calcium ppm ASTM D5185m		0	---	---
Phosphorus ppm ASTM D5185m		4	---	---
Zinc ppm ASTM D5185m		1	---	---
Sulfur ppm ASTM D5185m		13728	---	---

CONTAMINANTS

method	limit/base	current	history1	history2
Silicon ppm ASTM D5185m	>25	9	---	---
Sodium ppm ASTM D5185m		1	---	---
Potassium ppm ASTM D5185m	>20	0	---	---
Water % ASTM D6304	>0.05	▲ 0.135	---	---
ppm Water ppm ASTM D6304	>500	▲ 1350	---	---






FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm ASTM D7647		2097	---	---
Particles >6µm ASTM D7647	>1300	1142	---	---
Particles >14µm ASTM D7647	>80	▲ 194	---	---
Particles >21µm ASTM D7647	>20	▲ 65	---	---
Particles >38µm ASTM D7647	>4	● 10	---	---
Particles >71µm ASTM D7647	>3	1	---	---
Oil Cleanliness ISO 4406 (c)	>--/17/13	▲ 18/17/15	---	---

FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN) mg KOH/g ASTM D8045		0.37	---	---


OIL ANALYSIS REPORT

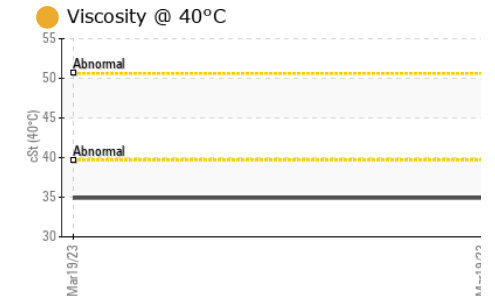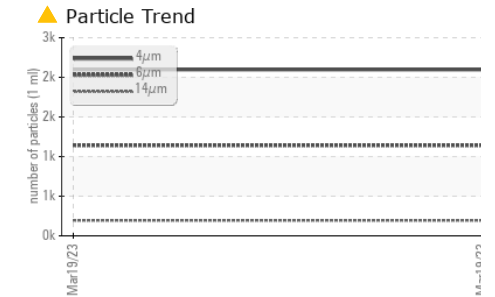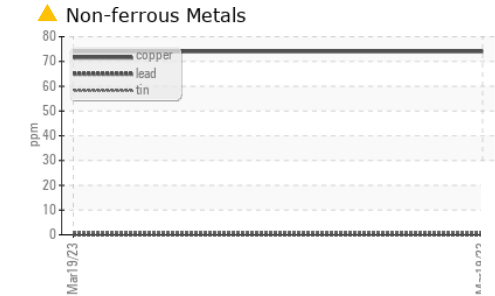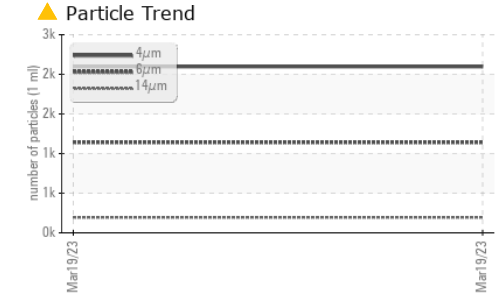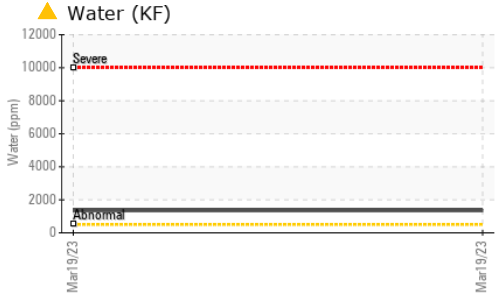






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	LIGHT	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	0.2%	---
Free Water	scalar	*Visual		1.0	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	34.9	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

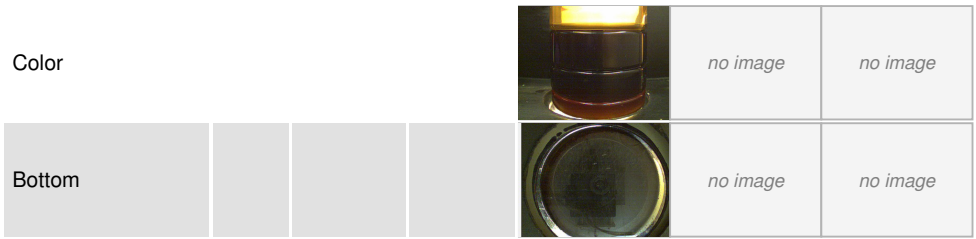

GRAPHS

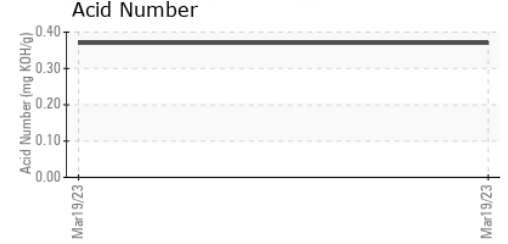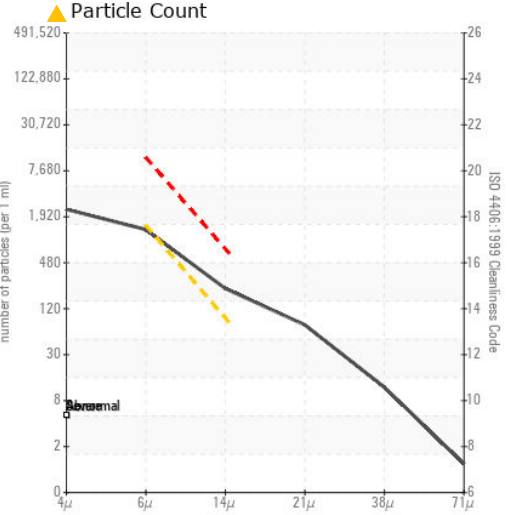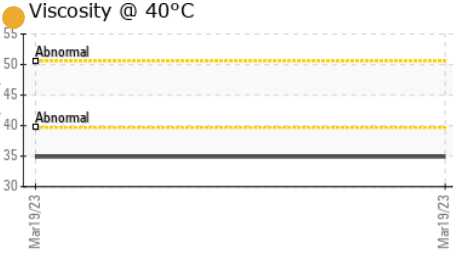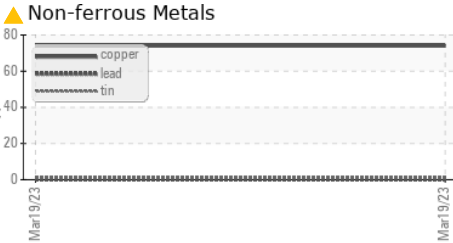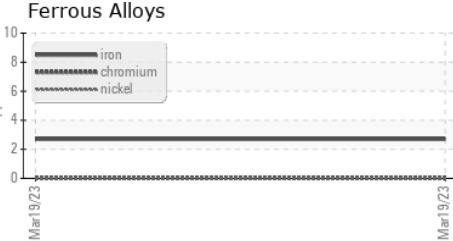

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCP47539D **Received** : 17 Mar 2023
Lab Number : 05795169 **Tested** : 24 Mar 2023
Unique Number : 10384853 **Diagnosed** : 26 Mar 2023 - Doug Bogart
Test Package : IND 2 (Additional Tests: KF, PrtCount)

CALIFORNIA DOOR CORPORATION
 1800 ABBOTT ST
 SALINAS, CA
 US 93901
 Contact: M. SOUZA
 msouza@caldoor.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)