OIL ANALYSIS REPORT

Sample Rating Trend

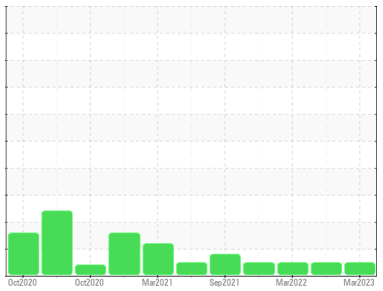

NORMAL

Area
Red Bluff Plant/Cryogenic/Compressor
Machine Id
FRICK C-162
Component
Rotary Compressor
Fluid
TULCO LUBSOIL SYN RL WI 100 (250 GAL)

DIAGNOSIS

Recommendation
Resample at the next service interval to monitor.

Wear
All component wear rates are normal.

Contamination
There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition
The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number		Client Info		**TO90002292**	TO9012035	TO90000697
Sample Date		Client Info		**14 Mar 2023**	28 Apr 2022	08 Mar 2022
Machine Age	hrs	Client Info		**0**	0	0
Oil Age	hrs	Client Info		**0**	0	0
Oil Changed		Client Info		**N/A**	N/A	N/A
Sample Status				**NORMAL**	NORMAL	NORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>70	**2**	1	0
Chromium	ppm	ASTM D5185m	>10	**0**	0	0
Nickel	ppm	ASTM D5185m		**<1**	0	0
Titanium	ppm	ASTM D5185m		**0**	0	0
Silver	ppm	ASTM D5185m		**0**	0	<1
Aluminum	ppm	ASTM D5185m	>3	**1**	0	<1
Lead	ppm	ASTM D5185m	>4	**0**	<1	0
Copper	ppm	ASTM D5185m	>20	**0**	0	0
Tin	ppm	ASTM D5185m	>3	**<1**	<1	<1
Antimony	ppm	ASTM D5185m		**---**	---	0
Vanadium	ppm	ASTM D5185m		**<1**	0	0
Cadmium	ppm	ASTM D5185m		**0**	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		**0**	2	2
Barium	ppm	ASTM D5185m		**0**	0	0
Molybdenum	ppm	ASTM D5185m		**<1**	0	0
Manganese	ppm	ASTM D5185m		**<1**	0	0
Magnesium	ppm	ASTM D5185m		**1**	<1	0
Calcium	ppm	ASTM D5185m		**4**	42	<1
Phosphorus	ppm	ASTM D5185m	1500	**1179**	1144	742
Zinc	ppm	ASTM D5185m		**8**	15	2
Sulfur	ppm	ASTM D5185m		**16**	100	17

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>45	**<1**	1	0
Sodium	ppm	ASTM D5185m		**1**	1	<1
Potassium	ppm	ASTM D5185m	>20	**1**	<1	0
Water	%	ASTM D6304	>2.26	**0.00**	0.090	0.008
ppm Water	ppm	ASTM D6304	>22600	**0.00**	902.5	83.0

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>2500	**1090**	486	574
Particles >6µm		ASTM D7647	>320	**250**	95	175
Particles >14µm		ASTM D7647	>80	**21**	10	19
Particles >21µm		ASTM D7647	>20	**7**	3	7
Particles >38µm		ASTM D7647	>4	**1**	0	0
Particles >71µm		ASTM D7647	>3	**0**	0	0
Oil Cleanliness		ISO 4406 (c)	>18/15/13	**17/15/12**	16/14/10	16/15/11

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.04	**0.028**	0.044	0.59

OIL ANALYSIS REPORT

Water (KF)

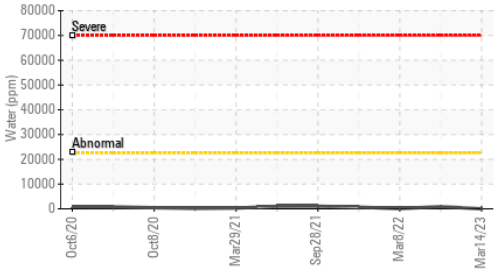

Viscosity @ 100°C

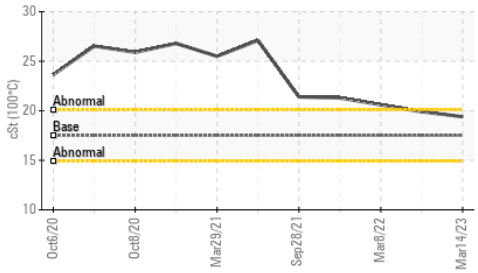

Particle Trend

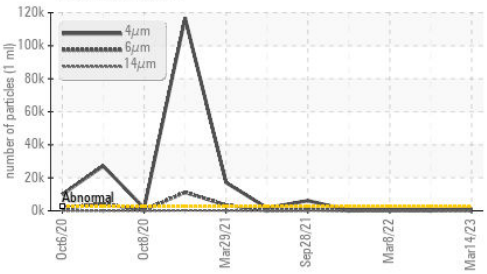

Viscosity @ 100°C

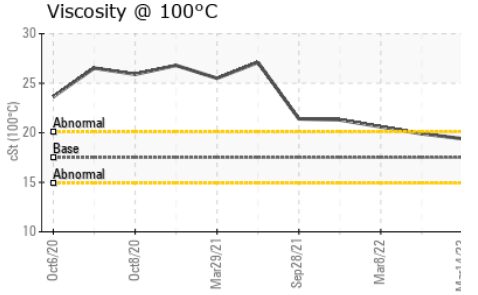

Viscosity @ 40°C

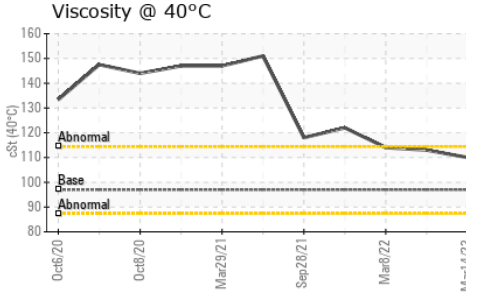

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	**NONE**	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	**NONE**	NONE	NONE
Precipitate	scalar	*Visual	NONE	**NONE**	NONE	NONE
Silt	scalar	*Visual	NONE	**NONE**	NONE	NONE
Debris	scalar	*Visual	NONE	**NONE**	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	**NONE**	NONE	NONE
Appearance	scalar	*Visual	NORML	**NORML**	NORML	NORML
Odor	scalar	*Visual	NORML	**NORML**	NORML	NORML
Emulsified Water	scalar	*Visual	>2.26	**NEG**	NEG	NEG
Free Water	scalar	*Visual		**NEG**	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	97	**110**	113	114
Visc @ 100°C	cSt	ASTM D445	17.5	**19.4**	19.9	20.6
Viscosity Index (VI)	Scale	ASTM D2270	198	**199**	200	206

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

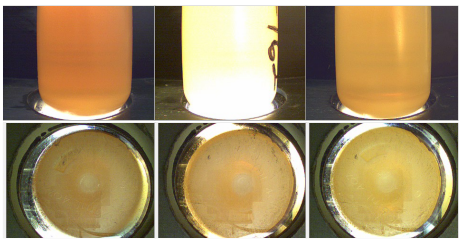

GRAPHS

Ferrous Alloys

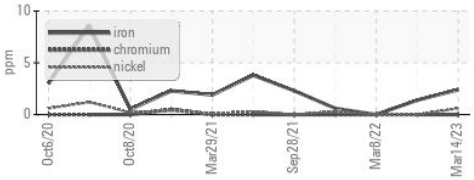

Non-ferrous Metals

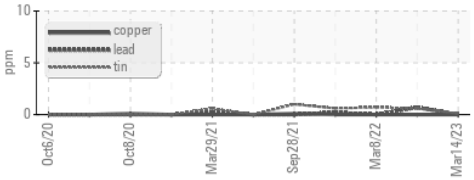

Viscosity @ 40°C

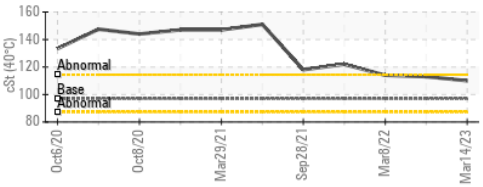

Particle Count

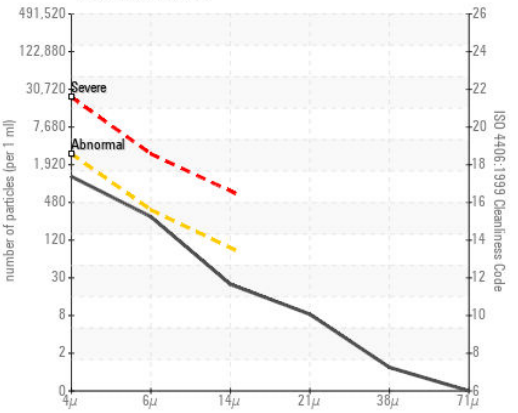

Acid Number

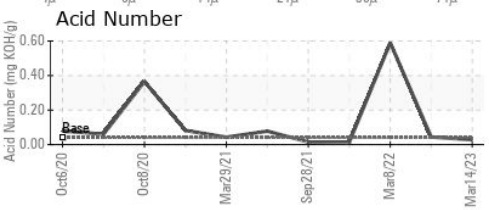

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : TO90002292
Lab Number : 05797421
Unique Number : 10387105
Test Package : IND 2 (Additional Tests: KF, KV100, PrtCount, VI)

Received : 21 Mar 2023
Tested : 22 Mar 2023
Diagnosed : 23 Mar 2023 - Doug Bogart

To discuss this sample report, contact Customer Service at 1-800-237-1369.
** - Denotes test methods that are outside of the ISO 17025 scope of accreditation.*
Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

ENERGY TRANSFER - RED BLUFF/ORLA PLANT
770 CR 437
ORLA, TX
US 79770
Contact: STUART TAYLOR
stuart.taylor@energytransfer.com
T:
F:

Report Id: ENEORL [WUSCAR] 05797421 (Generated: 05/22/2024 13:26:16) Rev: 1

Submitted By: ERIC THORNTON