

OIL ANALYSIS REPORT

Sample Rating Trend



Machine Id MOTIVA UNIT 12

Component

Outboard Bearing

ROYAL PURPLE SYNFILM GT 32 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.




Sample Number		Client Info		RP0028241		
Sample Date		Client Info		16 Feb 2023		
Machine Age	hrs	Client Info		0		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>20	0		
Chromium	ppm	ASTM D5185m	>20	0		
Nickel	ppm	ASTM D5185m	>20	0		
Titanium	ppm	ASTM D5185m		<1		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>20	0		
Lead	ppm	ASTM D5185m	>20	0		
Copper	ppm	ASTM D5185m	>20	6		
Tin	ppm	ASTM D5185m	>20	2		
Vanadium	ppm	ASTM D5185m		<1		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m		0		
Molybdenum	ppm	ASTM D5185m		<1		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m		79		
Calcium	ppm	ASTM D5185m		0		
Phosphorus	ppm	ASTM D5185m		10		
Zinc	ppm	ASTM D5185m		5		
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	2		
Sodium	ppm	ASTM D5185m	710	_ 1		
Potassium	ppm	ASTM D5185m	>20	- <1		
Water	%	ASTM D6304	>2	0.027		
ppm Water	ppm	ASTM D6304	. –	273.4		
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
Acid Number (AN)		ASTM D8045		0.34		
VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE		
Yellow Metal	scalar	*Visual	NONE	NONE		
Precipitate	scalar	*Visual	NONE	NONE		
Silt	scalar	*Visual	NONE	NONE		
Debris	scalar	*Visual	NONE	NONE		
Sand/Dirt	scalar	*Visual	NONE	NONE		
Jana, Dire						
Appearance						
Appearance Odor	scalar	*Visual	NORML	NORML		
Appearance Odor Emulsified Water						

NEG

ition:-LOGAN SEYL --MAGHOU



OIL ANALYSIS REPORT

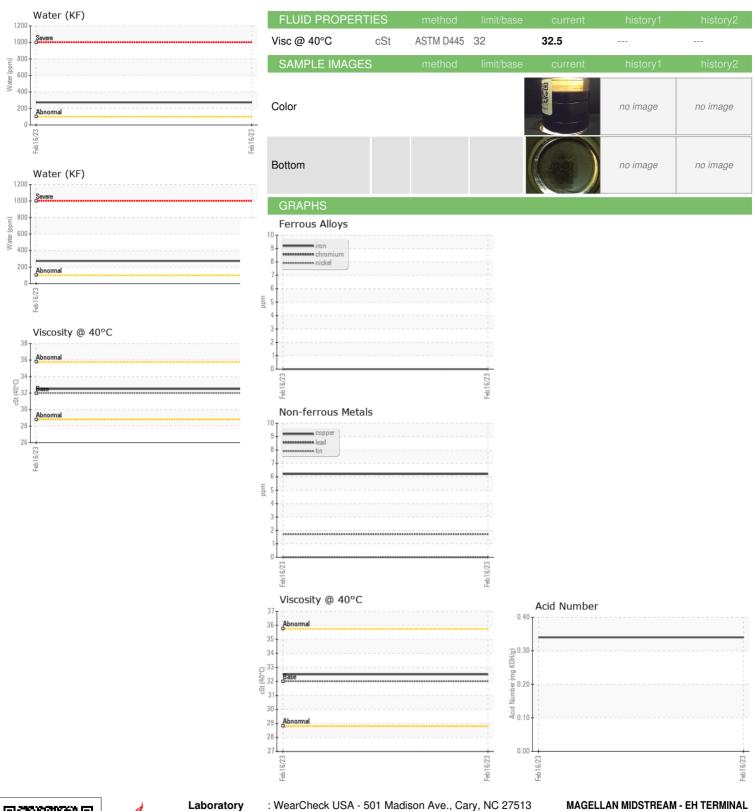



Certificate L2367

Laboratory Sample No. Lab Number Test Package : IND 2

: 05797603 Unique Number : 10387287

: RP0028241

Received Diagnosed Diagnostician : Don Baldridge

: 21 Mar 2023 : 23 Mar 2023 **MAGELLAN MIDSTREAM - EH TERMINAL** 7901 WALLISVILLE RD

HOUSTON, TX US 77029

Contact: LOGAN SEYL logan.seyl@magellanlp.com T:

To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: